



ACTION PLAN



Los Angeles
Department of
Water & Power

In Partnership With

W S O

Water Systems
Optimization, Inc.

September 2015

National
Leaders in
Water Loss
Prevention

Acknowledgements

We would like to thank the Water Loss Task Force for all of their work in completing this Action Plan.

Mario Acevedo	Albert Gastelum	Jose Martinez	Ani Siyahian
Martin Adams	Brian Gibson	George Mavrakis	Tim Spinn
Edgardo Agustin	Ricky Glover	Mike Miller	Reinhard Sturm
Greg Algorri	Priscilla Gonzalez	Vee Miller	Salman Sufi
Jaime Almaraz	Mike Grahek	Charles Ngo	Dean Terada
Greg Ammon	Sharon Grove	Ehinomen Nwani	Eric Tillemans
Shabbir Baldiwala	Mona Guirguis	John Otoshi	Robert Tokashiki
Darlene Battle	Richard Harasick	Annamae Peji	Jordan Tolle
Alvin Bautista	Kathie Hirata	Adam Perez	Hugo Torres
Jeff Bray	Cree Horner	Marce-Adrian Perez	Mark Townsend
Joe Castruita	Greg Hornsby	David Pettijohn	Du Tran
Flora Chang	Simon Hsu	Linh Phan	Stephan Tucker
Dave Christensen	Todd Huynh	Russ Pierson	Craig Underwood
Phil Clark	Jeff Kauf	Cliff Plumb	Kim Versluis
Steven Cole	Terri Koch	Ethelinda Reyes	Bill Van Wagoner
Anselmo Collins	Delon Kwan	Gonzalo Reyes	Greg Van
Clinetta Collins	Jevon Lam	Vincent Rivera	Nance Walker-Bonnelli
John Cox	Matt Lampe	Earl Rodgers	Julie Wang
Donald Cresse	Todd Le	George Rofail	Gary Warden
Kevin Daugherty	David Leonard	Javier Romero	Gloria Williams
Carlos De La Roca	Jonathan Leung	Susan Rowghani	Wayne Wohler
Charnpreet Dhillon	Andrew Linard	Stefan Sadeli	David Wright
Mike Downs	Breonia Lindsey	Adolfo Sanchez	Kathy Wright
Peter Dugan	Greg Loveland	Paul Scantlin	James Yannotta
Penny Falcon	Carolina Maldonado	Vlad Scutelnicu	Miki Yonamine
Amgad Farag	Sal Mancilla	Guillermo Serrano	George Zordilla
Patrick Findley	Raz Manoukian	Keith Session	
Kate Gasner	Sofia Marcus	Minas Sirakie	

Table of Contents

Acknowledgements.....	iii
Table of Contents	v
List of Acronyms and Abbreviations	x
Executive Summary.....	1
Background	3
Organization of this Report.....	7
Section 1: System Input Volume	9
Recommendation 1.1: <i>LA Aqueduct Filtration Plant System Input Volume Meters</i>	9
Recommendation 1.2: <i>LA Reservoir West Outlet Meter Installation</i>	14
Recommendation 1.3: <i>Well Field Meter Accuracy and Regular Testing</i>	17
Recommendation 1.4: <i>Storage Data Tracking</i>	25
Recommendation 1.5: <i>MWD LA-25 Connection Meter Installation</i>	28
Section 2: Database Management.....	33
Recommendation 2.1: <i>Water Control Systems Database Consolidation</i>	33
Recommendation 2.2: <i>Recycled Water and Treatment Process Water Tracking</i>	37
Recommendation 2.3: <i>CIS and WMIS Inconsistencies</i>	41
Recommendation 2.4: <i>Leak Database Consolidation and Accuracy</i>	45
Section 3: Meter Testing and Replacement.....	51
Recommendation 3.1: <i>Customer Meter Sizing and Regular Consumption Profiling</i>	51
Recommendation 3.2: <i>Testing of Small Customer Meters</i>	54
Recommendation 3.3: <i>Replacement of Worst Performing Small Customer Meters</i>	59
Recommendation 3.4: <i>Large Meter Maintenance Schedule Overhaul</i>	62
Section 4: Leak Detection and Prevention.....	65
Recommendation 4.1: <i>Pressure Management Improvement and Pilot Study</i>	67
Recommendation 4.2: <i>Leak Location and Repair Time Reduction</i>	79
Recommendation 4.3: <i>Active Leak Detection</i>	85
Section 5: Unmetered and Unauthorized Consumption	91
Recommendation 5.1: <i>Unauthorized Consumption Volume Tracking</i>	91

Recommendation 5.2: *Authorized Unmetered Uses Tracking* 98
Conclusion 103
Appendix 105

List of Tables

Table 1: FY 2010-2011 Performance Indicators 5
Table 2: Estimated Cost for Recommendation 1.1, Action 1 13
Table 3: Estimated Time for Recommendation 1.1, Action 1 13
Table 4: Estimated Cost for Recommendation 1.1, Action 2 14
Table 5: Estimated Time for Recommendation 1.1, Action 2 14
Table 6: Estimated Cost for Recommendation 1.2, Action 1 16
Table 7: Estimated Time for Recommendation 1.2, Action 1 16
Table 8: Summary of Flow Meters & Connectivity at LADWP Well Fields 18
Table 9: Estimated Cost for Recommendation 1.3, Action 1 21
Table 10: Estimated Time for Recommendation 1.3, Action 1 21
Table 11: Estimated Cost for Recommendation 1.3, Action 2 22
Table 12: Estimated Time for Recommendation 1.3, Action 2 22
Table 13: Manufacturer’s Flow Meter Calibration Requirements 23
Table 14: Estimated Cost for Recommendation 1.3, Action 3 24
Table 15: Estimated Time for Recommendation 1.3, Action 3 24
Table 16: Major Reservoirs and Tanks 25
Table 17: Estimated Cost for Recommendation 1.4, Action 1 27
Table 18: Estimated Time for Recommendation 1.4, Action 1 27
Table 19: Volume of Treated Water Billed from MWD LA-25 28
Table 20: Estimated Cost for Recommendation 1.5, Action 1 29
Table 21: Estimated Time for Recommendation 1.5, Action 1 30
Table 22: Estimated Cost for Recommendation 1.5, Action 2 31
Table 23: Estimated Time for Recommendation 1.5, Action 2 31
Table 24: LADWP Water Control Systems 34
Table 25: Estimated Cost for Recommendation 2.1, Action 1 35
Table 26: Estimated Time for Recommendation 2.1, Action 1 35

Table 27: Estimated Cost for Recommendation 2.1, Action 2..... 36

Table 28: Estimated Time for Recommendation 2.1, Action 2..... 36

Table 29: Estimated Cost for Recommendation 2.2, Action 1..... 40

Table 30: Estimated Time for Recommendation 2.2, Action 1..... 40

Table 31: Estimated Cost for Recommendation 2.2, Action 2..... 41

Table 32: Estimated Time for Recommendation 2.2, Action 2..... 41

Table 33: Number of Cross-Database Discrepancies Checked During CISCON 43

Table 34: Estimated Cost for Recommendation 2.3, Action 1..... 44

Table 35: Estimated Time for Recommendation 2.3, Action 1..... 45

Table 36: Main Leaks Data Quality 46

Table 37: Service Leaks Between Main and Curb Data Quality 47

Table 38: Service Leaks Between Curb and Meter Box Data Quality 47

Table 39: Estimated Cost for Recommendation 2.4, Action 1..... 49

Table 40: Estimated Time for Recommendation 2.4, Action 1..... 49

Table 41: Estimated Cost for Recommendation 3.1, Action 1..... 53

Table 42: Estimated Time for Recommendation 3.1, Action 1..... 54

Table 43: Estimated Cost for Recommendation 3.2, Action 1..... 56

Table 44: Estimated Time for Recommendation 3.2, Action 1..... 57

Table 45: Estimated Cost for Recommendation 3.2, Action 2..... 58

Table 46: Estimated Time for Recommendation 3.2, Action 2..... 58

Table 47: Estimated Cost for Recommendation 3.3, Action 1..... 61

Table 48: Estimated Time for Recommendation 3.3, Action 1..... 61

Table 49: Estimated Cost for Recommendation 3.4, Action 1..... 64

Table 50: Estimated Time for Recommendation 3.4, Action 1..... 64

Table 51: Estimated Cost for Recommendation 4.1, Action 1..... 73

Table 52: Estimated Time for Recommendation 4.1, Action 1..... 74

Table 53: Estimated Cost for Recommendation 4.1, Action 2..... 75

Table 54: Estimated Time for Recommendation 4.1, Action 2..... 75

Table 55: Estimated Cost for Recommendation 4.1, Action 3..... 76

Table 56: Estimated Time for Recommendation 4.1, Action 3..... 76

Table 57: Estimated Cost for Recommendation 4.1, Action 4..... 77

Table 58: Estimated Time for Recommendation 4.1, Action 4..... 77

Table 59: Estimated Cost for Recommendation 4.1, Action 5..... 78

Table 60: Estimated Time for Recommendation 4.1, Action 5..... 78

Table 61: Summary of Economic Analysis of Improved Location and Repair Times for Main Line Failures
..... 80

Table 62: Summary of Economic Analysis of Improved Location and Repair Times for Service Lines Failure
and Meter Leaks 80

Table 63: Estimated Cost for Recommendation 4.2, Action 1..... 83

Table 64: Estimated Time for Recommendation 4.2, Action 1..... 83

Table 65: Estimated Cost for Recommendation 4.2, Action 2..... 84

Table 66: Estimated Time for Recommendation 4.2, Action 2..... 84

Table 67: Estimated Cost for Recommendation 4.3, Action 1..... 86

Table 68: Estimated Time for Recommendation 4.3, Action 1..... 86

Table 69: Estimated Cost for Recommendation 4.3, Action 2..... 87

Table 70: Estimated Time for Recommendation 4.3, Action 2..... 87

Table 71: Estimated Cost for Recommendation 4.3, Action 3..... 89

Table 72: Estimated Time for Recommendation 4.3, Action 3..... 89

Table 73: Estimated Cost for Recommendation 4.3, Action 4..... 90

Table 74: Estimated Time for Recommendation 4.3, Action 4..... 90

Table 75: Estimated Cost for Recommendation 5.1, Action 1..... 94

Table 76: Estimated Time for Recommendation 5.1, Action 1..... 95

Table 77: Estimated Cost for Recommendation 5.1, Action 2..... 96

Table 78: Estimated Time for Recommendation 5.1, Action 2..... 96

Table 79: Estimated Cost for Recommendation 5.1, Action 3..... 97

Table 80: Estimated Time for Recommendation 5.1, Action 3..... 97

Table 81: Estimated Cost for Recommendation 5.2, Action 1..... 100

Table 82: Estimated Time for Recommendation 5.2, Action 1..... 100

Table 83: Estimated Cost for Recommendation 5.2, Action 2..... 101

Table 84: Estimated Time for Recommendation 5.2, Action 2..... 101

Table 85: Summary of Recommended Actions.....	103
Table 86: List of Sections, Recommended Actions, and Key LADWP Staff	105

List of Figures

Figure 1: Standardized Components of the Annual Water Balance (Not to Scale)	3
Figure 2: System Input Volume Identified in the Water Balance (Not to Scale).....	9
Figure 3: Schematic of Meters Tracking Supply Volumes at LAAFP.....	10
Figure 4: LA-25 Volume Determination Mass Balance	28
Figure 5: Billed Metered Authorized Consumption Identified in the Water Balance (Not to Scale).....	37
Figure 6: Diagram Showing Classification of Leak Types A, B, & C	45
Figure 7: Customer Meter Inaccuracies Identified in the Water Balance (Not to Scale).....	51
Figure 8: Real Losses Identified in the Water Balance (Not to Scale).....	65
Figure 9: Four-Component Tool Box for Intervention against Real Losses.....	66
Figure 10: Static Pressure Map of LADWP's Water System.....	70
Figure 11: Leak Density Map of LADWP's Water System	71
Figure 12: Ground Elevation Map of LADWP's Water System.....	72
Figure 13: Seasonal Variation of Leaks in LADWP's Water System	81
Figure 14: Unmetered and Unauthorized Consumption Identified in the Water Balance (Not to Scale) ..	91

List of Acronyms and Abbreviations

AF: Unit of Volume in Acre-Feet

AFY: Unit of Acre-Feet per Year

AMG: Asset Management Group

AMI: Advanced Metering Infrastructure

AWWA: American Water Works Association

AWWA M6: AWWA's Manual on Selection, Installation, Testing and Maintenance of Water Meters

AWWA M36: AWWA's Manual on Water Audits and Loss Control Programs

BEM: Broadband Electromagnetic

BMAC: Billed Metered Authorized Consumption

BMP: Best Management Practice

CCB: Customer Care & Billing

CIS: Customer Information System, also known as CIS/TRES or TRES

CISCON: CIS Conversion to CCB

COBOL: Common Business Oriented Language

CPS: Construction Productivity System

CSD: Customer Services Division

CUWCC: California Urban Water Conservation Council

DCS: Distributed Control System

DWP: See LADWP

DWR: California Department of Water Resources

ERT: Encoder Receiver Transmitter

F/A: Field Activity

FI: Field Investigation

FPS: Unit of Velocity in Feet per Second

FY: Fiscal Year

GIS: Geographic Information Systems

GPM: Unit of Flow in Gallons per Minute

HCF: Unit of Volume in Hundred Cubic Feet

ILI: Infrastructure Leakage Index

ITS: Information Technology Services Division

IWA: International Water Association

JPI: Jensen Plant Inlet

LA: Los Angeles

LAA: Los Angeles Aqueduct (of which there are two: LAA 1 and LAA 2)

LAAFP: Los Angeles Aqueduct Filtration Plant

LABSS: Los Angeles Bureau of Street Services

LADBS: Los Angeles Department of Building and Safety

LADWP: Los Angeles Department of Water and Power, also referenced as the Department or DWP

LAFD: Los Angeles Fire Department

LAPD: Los Angeles Police Department

LAR: Los Angeles Reservoir

LARIAC: Los Angeles Region Imagery Acquisition Consortium

LAWSDAC: Los Angeles Water System Data Acquisition and Control

MA: Management Analyst

M&C: Maintenance & Construction

MDT: Mobile Data Terminal

MG: Unit of Volume in Millions of Gallons

MGY: Unit of Millions of Gallons per Year

MOU: Memorandum of Understanding

MRP: Meter Replacement Program

MWD: Metropolitan Water District of Southern California

NIST: National Institute of Standards and Technology

O&M: Operations & Maintenance

OTS: Operational Technology System

PLC: Programmable Logic Controller

PRV: Pressure Regulating Valve

PSI: Unit of pressure in pounds per square inch

R&C: Repair and Construction

WATER LOSS TASK FORCE

RF: Radio Frequency

RSU: Revenue Security Unit

RTU: Remote Terminal Unit

SCADA: Supervisory Control and Data Acquisition

SFO: Sepulveda Feeder Outlet

SIM: Subscriber Identification Module

TOCC: Treatment Operations Control Center

TRES: See CIS

UCLA: University of California Los Angeles

ULARA: Upper Los Angeles River Area

UME: Unitized Measuring Elements

USA: Underground Service Alert

UV: Ultraviolet

UWMP: Urban Water Management Plan

VGS: Valley Generating Station

WDD: Water Distribution Division

WETS: Water Engineering & Technical Services Division

WIR: Water Investigation Report

WMIS: Work Management Information System

WOD: Water Operations Division

WRD: Water Resources Division

WRF: Water Research Foundation

WSO: Water Systems Optimization, Inc.

WTCS: Water Technology and Control Systems

Executive Summary

This Action Plan was prepared by LADWP's Water Loss Task Force (Task Force) and approved by LADWP management. The purpose of this Action Plan is to assess the recommendations presented in the Water Loss Audit and Component Analysis study completed in 2013 and conducted by Water Systems Optimization, Inc. consultants in conjunction with LADWP staff. The Action Plan includes an assessment of feasibility, cost-effectiveness, and other benefits associated with implementation of the recommendations, as well as a determination of how the recommendations may improve LADWP's Water System efficiency and meet State of California regulatory requirements related to system water losses. These regulatory requirements – such as California Urban Water Conservation Council (CUWCC) Best Management Practice (BMP) Reporting, Assembly Bill 1420, Senate Bill 1420, and Senate Bill 555 – are discussed in the Background section of this Action Plan.

LADWP's Task Force consists of over 100 staff from the following eight divisions:

- Customer Services Division (CSD)
- Information Technology Services Division (ITS)
- Security Services Division (SSD)
- Water Distribution Division (WDD)
- Water Engineering & Technical Services Division (WETS)
- Water Operations Division (WOD)
- Water Quality Division (WQD)
- Water Resources Division (WRD)

The Action Plan was coordinated by the Water Resources Division Water Conservation Policy Group. Water Systems Optimization, Inc. served as consulting technical experts and provided guidance to the key staff during the drafting of the Action Plan. Key LADWP staff who worked on the write-up for each section of this Action Plan are shown in the Appendix.

A summary of recommended actions to reduce water losses in LADWP's water distribution system and improve the validity of data in the annual LADWP water loss audit are presented in the Conclusion section of this Action Plan. Overall it is estimated that the recommended actions will cost just over \$4 million in capital costs and just under \$2 million in operations and maintenance costs.

Background

Water loss control is the method of examining inefficiencies in a utility’s water distribution system and implementing preventative measures to reduce water losses in the system. The American Water Works Association (AWWA) defines *water loss* as the difference between the volume of water supplied to the water distribution system and the volume of water consumed by all authorized uses, including customer demand. Water losses can be further broken out into two categories: *apparent losses* and *real losses*. Apparent losses include meter inaccuracies, unauthorized consumption, and systematic data handling errors. Real losses are piping distribution system leakage. *Non-revenue water* is the sum of unbilled authorized consumption and water losses. Figure 1 shows all of the components of the water balance as defined by the International Water Association (IWA) and the AWWA.

Water Supplied	Authorized Consumption	Billed Authorized Consumption	Billed Metered Consumption	Revenue Water
			Billed Unmetered Consumption	
		Unbilled Authorized Consumption	Unbilled Metered Consumption	Non-Revenue Water
			Unbilled Unmetered Consumption	
	Water Losses	Apparent Losses	Unauthorized Consumption	
			Customer Meter Inaccuracies	
			Data Handling Errors	
Real Losses				

Figure 1: Standardized Components of the Annual Water Balance (Not to Scale)

As the Los Angeles Department of Water and Power (LADWP), a California utility and the nation’s largest publicly-owned utility, faces rising water costs due to climate change and other factors, water loss control has moved to the forefront of the utility’s effort to increase water efficiency. While LADWP’s water system has operated at historically low levels of water losses, the high cost of water production warrants an examination of additional cost-effective options for further reducing losses. In addition, compliance with water conservation measures imposed by statewide regulatory agencies is of the utmost importance to LADWP.

Regulatory Requirements

The California Urban Water Conservation Council (CUWCC) is a statewide membership organization dedicated to maximizing urban water conservation throughout California by supporting and integrating innovative technologies and practices; encouraging effective public policies; advancing research, training, and public education; and building on collaborative approaches and partnerships. In 1991, a Memorandum of Understanding (MOU) was signed by 120 urban water agencies (including LADWP) and environmental groups. Those signing the MOU pledge to develop and implement urban water conservation practices to reduce the demand of urban water supplies. As an original signatory of the

MOU, LADWP has remained in compliance with all Best Management Practices (BMP) for water conservation as required by the CUWCC.

In 2009, the CUWCC amended the MOU to include new requirements for BMP 1.2: Water Loss Control. The revised BMP requires an annual water loss audit of the water system using the AWWA Free Water Audit Software, and the completion of a component analysis of real losses every 4 years. The first year of implementation for the annual audit was the fiscal year July 1, 2009 to June 30, 2010 and the first component analysis was due on June 30, 2013. The MOU stipulates that implementation of BMP 1.2 shall consist of the following:

1. Standard Water Audit and Water Balance - Agencies are required to quantify their current volume of water loss, and complete an annual standard water audit using AWWA water loss software.
2. Validation - Agencies are required to develop a validated set of data for all entries of their water audit and balance, and data validation shall follow the methods suggested by the AWWA.
3. Economic Values - The economic value of real loss recovery shall be based upon the agency's avoided cost of water as calculated by the CUWCC's Avoided Cost Model, or another agency model consistent with the CUWCC model.
4. Component Analysis - A component analysis is required at least once every four years and is defined as a means to analyze losses and their causes by quantity and type.

With the passage of California Assembly Bill 1420 in 2009, compliance with the CUWCC BMPs is mandatory for a water agency to qualify for state grants and loans.

The Department of Water Resources (DWR) is another statewide agency responsible for managing and protecting California's water. All BMP compliance reports submitted to CUWCC are also sent to DWR. With the passage of the Urban Water Management Planning Act in 1984, all urban water suppliers in California must prepare and adopt an Urban Water Management Plan (UWMP) every five years and submit the final UWMP to DWR. In 2014, California Senate Bill 1420 was passed amending the Urban Water Management Planning Act to require UWMPs to quantify and report on distribution system losses. The 2015 UWMP will be the first UWMP to be submitted under this new requirement.

Another bill, California Senate Bill 555, focuses on water loss validation. The bill requires that each water supplier submit a validated water loss audit to the State each year using AWWA water audit software under the guidance of the AWWA M36 Manual and DWR requirements. In order to validate the water loss audit report, the water supplier must solicit a technical expert to confirm the basis of all of the entries in the report. The bill further requires water suppliers to report on steps taken each year to increase the validity of the data entered into the audit. Additionally, the State Water Resources Control Board is tasked in the bill with adopting rules before July 1, 2020 requiring urban retail water suppliers to meet performance standards for the volume of water losses. The bill has been approved by the California Senate and is expected to be approved by the California Assembly this year. Therefore, the bill would be effective in 2015. The first validated water loss audit report will be due on October 1, 2017.

Fiscal Year 2010-2011 Water Loss Audit and Component Analysis

LADWP has been tracking its non-revenue water totals going back to 1980 and adopted the AWWA M36 Water Loss Control methods in 2009. From April 2012 to June 2013, LADWP conducted its most-comprehensive Water Loss Audit and Component Analysis. (The Final Report can be downloaded at <http://www.ladwp.com/wc>.) The audit period examined was the fiscal year (FY) from July 1, 2010 to June 30, 2011 (FY 2010-2011). For this project, Water Systems Optimization (WSO), a consultant hired by LADWP and a technical expert in the field of water loss control, examined the efficiency of LADWP's water distribution system. Specifically, WSO investigated the current ability to accurately identify real and apparent losses, determined the economic optimum level of water losses, and identified, prioritized, and recommended the most efficient and cost-effective loss intervention strategies to minimize water loss.

A Water Conservation Field Services Program Grant in the amount of \$100,000 was received from the United States Bureau of Reclamation to partially fund contract costs for the project. The goal of the project was to fulfill all of the coverage requirements of the amended BMP 1.2 in the CUWCC MOU. The project investigated systematic data of LADWP's facilities and infrastructure related to water losses and provided recommendations for decreasing or eliminating such losses.

Upon completion of the project it was possible to calculate a variety of performance indicators (PI). These performance indicators are standards accepted industry-wide as the best way to understand how water losses are being managed, and to set targets for reducing those losses. Table 1 provides performance indicators for LADWP during FY 2010-2011.

Table 1: FY 2010-2011 Performance Indicators

Performance Indicator (PI)	Description of Use	PI for LADWP FY 2010-2011
Infrastructure Leakage Index (ILI)	ILI values close to 1 indicate a water system with very low leakage. The ILI is calculated by comparing the annual volume of Real Losses against a standard quantifying the lowest Real Losses achievable for the Water System.	1.26
Real Losses in gallons per service connection per day	This is the preferred basic operational performance indicator for analyzing leakage management performance and one of the most reliable.	23.21
Apparent Losses in gallons per service connection per day	This performance indicator is useful for comparing losses against average annual consumption per customer.	10.60
Non-Revenue Water as a % of Water Supplied	Though this performance indicator is still commonly used, it is not a good benchmark for measuring losses because it is unduly influenced by consumption. For example, if customer demand decreases due to conservation, the percentage of loss will increase even if leakage levels have not changed.	5.2%

All of these performance indicators suggest that LADWP's Water System does not have significant volumes of real or apparent losses. Each of these performance indicators reflects a well-performing Water System. It is worth noting, however, that because quantities of the water loss audit inputs – namely system input volume, authorized consumption, apparent losses, and real losses – vary from year to year, the volume of water losses in LADWP's Water System will fluctuate annually.

Water Loss Task Force

Even with the low water loss findings, the FY 2010-2011 Water Loss Audit and Component Analysis study was able to establish many recommendations to further decrease water loss and improve LADWP's water system performance. LADWP established a Water Loss Task Force (Task Force) in 2014 consisting of staff from several groups in LADWP's Water System and Chief Administrative Office to work on addressing the recommendations from the previous study. The evaluation of actions to address these recommendations is detailed in this Action Plan. LADWP management has reviewed and approved this Action Plan, and the recommended actions are planned to be implemented in the near future pending available funding.

Sections 1-5 of this report detail the key recommendations for improving supply and demand volume accuracy, reducing apparent losses, and reducing real losses. Along with a description of the recommendation as provided in the FY 2010-2011 Audit, the current status of the item has been updated in each of the sections in this report, and several implementation options are given (labeled as "Actions"). Ultimately, LADWP is recommended to pursue the most cost-effective option for each item in order to reduce water losses to an extent that is economically viable. These recommendations are summarized in the Conclusion of this Action Plan.

Organization of this Report

All the recommendations from the previous Water Loss Audit and Component Analysis study have been grouped into five sections:

Section 1: System Input Volume

Section 2: Database Management

Section 3: Meter Testing and Replacement

Section 4: Leak Detection and Prevention

Section 5: Unmetered and Unauthorized Consumption

Each recommendation includes a discussion of the following sub-sections:

Previous Study Conclusion

This sub-section provides a brief summary of the analysis, results, and conclusion of the previous Water Loss Audit and Component Analysis study pertaining to the specific recommendation. The previous study focused on data from FY 2010-2011 and was completed in 2013.

Current Status

This sub-section provides an update of the status of the issue discussed in the recommendation. All references to the audit period in the previous study should be read as FY 2010-2011. Some recommendations may be outdated if changes have occurred within the past year that have already addressed part or all of the issues identified.

List of Actions

This sub-section lists different actions that the Water Loss Task Force has identified would be appropriate measures to consider in order to implement the recommendations from the previous study. The actions include a discussion of the scope of work involved in the implementation; how many staff would be needed to perform the work; the equipment, materials, rentals, and contracts that may be necessary; estimates of costs involved; and an estimated implementation timeline. Estimated costs include direct labor costs only and are rounded to the nearest \$1,000.

A “No Action” option is also listed to describe the impact on water loss control at LADWP if no additional actions are taken to implement an action and operations maintain status quo. In some cases, updates to organizational operations since the completion of the previous study may negate the need for implementation of any additional actions. Furthermore, in other cases additional actions may not have been found to be cost-effective and therefore are not feasible to pursue.

Estimated timelines for completion have been established for each of the recommended actions. Actual start dates for each action will be dependent on available funding and resources.

Recommended Action

This sub-section proposes the best action(s) to pursue in order to complete the objective of the original recommendation from the previous study based on recommendations from the Water Loss Task Force.

Section 1: System Input Volume

System Input Volume represents the total amount of water supplied into the water distribution system. Considering transfers or exports to neighboring agencies, the remaining Water Supplied volume is the input volume that serves LADWP's customers. Water Supplied is equal to the total System Input Volume minus transfers/exports. For LADWP, three main sources supply potable water to the distribution network: the Los Angeles Aqueduct (LAA), purchased water from the Metropolitan Water District of Southern California (MWD), and groundwater from LADWP's well fields. Two microfiltration plants that provide treatment for overflows from Encino and Stone Canyon Reservoirs also contribute small volumes to the system. In addition, infrequent, minor transfers to Las Virgenes Municipal Water District, Calleguas Municipal Water District, and Los Angeles County Waterworks District must be accounted for in the system input volume calculation.

The system input volume is entered into the AWWA Free Water Audit Software under the "Water Supplied" section and is broken out as *volume from own sources, water imported, and water exported*. The AWWA Software also accounts for the accuracy of the supply meters under the "Master Meter and Supply Error Adjustments" section. Since the water balance is a process of elimination in which the System Input Volume is allocated into Authorized Consumption and Water Loss categories, assessing and improving the accuracy of the System Input Volume is an important piece of any water loss control program. Figure 2 identifies the role of the system input volume in the water balance.

Water Supplied	Authorized Consumption	Billed Authorized Consumption	Billed Metered Consumption	Revenue Water
			Billed Unmetered Consumption	
		Unbilled Authorized Consumption	Unbilled Metered Consumption	Non-Revenue Water
			Unbilled Unmetered Consumption	
	Water Losses	Apparent Losses	Unauthorized Consumption	
			Customer Meter Inaccuracies	
			Data Handling Errors	
		Real Losses		

Figure 2: System Input Volume Identified in the Water Balance (Not to Scale)

Recommendation 1.1:

LA Aqueduct Filtration Plant System Input Volume Meters

Previous Study Conclusion

The major source of water for LADWP during the audit period was the water treated at LAAFP, providing about 76% of the annual total input volume. Historically, supply volumes from the Los Angeles Aqueduct Filtration Plant (LAAFP) in Sylmar were calculated as the readings into the plant from the venturi meters at the LAA pipelines (LAA 1 and LAA 2) Soledad station in Santa Clarita and the ultrasonic meter at the

WATER LOSS TASK FORCE

LA-35 MWD untreated water connection in Sylmar. The treated water from LAAFP directly supplies the distribution system, and a portion of the water is also used for operational use at the plant (“LAAFP Backwash”). While LAA 1, LAA 2 and LA-35 track the raw water inputs into LAAFP, it is best to use measurements that are as close to the point of distribution system input as possible.

A collection of meters tracks LAAFP outputs of treated water at two different sites. At the first, the “Flow to City” meter tracks the majority of the LAAFP treated water, headed directly to the distribution system. In close proximity to this meter, there are two newer meters (in Vault 104 and Vault 106) that track the same volume. The remaining LAAFP treated water volume goes to the Los Angeles (LA) Reservoir. The following meters track the water from the LA Reservoir into the distribution system: the LA Reservoir Outlet meter tracks the majority of volume leaving from the mainline off of the LA Reservoir; another newer meter is along this same line (in Vault 204); and lastly, another route from the LA Reservoir into the distribution system is through the “West Outlet”, which is not metered. The newer meters off the Flow to City line and the new meter off the LA Reservoir will be heretofore referenced as the “New Meters”. Figure 3 presents a diagram of all the relevant meters that track LAAFP inflows and outflows. Figure 3 has been updated to include the new UV Plant installation that was completed in 2014.

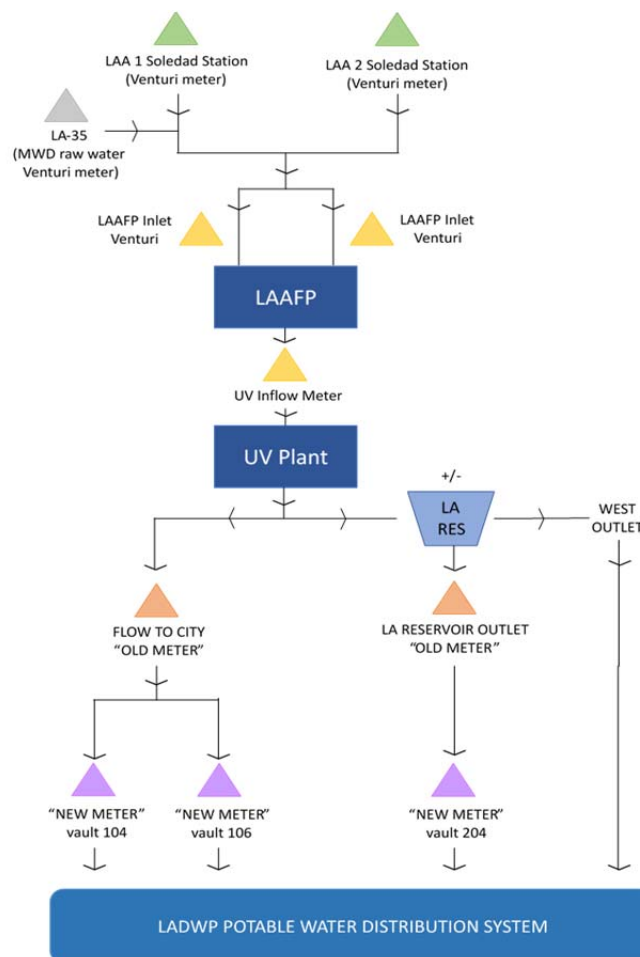


Figure 3: Schematic of Meters Tracking Supply Volumes at LAAFP

Ideally, system input volumes entered into the water balance are measured at the closest point to system entry. In this case, it would be best to use the three New Meters as they are closest to the point of input into the distribution system and are newly installed multi-path ultrasonic flow meters. However, only going online in January 2012, the New Meters were not in place for the audit period. Moving forward, LADWP should use the New Meters for all future calculations of System Input Volumes from LAAFP.

Current Status

Reporting of New LAAFP Effluent Meters

LADWP measures Los Angeles Aqueduct (LAA) water entering the Los Angeles Aqueduct Filtration Plant (LAAFP) from two meters located in Soledad Canyon. The flows at Soledad are recorded by Water Operations Division (WOD) Southern Aqueduct Group and reported to DWR and MWD. Water supplied by MWD at the LA-35 connection goes through their flow meter and volumes are provided by MWD on their monthly invoices. The total amount of water entering LAAFP is listed in the monthly Water Supply Report and is also provided monthly to the LADWP Board of Commissioners.

Water Resources Division (WRD) has been collecting and using LAA flows measured at Soledad in many ways. Historical LAA metered records dating back to 1916 have been used in studies analyzing trends of water supply and demand. These are official records reported to DWR and MWD and presented in publications such as the Urban Water Management Plan.

These historical records were used to establish the baseline gross water use per California Senate Bill x7-7 requirements for verifying the required 20% water use reduction by 2020 (20x2020). In order to maintain a historical consistency, WRD has continued to use the LAA and LA-35 volumes (representing the inflows into LAAFP) rather than LAAFP effluent meters to represent supply volumes for almost all reports. However, the water loss audits reported by LADWP have been using LAAFP effluent meters to represent supply volumes since FY 2010-2011.

Meter Testing and Calibration

Volumetric testing and calibration of ultrasonic flow meters requires that they be sent to a facility that has the capabilities to pass a measurable amount of water through the meters and then compare what actually passed through the meter with what was measured. Then, the meter is adjusted to match actual. There are a few facilities in the US that can perform this calibration, most of which are out of state.

LADWP currently does not perform regular testing of the ultrasonic meters in Vaults 104, 106, and 204 at LAAFP. These are the new effluent meters proposed to be used for future supply volume calculations and are only checked when an operator reports a specific problem with the meters. Regular testing of these ultrasonic meters would involve inspection of transducers, transducer cables, and console units; performance testing of sensors; and signal checking and verification.

List of Actions

No Action

Summary of Impact

Complete the annual water loss audit based on the records from three new LAAFP effluent meters. All other records and reporting remain unchanged and will continue to use the LA Aqueduct Soledad meters and the LA-35 meter to represent the flow into the distribution system from LAAFP. Reporting inconsistencies will continue. Notes explaining the discrepancy need to be included in the annual water loss audit and documents containing inconsistent records.

Action 1: Track Volumes of Water Sources and System Water Supply Separately

Scope of Work

Water source volumes are required for historical trend analysis and the UWMP. In addition, the new LAAFP effluent meters do not have historical records to generate a baseline (1996 to 2005) for determining LA's compliance to 20% water use reduction in 2020 as required by SBx7-7 legislation. System water supply volumes are required for non-revenue and water loss determination and to represent the most accurate supply volume to the distribution system.

As the two volumes are required for different purposes, both will be tracked and presented in reports such as the UWMP. Volumes of Water Sources will continue to use Soledad meters and LA-35 to track LAA and MWD untreated water. Volumes of System Water Supply will use LAAFP effluent meters to track amount of water supplied to the water distribution system from the LAAFP.

A System Supply Factor will be calculated to clarify the differences between the two datasets. As stated from the AWWA Water Balance, the differences between water source volumes and system water supply volumes include water consumed for treatment operations such as backwashing, basin flushing and cleaning, etc.

Staffing Needs

An Engineering Associate is needed to investigate data availability, develop procedures, and revise report templates.

Equipment, Materials, Rentals, and Contract Needs

No additional equipment, materials, rentals, or contracts are needed. Engineering staff may need coordination from other groups to receive data for compilation.

Estimated Costs

Table 2: Estimated Cost for Recommendation 1.1, Action 1

Staff/Item	Hours/Units	Cost
Staffing		
Capital Costs – for 3 months		
Engineering Associate (1)	80 hours	\$5,000
Equipment, Materials, Rentals, Contracts		
N/A	N/A	N/A
Total Capital Costs (for 3 months)		\$4,800

Estimated Time

Table 3: Estimated Time for Recommendation 1.1, Action 1

Task	Time
Developing Procedures	1 month
Implementation Transition	2 months
Total Time	3 months

Action 2: Regular Calibration of Relevant Supply Volume Meters at LAAFP

Scope of Work

Perform regular calibration procedures on the ultrasonic meters at Vault 104, Vault 106, and Vault 204 on an annual basis. These are the meters primarily used for supply volume purposes at LAAFP. The calibration procedures should be performed on an annual basis and meet AWWA standards. Regular calibration of these ultrasonic meters will involve inspection of transducers, transducer cables, and console units; performance testing of sensors; and signal checking and verification.

Staffing Needs

Two Electrical Mechanics are needed to perform the testing and calibration of the three ultrasonic meters. It will take staff approximately 2 weeks to perform the testing and calibration. If staff encounter any parts that needs to be replaced, the time frame for this work may be extended.

Equipment, Materials, Rentals, and Contract Needs

All equipment and materials are already available and no additional equipment or materials are needed. A contract is not needed as this work can be incorporated into the Water Operations Division Electronics Shop Preventative Maintenance (PM) program.

WATER LOSS TASK FORCE

Estimated Costs

Table 4: Estimated Cost for Recommendation 1.1, Action 2

Staff/Item	Hours/Units	Cost
Staffing		
Operations & Maintenance Costs – per year		
Instrument Mechanics (2)	108 hours	\$7,000
Equipment, Materials, Rentals, Contracts		
N/A	N/A	N/A
Total Operations & Maintenance Costs (per year)		\$7,000

Estimated Time

Table 5: Estimated Time for Recommendation 1.1, Action 2

Task	Time
Calibrate Meters	1 month
Total Time	1 month

Recommended Action

It is recommended to pursue both Actions 1 and 2. Action 1 will clarify data points used in calculations for sources of supply vs. supply to the water distribution system. Action 1 will also align calculated values across reports that should represent the same numerical definition, such as non-revenue water. Action 2 is required to verify meter functionality of LAAFP meters used for system supply volumes and to perform regular testing and calibration procedures outlined by the AWWA M36 method. Action 2 will also improve the data quality and validity score of the “Volume from own sources” entry on the AWWA water audit software.

Recommendation 1.2: *LA Reservoir West Outlet Meter Installation*

Previous Study Conclusion

During the FY 2010-2011 Water Loss Audit and Component Analysis Study, it was determined that there was some volume of water transferred to the distribution system through another outlet at the LA Reservoir, the “West Outlet” (see Figure 3). Water Operations records show that the West Outlet was opened from December 17, 2010 to February 7, 2011. The West Outlet is not metered, so the average difference between the LAAFP Input Volume and the LAAFP Output Volume was used to estimate the volume for the West Outlet in December 2010 and January 2011.

The FY 2010-2011 Water Loss Audit and Component Analysis Study recommended LADWP install an ultrasonic multi-point flow meter at the West Outlet to accurately and reliably record the volume supplied into the distribution network. This would help provide a more accurate system input volume that is used for calculating water loss.

Current Status

The Los Angeles Reservoir West Outlet (West Outlet) is typically used when the LA Reservoir Main Outlet is isolated and for other special operations, such as when the filtration plant is out of service (unplanned). During these instances, the West Outlet would then be used to supply water to Van Norman Pump Station #2 and the Rinaldi Trunk Line. There is a manually-operated valve on the West Outlet line which is 100% closed and is only operated at the request of Water Control Group.

List of Actions

No Action

Summary of Impact

The West Outlet is out of service and will not be used except in emergency situations. Therefore the impact of lack of accurate flow measurement is infrequent.

Action 1: Calculate West Outlet Flow using Mass Balance

Scope of Work

This proposed action is to use a mass balance calculation around the Los Angeles Reservoir (LAR). Upon completion of the UV plant at LAAFP in 2014, there now exists a full set of flow meters providing measurement of volumes entering and leaving the reservoir except the West Outlet. Measurement of the level of the reservoir is also available. These values can be used to calculate the volume of water entering, leaving through the outlet tower, or being stored in the Reservoir with unmeasured outflows passing through the West Outlet.

The LAR inflow cannot be measured directly. The LAR inflow comes from the overflow structure at the outlet of new LAAFP Ultraviolet (UV) plant. The LAR inflow can be calculated as difference between the total flow into the UV from the LAAFP and the UV plant outflow to the City. There are redundant meters on the outflow with the two ultrasonic meters located in Vault 106 and Vault 104 being the most accurate and the 120" Flow to City magnetic meter being less accurate.

There is an existing sensor to measure the level of the reservoir. This can be used to calculate changes in water storage in the reservoir.

To measure LAR outflow, there is a flow meter at the Van Norman 2 Chloramination station. In addition, there is a flow meter at the LAR Outlet Chlorine station that is currently out of service and a new flow meter will be installed as part of the LAR Outlet UV treatment station.

Using these available process measurements, we can calculate the flow through the West Outlet. The mass balance calculation is as follows:

$$\text{West Outlet Flow} = \text{Change in Level} + (\text{LAAFP Outflow} - \text{Vault 104 Flow} - \text{Vault 106 Flow}) - \text{LAR Outflow}$$

It should be noted that the accuracy of the resulting value is dependent on the accuracy of the primary measurements.

WATER LOSS TASK FORCE

Staffing Needs

The different process measurements are currently available on different control systems and they will need to be brought into the Los Angeles Water System Data Acquisition and Control (LAWSDAC) system to perform the West Outlet Flow calculation. The LAWSDAC system can also provide reporting and storage of the information to the historical database. An electrical engineer will be required to make the necessary programming changes.

Equipment, Materials, Rentals, and Contract Needs

Not applicable.

Estimated Costs

Table 6: Estimated Cost for Recommendation 1.2, Action 1

Staff/Item	Hours/Units	Cost
Staffing		
Capital Costs – for 1 month		
Electrical Engineering Associate (1)	40 hours	\$2,000
Equipment, Materials, Rentals, Contracts		
N/A	N/A	N/A
Total Capital Costs (for 1 month)		\$2,200

Estimated Time

Table 7: Estimated Time for Recommendation 1.2, Action 1

Task	Time
System Programming	1 month
Total Time	1 month

Action 2: Installation of Flow Meter on the West Outlet

Scope of Work

There are two proposed options for installation of a flow meter on the West Outlet line.

The first proposed action is the installation of a flow meter in the valve vault between the two reservoirs. This is a deep vault with multiple valves and tee to a third pipeline. The structure of the vault and the location of the valves and tee prevent installation of any flow meter with the required clearance for sensors. It also obstructs the required straight run of pipe for accurate measurement. Therefore it is not possible to install a flow meter in the valve vault.

The second proposed option is the construction of a new flow meter vault. The pipeline is buried at an estimated depth of 80ft. This would require the construction of a very large and very deep vault. The construction of a vault at this location is not practical because a large dig could compromise the LA Reservoir.

Staffing Needs

Not applicable.

Equipment, Materials, Rentals, and Contract Needs

Not applicable.

Estimated Costs

Not applicable.

Estimated Time

Not applicable.

Recommended Action

If the West Outlet is put into service, it will be necessary to provide measurement of the West Outlet flow. However, it is not possible to install a flow meter as discussed in Action 2. Therefore, it is recommended that Action 1, a mass balance calculation using the new UV inflow meter, be implemented. Action 1 will also improve the data quality and validity score of the “Volume from own sources” entry on the AWWA water audit software.

Recommendation 1.3:

Well Field Meter Accuracy and Regular Testing

Previous Study Conclusion

LADWP owns and operates wells in 11 different well fields. During FY 2010-2011, 65 of these wells were active and registered flow.

At the start of 2011, LADWP initiated a well flow meter testing and calibration program for 60 of the Department’s San Fernando Valley wells. Approximately 58 of the 60 flow meters have been repaired or replaced and 44 meters have been tested at three different flow rates to date. Some meters were repaired after calibration and others replaced with new flow meters. There were some meters that could not be tested. The high flow rates are representative and typical of the well production values where the flow meters were installed. The tested accuracies ranged from 98% to 108%. The AWWA standards on testing and maintaining flow meters (AWWA M6) recommends that 12-inch propeller meters (the type and size of most of the well flow meters) should test within 98% and 102%. Many of the tested flow meters meet this industry standard.

None of the well meters satisfied their manufacturer’s installation requirements. Without sufficient straight lengths of pipe, it is not guaranteed that a meter performs within its quoted accuracy (even with mitigating measures such as straightening vanes). Given the installation conditions of the individual well meters it can be assumed that even newly calibrated well meters will not provide accurate results. These meters should therefore only be used for general operational purposes and not for accurate production volumes.

WATER LOSS TASK FORCE

To improve the accuracy of the well field production volumes the FY2010-2011 Water Audit and Component Analysis Study recommended metering the production at a point before or after the collector basin and not to rely on the results of the individual well meters.

Current Status

Status of Groundwater Meters

Table 8 provides a summary of the types of flow meters and connectivity available for each of the well fields.

Table 8: Summary of Flow Meters & Connectivity at LADWP Well Fields

Well Field	Number of Active Production Wells*	Description of Flow Meters & Connectivity
Lomita Wells	0	This station is not in production and there is no flow meter available on SCADA. There is only one well and it is used as an observation well.
Erwin Wells	2	This station is currently in production but there is no flow meter available on SCADA.
Verdugo Wells	2	This station is currently in production but there is no flow meter available on SCADA.
Whitnall Wells	4	This station is currently in production but there is no flow meter available on SCADA.
99th Street Wells	4	There is a Venturi meter on pump station outlet on LAUSDAC. There is also a propeller meter on well collector line for zinc orthophosphate metering on Distributed Control System (DCS), however a mag-meter will be installed to replace the propeller meter as part of the new treatment station due in 2016.
Manhattan Wells	2	Insertion mag-meter on well collector line on Treatment Operations Control Center (TOCC) and a Venturi meter on pump station outlet on LAUSDAC.
Aeration Wells	7	There is an in-line mag-meter at the Aeration Tower on TOCC and DCS.
Mission Wells	2	There is a Venturi meter on pump station outlet on DCS and an in-line mag-meter on well collector line that will be on TOCC in March 2016. A new treatment station is planned to be in operation around 2018, and will most likely include a new flow meter.
North Hollywood Wells	14	There is an ultrasonic meter on collector line at North Hollywood Station on TOCC.
Pollock Wells	2	There is a Venturi meter on well collector line on DCS.
Rinaldi-Toluca Wells	15	There is an ultrasonic meter on collector line at North Hollywood Station on TOCC.
Tujung Wells	12	There is an insertion mag-meter on well collector line on TOCC and Venturi meter on pump station outlet on LAUSDAC
Total Wells	66	There are currently 66 active wells in production.

*As of July 27, 2015

Magnetic flow meters (mag-meters) and Ultrasonic meters can be field calibrated. They are very accurate (approximately 0.5%) if installed as required. When installed near valves, bends, etc., the accuracy is reduced. Accuracy is also compromised at low flow velocity and partially-filled pipe. Flow through Venturi meters is measured using a differential pressure transmitter. These transmitters are calibrated annually by the instrument shop; the Venturi meter is static and does not require calibration. Accuracy is similar to the other two meter types with similar caveats.

All of the flow meters noted can be read and logged on one of the three department SCADA systems. LAWSDAC is the main water SCADA system and will have historical data for many years. DCS is the SCADA system for the filtration plant and will have data for many years. TOCC is Treatment Operations Control Center located in the filter plant control Room. This is a relatively new system and will only have historical data for, at most, a couple of years.

The Water System's Water Operations and Groundwater Project Management Groups have developed standardized well construction drawings for new wells that will provide sufficient lengths of straight pipe that will meet flow meter manufacturer recommendations without the need of straightening vanes. Existing flow meters without the manufacturer's recommended lengths of straight pipe can be retrofitted with new straightening vanes that required less straight pipe. The Water System is currently exploring other types of straightening vanes that greatly reduce the required length of straight pipe (1.5 the pipe diameter upstream and 0 to 1 pipe diameter downstream). Retrofitting existing wells with other types of straightening vanes can increase meter accuracy to manufacturer's standards. As stated above, existing well flow meters are being calibrated and new flow meters are also being procured and installed.

Collector line flow meters have been installed on most well field collector lines. Where collector line flow meters do not exist, flow measurements are taken at the individual wells and this information is supplied to Water Control Group to be included in the Upper Los Angeles River Area (ULARA) water master report. A new replacement flow meter was recently installed on the Tujunga Tank inflow line and is now operational. New flow meters have been installed on the North Hollywood and Rinaldi Toluca collector lines but this information is not seen by LAWSDAC. Instead, it is seen on the TOCC system used by Treatment Operations.

Groundwater Reporting

In June 2015, Water Operations Division Water Control Group began reporting groundwater volumes from SCADA reads of the collector facility meters for the 8 active well fields where this data is available, and continued to estimate the remaining active well fields using pump rates and time of operation. Prior to this, almost all official groundwater reports (with the exception of water loss audits) used meter reads from the individual well head meters to determine groundwater volume. The decision was made to switch based on the previous FY 2010-2011 Water Loss Audit and Component Analysis study findings that the collector facility meters would provide a more accurate depiction of the groundwater volume supplied to the water distribution system.

Reports to the ULARA Watermaster continue to require data from manual readings of the individual well head meters as a representation of groundwater pumped out of the San Fernando Basin. The Urban

Water Management Plan (UWMP) requires both Watermaster reports and water loss audit requirements be reported, so both volumes are represented. The Watermaster report is considered a representation of “sources of supply”, while the water loss audit method is considered a representation of “system supply volume”, which is sent to the distribution system for use by LADWP customers and other end-users.

List of Actions

No Action

Summary of Impact

By not pursuing any of the actions, the current uncertainty of water quantity coming from some of the well fields will remain the same. For well-fields that have flow meters on the well collector line already installed (such as Manhattan Wells, 99th Street Wells, Aeration Wells, Mission Wells, North Hollywood Wells, Pollock Wells, Rinaldi-Toluca Wells, and Tujunga Wells) with signal connectivity to LAUSDAC/DCS/TOCC, the water flow is sufficiently measured and reported. For well fields that do not have a flow meter on a collector and access to LAUSDAC/DCS/TOCC (such as Lomita Wells, Verdugo Wells, Erwin Wells, and Whitnall Wells), the wells flows are currently estimated by pump rate and time of operation.

Action 1: Install Manufacturer’s Recommended Flow Straighteners

Scope of Work

One of the factors that affect the accuracy of flow measurement is the length of straight pipe that is available before and after a flow meter. Without sufficient straight pipe length, a meter will not perform within its rated accuracy. Mitigating measures such as straightening vanes reduce the required length of straight pipe and can help improve meter accuracy.

Some well fields do not have a flow meter installed on a collector line but rather on the well head. These well fields include Lomita, Erwin, Verdugo, and Whitnall. In many cases, these flow meters do not have sufficient straight pipe run upstream and/or downstream of the flow meter that is required for accurate flow measurement.

All wells already include installations of flow straighteners, but these installations typically require a straight run of 5 pipe diameters upstream and 10 pipe diameters downstream of the flow meter. To improve the accuracy of the well head flow meters, it is recommended to install newer technology flow straighteners at the 8 active wells at Erwin, Verdugo, and Whitnall that cause the flow to become laminar as it enters and leaves the flow meter and only require one pipe diameter upstream and downstream of the flow meter. Lomita does not need flow straightener installations because it only has one inactive well. It is also not recommended at this time to install straighteners at other well fields with active wells since these other well fields have collector facility meters that can be used to track flows. If the newer flow straighteners are installed at Erwin, Verdugo, and Whitnall and perform well, it may be recommended to install the straighteners at other well fields to improve the accuracy of well head pumping reports submitted to the ULARA Watermaster.

Staffing Needs

In order to complete this action, the following staff will be needed: one design engineer, one engineering drafter, and three construction crew staff.

Equipment, Materials, Rentals, and Contract Needs

For each well, a flow straightener and construction equipment will be needed.

Estimated Costs

Table 9: Estimated Cost for Recommendation 1.3, Action 1

Staff/Item	Hours/Units	Cost
Staffing		
Capital Costs – for 8 months		
Design Engineer (1)	100 hours	\$6,000
Engineering Drafter (1)	50 hours	\$2,000
Construction Crew (3)	90 hours	\$6,000
Equipment, Materials, Rentals, Contracts		
Capital Costs		
Flow Straightener	1 unit	\$1,000
Construction Equipment	1 unit	\$10,000
Total Capital Costs (per well, for 8 months)		\$26,000
Total Capital Costs (for 8 wells, for 1 year 10 months)		\$208,000

Estimated Time

Table 10: Estimated Time for Recommendation 1.3, Action 1

Task	Time
Planning and Design	1 month
Contract Procurement	6 month
Installation and Testing	1 month
Total Time (per well)	8 month
Total Time (for 8 wells)	1 year 10 months

The total time estimated is 22 months because it is expected that the contract that is procured would be a one-time effort and would include the scope of work and funding for all of the flow straighteners requested.

Action 2: Installation of Flow Meters on Well Collector Lines

Scope of Work

This action recommends the installation of flow meters on existing collector lines where no flow meter currently exists. The advantages include obtaining sufficiently accurate flow measurements since the collector line will have adequate straight pipe before and after the flow meter as well as connectivity to LAWSDAC/TOCC. This eliminates the need for manual tabulation and hence preventing measurement inaccuracy due to human error.

WATER LOSS TASK FORCE

Currently, three active well fields do not have collector lines – Erwin, Verdugo, and Whitnall. It is anticipated that if treatment facilities are planned for in the future at these well fields, a collector line would be built. At that time, it could be feasible to install a flow meter on the new collector lines. However, until these treatment facilities are planned and constructed, no opportunity exists to construct a collector facility meter at Erwin, Verdugo, and Whitnall.

Staffing Needs

In order to complete this action, the following staff will be needed: three design engineers, one engineering drafter, and seven construction crew.

Equipment, Materials, Rentals, and Contract Needs

For each well field, a flow meter, valves, insulation joints, a maintenance vault and hatch, a Programmable Logic Controller (PLC) cabinet, other equipment rental, and PLC and LAUSDAC Connectivity will be needed.

Estimated Costs

Table 11: Estimated Cost for Recommendation 1.3, Action 2

Staff/Item	Hours/Units	Cost
Staffing		
Capital Costs – for 11 months		
Design Engineers (3)	500 hours	\$28,000
Engineering Drafter (1)	100 hours	\$5,000
Construction Crew (7)	300 hours	\$15,000
Equipment, Materials, Rentals, Contracts		
Capital Costs		
Flow Meter & Misc. Items (Valves & Insulation Joints etc...)	1 unit	\$125,000
Maintenance Can and Hatch	1 unit	\$17,000
PLC Cabinet	1 unit	\$20,000
Equipment Rental	1 unit	\$16,000
PLC & LAUSDAC Connectivity	1 unit	\$150,000
Total Capital Costs (per well field, for 11 months)		\$376,000
Total Capital Costs (for 3 well fields, for 2 years 9 months)		\$1,128,000

Estimated Time

Table 12: Estimated Time for Recommendation 1.3, Action 2

Task	Time
Planning and Design	4 months
Contract Procurement	6 months
Installation and Testing	1 months
Total Time (per well field)	11 months
Total Time (for 3 well fields)	2 years 9 months

Action 3: Calibrate Collector Facility Meters

Scope of Work

This action recommends the calibration of eight flow meters on existing collector lines. The advantages include ensuring that the flow meters operate properly. Per manufacturer's recommendation, various types of flow meters would require different approaches in performing the flow meter calibration. Some of these tests are provided in Table 13 according to flow meter type.

Table 13: Manufacturer's Flow Meter Calibration Requirements

<p>1) Primary element flow meters</p> <ul style="list-style-type: none"> a. Inspect element for wear and proper operations b. Field or factory calibrate differential pressure transmitter to an National Institute of Standards and Technology (NIST) standard reference
<p>2) Insert mag-meters</p> <ul style="list-style-type: none"> a. Inspect insert element and test critical operational values for coil and electrodes b. Field test converter with flow value simulator c. If removable, perform flow calibration
<p>3) In-line mag-meters</p> <ul style="list-style-type: none"> a. Inspect insert element and test critical operational values for coil and electrodes b. Field test converter with flow value simulator
<p>4) Ultrasonic flowmeters</p> <ul style="list-style-type: none"> a. Inspect transducers, transducer cables, console unit for viable operation b. Confirm viability of each path and performance testing of sensors c. Check operation signal strength values and confirm acceptable to factory standards

Staffing Needs

Design engineers will administer the contract and determine the locations of the meters for the contractor. A drafter may be needed to create new plans if existing plans are not sufficient to detail the location and installation conditions of the meters. Operations and construction crew are needed to accompany the contractor into the vault and open compartments were needed, and potentially assist in removal and replacement of meters determined to be non-functional.

Equipment, Materials, Rentals, and Contract Needs

For each flow meter, construction and flow meter testing equipment will be needed.

WATER LOSS TASK FORCE

Estimated Costs

Table 14: Estimated Cost for Recommendation 1.3, Action 3

Staff/Item	Hours/Units	Cost
Staffing		
Operations & Maintenance Costs – per year		
Design Engineer (2)	100 hours	\$6,000
Engineering Drafter (1)	50 hours	\$3,000
Operations & Construction Crew (3)	60 hours	\$2,000
Equipment, Materials, Rentals, Contracts		
Operations & Maintenance Costs – per year		
Flow Meter Testing Contract (per flow meter)	1 unit	\$2,000
Construction Equipment	1 unit	\$10,000
Total Operations & Maintenance Costs (per flow meter, per year)		\$23,000
Total Operations & Maintenance Costs (for 8 flow meters, per year)		\$184,000

Estimated Time

Table 15: Estimated Time for Recommendation 1.3, Action 3

Task	Time
Planning and Design	1 month
Contract Procurement	1 year
Testing	1 month
Total Time (all flow meters)	1 year 2 months

Recommended Action

It is recommended to pursue Action 2 if collector lines are constructed as part of additional treatment facilities for the remaining well fields without collector meters at Erwin, Verdugo, and Whitnall. (Lomita has been taken permanently offline as a production well field, so there is no need to address any meter inaccuracies at that well field.) A data analysis of groundwater volumes from Erwin, Verdugo, and Whitnall well fields from years 2013-2014 showed that these well fields provided around 3% of the total groundwater volume to the water system. Since this is a relatively small amount, it is recommended to continue using estimates of flow values based on pump rates and time of operation for three well fields without collector facility meters until collector lines are built.

It is also recommended to pursue Action 3, meter calibration, for the rest of the active well fields that do have collector facility meters to meet AWWA calibration requirements to improve water loss audit validation scores and to catch maintenance issues earlier. Specifically, Action 3 will improve the data quality and validity score of the “Volume from own sources” entry on the AWWA water audit software.

Recommendation 1.4: *Storage Data Tracking*

Previous Study Conclusion

Changes in reservoir storage volume can affect the system input volume. If there is an overall change in storage volume from the first to last day of the audit period, that change is accounted for as a consumption volume (if the volume of water in the reservoirs has increased) or additional system input volume (if the volume of water in the reservoirs has decreased).

However, only some of LADWP's reservoirs have level data sufficient to estimate whether the storage volume increased or decreased over the course of the audit period. Without complete data, it was decided to exclude a reservoir storage consideration in the determination of the system input volume in the FY 2010-2011 Water Loss Audit and Component Analysis Study, and it is recommended to track all the reservoirs levels moving forward so that this volume can be incorporated in future audits.

Current Status

WOD Water Control Group estimates the end-of-month storage from the SCADA-generated "Water Operations Daily Report." This SCADA report calculates the storage based on the water elevations at major reservoirs and the largest tanks, listed in Table 16, which have a total capacity of 12,233 AF.

Table 16: Major Reservoirs and Tanks

Reservoirs	Tanks
Los Angeles	Clearwell
Van Norman Bypass	Susana
Green Verdugo	Kittridge No. 3
Upper Stone Canyon	Kittridge No. 4
Santa Ynez	Maclay 1
Lower Franklin	Maclay 2
Elysian	North Toyon
Solano	South Toyon
Ascot	
Eagle Rock	
Headworks	

As for all the other reservoirs and tanks in the system, the combined storage is assumed to be 250 AF. Some of the tanks within this group do have SCADA information; however it is not part of the "Water Operations Daily Report" because the purpose of this report is to have a daily snapshot of what the system is doing by looking at the reservoirs and the large tanks. Even though additional tanks have SCADA storage information, these set of tanks is part of the 250 AF of storage. Therefore, it will be difficult to use since the rest of the tanks' volumes are still unaccounted for. In addition the total capacities of these tanks are 265 AF and therefore 250 AF is a reasonable number to use.

Since storage for these smaller tanks and reservoirs is always reported as 250 AF, the amount of change in storage for these facilities is always assumed to be zero. Therefore, this number will not affect the water balance calculation performed by the AWWA M36 method. Any actual change in storage from these facilities is almost always negligible when considering the average storage capacity of LADWP's water system.

List of Actions

No Action

Summary of Impact

Out of 103 reservoirs and tanks that are in-service, SCADA information is used for 19 of these facilities to calculate the storage. Even though, the number of facilities is small, it makes up for 98% for the volume. Therefore, having an estimated volume for the 2% of volume left is within an acceptable low margin of error.

Action 1: Accelerate Addition of All Reservoirs and Tanks to SCADA

Scope of Work

Install additional remote monitoring capabilities for approximately 90 tanks to measure elevations for the purpose of calculating storage at these facilities. Have custom reports then be built on that SCADA System that would allow engineering analysis for water audit requirements.

Staffing Needs

A design team of two electrical engineering associates, one drafting tech, two electrical mechanics and two crafts is needed for the connecting of existing instrumentation and remoting the reads into either the existing TOCC or LAWSDAC Systems.

Equipment, Materials, Rentals, and Contract Needs

Electrical Cabinets, radios solar power supplies and remote terminal units are needed.

Estimated Costs

Table 17: Estimated Cost for Recommendation 1.4, Action 1

Staff/Item	Hours/Units	Cost
Staffing		
Capital Costs – for 2 months		
Electrical Engineering Associates (2)	160 hours	\$10,000
Drafting Tech (1)	40 hours	\$2,000
Electrical Mechanics (2)	160 hours	\$4,000
Crafts (2)	160 hours	\$5,000
Equipment, Materials, Rentals, Contracts		
Capital Costs		
Electrical Cabinet, Power Supply and RTU	1 unit	\$13,000
Solar Power Supply	1 unit	\$5,000
Radios	2 units	\$13,000
Concrete Pad/Conduit	1 unit	\$5,000
Total Capital Costs (per tank, for 2 months)		\$57,000
Total Capital Costs (for 90 tanks, for 15 years)		\$5,130,000

Estimated Time

Assuming that the installation is done in-house and not contracted out, it would take approximately 15 years to have the remaining 90 tanks be added to the SCADA system at a rate of 2 months/tank. The table below is the breakdown of the time.

Table 18: Estimated Time for Recommendation 1.4, Action 1

Task	Time
Planning and Design	1 month
Installation and Testing	1 month
Total Time (per tank)	2 month
Total Time (90 tanks)	15 years

Recommended Action

The No Action option is recommended since the amount of resources needed, both cost and labor, does not outweigh the low percentage of error in calculating the small storage volume from reservoirs and tanks without SCADA information. However, there is currently a program to have visibility at these reservoirs and tanks by adding them to SCADA for operational purposes. The current rate of progress is about 1 to 2 tanks a year.

Recommendation 1.5: MWD LA-25 Connection Meter Installation

Previous Study Conclusion

The LA-25 MWD connection brings treated water from MWD’s Jensen Treatment Plant in Sylmar to LADWP’s distribution system. The LA-25 connection is not metered, and the volume passing through the connection is calculated with a mass balance equation between the Jensen Plant Influent (JPI) meter, Reservoir 1 at the Jensen Plant and the Sepulveda Feeder Output (SFO) (see Figure 4). Therefore, these meters were examined as they inform the volume reported for LA-25. It is recommended that a meter is installed at LA-25 to simplify the accuracy assessment process at this site. However, the current setup provides a reasonably accurate volume calculation.

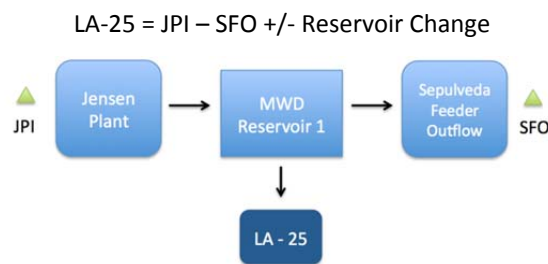


Figure 4: LA-25 Volume Determination Mass Balance

Current Status

The MWD LA-25 connection (LA-25) is used when LAAFP is out of service, which normally occurs once a year to enable maintenance work at the LAAFP. The shutdown is for about two weeks during January and /or February. Since there is no meter at the LA-25 connection, MWD does a mass balance calculation of inflow and outflow at their Jensen Filtration Plant to obtain the volume of water supply through LA-25. Table 19 shows yearly volumes of treated water at LA-25 in the last five years that was purchased to support the annual LAAFP shutdowns.

Table 19: Volume of Treated Water Billed from MWD LA-25

Year	LA-25 Volume (AF)
2010	14,000
2011	13,400
2012	11,400
2013	14,900
2014	10,100

List of Actions

No Action

Summary of Impact

Currently, the amount of water flowing through the LA-25 connection is calculated by MWD. The fact that it is a calculated value means the error in the value is compounded by the error of each instrument

that went into the calculation. Furthermore, LADWP has no control over MWD operations and relies on MWD to maintain the accuracy of their instrumentation. The result is a value of unknown accuracy.

Action 1: Install an Ultrasonic Meter with Internal Mount Sensors

Scope of Work

The first option for direct measurement of the LA-25 flow is the installation of an internally-mounted ultrasonic flow meter with a proven accuracy of 0.5%. This flow meter will be installed with internally mounted sensors and a meter console mounted in instrument cabinet located nearby. A pipe maintenance manhole will be installed by WDD Trunkline Construction. Installation of the flow meter sensors is performed by the vendor and LADWP needs to furnish a conduit path to the instrument cabinet.

Staffing Needs

The installation of the flow meter will require staffing to plan, design, manage and install the flow meter and manhole with precast vault. Engineering staff will be required to design, specify and purchase the materials and manage their installation. The actual flow meter installation will be performed by the vendor and is included in the purchase price. WDD Trunkline Construction crews will be required to install the manhole, vault and buried conduit. We will require instrument mechanics to program the PLC and commission the flow meter.

Equipment, Materials, Rentals, and Contract Needs

Materials are limited to the flow meter and construction materials to install the buried conduits. An asphalt paving contractor will be required to repair road surfaces.

Estimated Costs

Table 20: Estimated Cost for Recommendation 1.5, Action 1

Staff/Item	Hours/Units	Cost
Staffing		
Capital Costs – for 1 year		
Project Management	160 hours	\$12,000
Mechanical Engineering	800 hours	\$56,000
Electrical Engineering	160 hours	\$11,000
Repair & Construction (R&C)	800 hours	\$53,000
Trunkline Construction	2,000 hours	\$116,000
Operations	200 hours	\$15,000
Equipment, Materials, Rentals, Contracts		
Capital Costs		
Ultrasonic Flow Meter	1 unit	\$100,000
Precast Manhole	1 unit	\$10,000
Trenching & Paving Contract	1 unit	\$10,000
Total Capital Costs (for 1 year)		\$383,000

WATER LOSS TASK FORCE

Estimated Time

Table 21: Estimated Time for Recommendation 1.5, Action 1

Task	Time
Planning and Design	4 months
Contract Procurement	6 months
Installation and Testing	2 months
Total Time	1 year

Action 2: Install an Ultrasonic Meter with Thru-Mount Sensors

Scope of Work

The second option for direct measurement of the LA-25 flow is the construction of flow meter vault and the installation of “thru-mount” ultrasonic flow meter. This type flow meter will provide accuracy of 0.5%.

A new vault would be constructed upstream of the LA-25 valve vault in an optimal location for flow meter accuracy. The vault would be large enough to permit the access to tapping holes and installing sensors around circumference of the pipe. The vault would require electrical equipment such as lighting, a sump pump, and a blower. The flow meter console will be mounted in instrument cabinet located nearby with buried conduit installed between the vault and cabinet. All work would be performed the department.

Staffing Needs

The installation of the flow meter will require staffing to plan, manage, design, construct, and commission the custom vault and flow meter. Civil and structural engineering staff will be required to research, design, and supervise construction the vault. Mechanical and electrical engineering staff will be required to design, specify, and purchase the flow meter and electrical equipment. Department construction crews would be required to construct the vault and install the flow meter.

Equipment, Materials, Rentals, and Contract Needs

Materials required include the flow meter, construction materials for the vault and electrical equipment. Rentals will be required for construction equipment and shoring.

Estimated Costs

Table 22: Estimated Cost for Recommendation 1.5, Action 2

Staff/Item	Hours/Units	Cost
Staffing		
Capital Costs – for 1 year 6 months		
Project Management	400 hours	\$31,000
Civil Structural	1,600 hours	\$112,000
Mechanical Engineering	800 hours	\$56,000
Electrical Engineering	160 hours	\$11,000
Repair & Construction (R&C)	2,000 hours	\$132,000
Trunkline Construction	10,000 hours	\$580,000
Operations	200 hours	\$15,000
Equipment, Materials, Rentals, Contracts		
Capital Costs		
Ultrasonic Flow Meter	1 unit	\$100,000
Construction Materials	1 unit	\$50,000
Electrical Materials	1 unit	\$50,000
Equipment Rental	1 unit	\$50,000
Total Capital Costs (for 1 year 6 months)		\$1,187,000

Estimated Time

Table 23: Estimated Time for Recommendation 1.5, Action 2

Task	Time
Planning and Design	8 months
Contract Procurement	6 months
Installation and Testing	4 months
Total Time	1 year 6 months

Recommended Action

The lack of accurate measurement of the LA-25 flow presents a couple of problems, including the potential for inaccurate measurement of water entering LADWP's water system. Therefore, LADWP is paying for quantities of water that cannot be verified. Installation of a flow meter is recommended.

The ultrasonic type of flow meter is the industry standard for large diameter pipes. Meters with internal mount sensors (Action 1) and thru-mount sensors (Action 2) both provide excellent accuracy in large diameter pipes. The internal mount sensors are installed on the interior pipe wall and only require installation of a manhole for access to the pipe interior; a precast vault or rings can be used for the manhole. Thru-mount sensors pass through the pipe wall and require a vault with 360-degree access around the pipe diameter and sufficient clearance for installation of the sensors. This will require a large, custom-built vault at greater expense.

The disadvantage of the internally mounted sensor is that installation and maintenance requires entrance to the pipeline where the thru-mount can be serviced from outside the pipe. This should not

be a major problem since this line is not normally in service. Another potential issue of the internally mounted sensor is that this type of meter installation has not been used by the Water System; however, the Power System has used this meter with good results on hydro-generation systems.

Action 1 is recommended over Action 2 and the “No Action” option. A new flow meter will provide accurate flow measurement. It can be installed quickly and with lower cost and less resources than the second action. Action 1 will also improve the data quality and validity score of the “Water imported” entry on the AWWA water audit software.

Section 2: Database Management

Database Management refers to the procedures for updating and maintaining system databases, as well as providing a reasonable level of data accuracy and ease of data retrieval. Some of the major databases that house data relevant to the water balance calculation and water loss studies include (but are not limited to):

- Customer Information System (CIS) – the old billing system
- Customer Care & Billing (CCB) – the new billing system
- Work Management Information System (WMIS) – tracks water meter and service data
- LAUSDAC – Supervisory Control and Data Acquisition (SCADA) system for water operations
- Wave Server – Distributed Control System (DCS) for treatment plant specific operations
- Leak Information Database – GIS-based system that tracks mainline leak reports
- Construction Productivity System (CPS) – tracks work orders for projects, including service leaks

Errors in data collection and storage can adversely affect calculations in multiple areas of the water balance. Difficulties in data retrieval due to overly complicated databases can also delay analyses of water loss in the system and hinder the ability to perform the water audit by mandated regulatory deadlines.

Recommendation 2.1:

Water Control Systems Database Consolidation

Previous Study Conclusion

LADWP should consider consolidating its Water Control Systems databases. For the LAAFP volume analysis alone, data from three separate Water Control Systems was required. This included the Owens Valley SCADA system, which provided the data for the LAA pipelines; Los Angeles Water System Data Acquisition and Control (LAUSDAC), which provided most of the system input volume data; and the LAAFP Distributed Control System (DCS), which provided the data for the “New Meters” on the effluent side at the LAAFP. With different data extraction procedures and permissions for each SCADA system and the DCS, the data collection process for System Input Volume determination becomes quite cumbersome and introduces a greater probability for error in data collection and analysis.

Current Status

The Water Control Systems used in the LADWP Water System are presented in Table 24.

Table 24: LADWP Water Control Systems

System	Description
LAWSDAC (Los Angeles Water System Data Acquisition and Control)	SCADA System that supports Transmission Operations by monitoring and controlling water delivery and storage facilities in the Los Angeles area such as pump stations, tanks and regulator stations
TOCC (Treatment Operations Control Center)	SCADA System that supports Treatment Operations by monitoring and controlling water treatment stations such as those at the LAAFP and field treatment stations in the Los Angeles area
LAAFP (Los Angeles Aqueduct Filtration Plant)	DCS System that monitors and controls Plant Operations at the LAAFP
Owens Valley SCADA	SCADA System that supports Los Angeles Aqueduct operations monitoring and controlling out-of-City Stations
OTS (Operational Technology System)	Local Area Network in possible development by Water Operations Division to support engineering studies and remote SCADA Users for the LAWSDAC and TOCC Field Operators

List of Actions

No Action

Summary of Impact

LADWP engineering staff will have to continue to access data across four different Water Control System platforms and manually synchronize data at time of data collection. Data going back more than three years will have to be stored and maintained by staff as the data will be regularly cleared from LAWSDAC & TOCC. The presence of multiple users on the operational SCADA databases who are outside of the Water Operations Division can compromise water system facilities that are controlled through the SCADA system.

Action 1: Build the Operational Technology System (OTS)

Scope of Work

Build an Engineering Technology System – Local Area Network dedicated to engineering studies. This would download data from the LAWSDAC and TOCC systems. If data points from other systems outside of LAWSDAC & TOCC need to be added to the Engineering Technology System, this would need to be a special request.

Staffing Needs

A design team of two electrical engineering associates and two system programmers is needed. One of the system programmers will be needed during the initial setup phase, while another programmer will be needed for ongoing maintenance of the system. These could be two different staff or potentially the

same staff member, depending on staffing needs at the time. A project manager is also needed to oversee the work.

Equipment, Materials, Rentals, and Contract Needs

8 Servers, 4 Routers, 4 Terminals, a Computer Room, and Office Space are needed.

Estimated Costs

Table 25: Estimated Cost for Recommendation 2.1, Action 1

Staff/Item	Hours/Units	Cost
Staffing		
Capital Costs – for 1 year 6 months		
Design Engineer (2)	6,240 hours	\$250,000
Design System Programmer (1)	3,120 hours	\$125,000
Project Manager (1)	3,120 hours	\$125,000
Operations & Maintenance Costs – per year		
System Programmer (1)	2,080 hours	\$125,000
Equipment, Materials, Rentals, Contracts		
Capital Costs		
Servers	8 units	\$80,000
Routers/Switches	4 units	\$160,000
UPS/Racks	4 units	\$50,000
Terminals	4 units	\$16,000
Server Room Equipment (Racks, AC, Conduit)	1 unit	\$65,000
Operations & Maintenance Costs – per year		
Software License (MS, Cisco, and Application)	1 unit	\$70,000
Total Capital Costs (for 1 year 6 months)		\$871,000
Total Operations & Maintenance Costs (per year)		\$195,000

Estimated Time

Table 26: Estimated Time for Recommendation 2.1, Action 1

Task	Time
Planning and Design	1 year
Installation and Testing	6 months
Total Time	1 year 6 months

Action 2: Re-wire Devices into One SCADA System

Scope of Work

Install additional remote monitoring capabilities at desired flow measurement points throughout the distribution system and have these flow measurements reside within one of the existing SCADA

WATER LOSS TASK FORCE

Systems. Each site has a capacity of eight status points and four analog points. Have custom reports then be built on that SCADA System that would allow engineering analysis for water audit requirements.

Staffing Needs

A design team of two electrical engineering associates, one drafting tech, two electrical mechanics and two crafts is needed for the connecting of existing instrumentation and remoting the reads to the preferred SCADA system.

Equipment, Materials, Rentals, and Contract Needs

Electrical Cabinets, Radio Solar Power Supplies and Remote Terminal Units are needed.

Estimated Costs

Table 27: Estimated Cost for Recommendation 2.1, Action 2

Staff/Item	Hours/Units	Cost
Staffing		
Capital Costs – for 2 months		
Electrical Engineering Associates (2)	160 hours	\$10,000
Drafting Tech (1)	40 hours	\$2,000
Electrical Mechanics (2)	160 hours	\$4,000
Crafts (2)	160 hours	\$5,000
Equipment, Materials, Rentals, Contracts		
Capital Costs		
Electrical Cabinet, Power Supply and RTU	1 unit	\$13,000
Solar Power Supply	1 unit	\$5,000
Radios	2 units	\$13,000
Concrete Pad/Conduit	1 unit	\$5,000
Total Capital Costs (per site, for 2 months)		\$57,000

Currently only one site has been identified as a priority for re-wiring, but more sites may be identified in the future based on engineering data needs.

Estimated Time

Table 28: Estimated Time for Recommendation 2.1, Action 2

Task	Time
Planning and Design	1 month
Installation and Testing	1 month
Total Time (per site)	2 months

Recommended Action

WOD Water Technology & Control Systems (WTCS) Group is currently evaluating the feasibility of creating the OTS as outlined in Action 1. It is recommended to go with the No Action option until WTCS Group can verify the feasibility of pursuing Action 1. During the time Action 1 is being evaluated, LADWP

engineering staff can provide any data points that are of interest but not currently on LAUSDAC or TOCC to WTCS Group for addition to one of the two systems.

Recommendation 2.2:
Recycled Water and Treatment Process Water Tracking

Previous Study Conclusion

For the purposes of creating a consistent and complete water balance, the consumption volume determination must correspond with the system input volume: only consumption that draws from the water supplied (as calculated in the system input volume calculation) qualifies as *Billed Metered Authorized Consumption* (BMAC) in the water balance. As such only potable water that is consumed after the points of system input volume metering is included in BMAC. Figure 5 shows the BMAC as a part of the water balance.

Water Supplied	Authorized Consumption	Billed Authorized Consumption	Billed Metered Consumption	Revenue Water
			Billed Unmetered Consumption	
		Unbilled Authorized Consumption	Unbilled Metered Consumption	Non-Revenue Water
			Unbilled Unmetered Consumption	
	Water Losses	Apparent Losses	Unauthorized Consumption	
			Customer Meter Inaccuracies	
			Data Handling Errors	
Real Losses				

Figure 5: Billed Metered Authorized Consumption Identified in the Water Balance (Not to Scale)

The first group of exclusions from the BMAC volume includes the accounts that receive recycled water. This audit is limited to the potable water system, so any recycled water accounts tracked in the Customer Information System (CIS) must be excluded. In CIS, the rate code “44” highlights records that refer to recycled water. In the first review of the CIS data, all billing records with rate code “44” were removed.

Upon further investigation, it became clear that a significant number of accounts receive recycled water without the rate code “44” distinction on their billing records. The LADWP Water Recycling and Planning Group provided their documentation of these accounts’ information, which was then cross-referenced with CIS. Through this effort, beyond the rate code “44” accounts, an additional 544.95 MG or 1,672.39 AF was excluded from the final BMAC volume determination. In future water audits, it will be important to exclude all accounts that receive recycled water.

The second group of exclusions from the BMAC volume includes treatment process water. All consumption included in the BMAC volume determination must be accounted for in the system input volume. This is not the case for a small number of accounts that use potable water before the points of measurement for the system input volume. A particular account of note is Meter Number 96101258

(Account Number 3597809313101000000000). It is a six-inch Badger meter that is classified in Class Code 60, "Purpose of Enterprise", and is located near the Los Angeles Aqueduct Filtration Plant. CIS does not include any records with consumption from this account during the audit period. However, in July 2011, a bill reports a consumption of 960,053 hundred cubic feet (HCF), or 718.12 MG. The prior reading was made in September 2008, when the meter was installed. It appears that this meter is rarely read, and due to its high volume records, careful attention should be made to exclude it from future consumption volumes in water balance calculations.

Current Status

Recycled Water

In the previous CIS/TRES system, recycled water accounts were coded as various rate schedules, even though Schedule D (Rate Code 44) was noted as Reclaimed Water. Certain accounts are served recycled water but billed at different schedules, such as the City of Los Angeles Recreation and Parks facilities. In the new CCB, the same rate schedules from the old CIS/TRES system were carried over. There is currently a recycled water "yes/no" identifier in CCB, but it is not fully populated at this time and contains unreliable data.

In general, for a new recycled water account to be programmed in CCB, the Recycled Water Planning Group would need to provide the new account information to Account Services to be entered into the CCB system. It is not currently standard protocol to use the recycled water "yes/no" identifier as the priority has been to identify the rate structure that would apply for each specific account. Recycled water accounts could fall into several different rate structures. In some cases, these rate structures are not specific to recycled water and could also include potable water accounts. This makes separation of recycled water uses from potable water uses difficult and time-consuming, as a manual cross-check of CCB and Recycled Water Planning Group information would need to be performed.

Recycled water always has its own meter. If there is ever a need to switch the customer from recycled water to potable water, the meter would be removed and a new meter installed. Water Distribution New Business Group would get an order for the new meter. In addition, all dual plumbed buildings at Playa Vista have separate recycled water meters for irrigation and toilets. There is no potable back up currently for Playa Vista.

Potable water only goes through a recycled water meter if potable backup is placed in a recycled water tank. There are currently only two such tanks, the Greenbelt tank and the Hansen tank. The Hansen Tank serves as back-up water supply for the Valley Generating Station (VGS). The tank has a potable water meter and any potable water used to supplement the tank is subtracted from the total water delivered to the VGS and billed separately from the recycled water. The Griffith Park tank serves the Greenbelt system. Currently the tank does not have a potable water meter; however, very little potable water is used to supplement the tank. Recycled Water Group is in the process of installing a meter on the Griffith Park tank; the meter is expected to be installed by the end of the 2014-2015 fiscal year. For future recycled water tank installations, a meter will be installed on any potable back-up lines that may exist.

Treatment Process Water

There are some meters located at or near the LAAFP that appear to measure flows related to treatment processes. However, these meters are read and the readings are entered into the billing system. When this happens, water that would typically be classified as a supply volume is included in the consumption volume total.

In order to mitigate this potential double-counting effect, LADWP staff are currently investigating the installation conditions and intended purpose of these meters, as well as analyzing the best way to track these flows.

List of Actions*No Action**Summary of Impact*

Information in CCB and Recycled Water Planning Group databases would continue to be manually cross-checked upon request to determine the total recycled water usage in LADWP's customer base, which is time consuming for staff.

*Action 1: Add a Recycled Water Identifier in the Billing System**Scope of Work*

Information Technology Services Division (ITS) would perform an initial check of the current data set in CCB to check if the recycled water "yes/no" identifier is already filled out correctly. Recycled Water Planning Group would need to provide to ITS the current full list of recycled water accounts in a specific format to be identified by ITS. Recycled Water Planning Group would also need to coordinate with Account Services to provide information on any new recycled water accounts in the future. Account Services would then be responsible for populating the recycled water "yes/no" identifier. With these new procedures, recycled water usage could be easily extracted from CCB by filtering data through the "yes/no" identifier.

In the future, it may be worthwhile to investigate the possibility of adding a new attribute in CCB with a two-digit code identifier for different types of recycled water accounts (tertiary treated vs. advanced reverse osmosis treated, for example), but this has not been included in this action at this time.

Staffing Needs

The following staff are needed to complete this work: one Senior Systems Analyst, one Programmer Analyst, one Database Architect, and one Senior Utility Services Specialist.

Equipment, Materials, Rentals, and Contract Needs

No additional equipment, materials, rentals, or contracts are needed to perform this work.

WATER LOSS TASK FORCE

Estimated Costs

Table 29: Estimated Cost for Recommendation 2.2, Action 1

Staff/Item	Hours/Units	Cost
Staffing		
Capital Costs – for 1 month		
Senior Systems Analyst (1)	160 hours	\$9,000
Programmer Analyst (1)	160 hours	\$9,000
Database Architect (1)	160 hours	\$10,000
Senior Utility Services Specialist (1)	15 hours	\$1,000
Equipment, Materials, Rentals, Contracts		
N/A	N/A	N/A
Total Capital Costs (for 1 month)		\$29,000

Estimated Time

Table 30: Estimated Time for Recommendation 2.2, Action 1

Task	Time
Cross-Check of Existing Databases	1 month
Total Time	1 month

Action 2: Create a Standard Procedure for Identifying Treatment Process Water in the Billing System

Scope of Work

Water Operations Division staff would need to assist in investigation of meters at LAAFP that were identified on CCB but may be recirculating water through the treatment process. Water used in the treatment process would not be considered a part of LADWP's demand volume, but rather a function of supply volume. Having these volumes entered into CCB creates a double-counting by including the volumes as demand volumes.

ITS would need to create an identifier for treatment process water. This step is not currently being proposed at this time until treatment process volumes can be verified by LAAFP personnel and the need for a treatment process water attribute determined.

Staffing Needs

One treatment plant operator and one engineering associate would be needed for this investigative work.

Equipment, Materials, Rentals, and Contract Needs

No additional equipment, materials, rentals, or contracts are needed to perform this work.

Estimated Costs

Table 31: Estimated Cost for Recommendation 2.2, Action 2

Staff/Item	Hours/Units	Cost
Staffing		
Capital Costs – for 1 month		
Filtration Plant Operator (1)	80 hours	\$4,000
Engineering Associate (1)	80 hours	\$4,000
Equipment, Materials, Rentals, Contracts		
N/A	N/A	N/A
Total Capital Costs (for 1 month)		\$8,000

Estimated Time

Table 32: Estimated Time for Recommendation 2.2, Action 2

Task	Time
Investigation of LAAFP Meters Identified in CCB	1 month
Total Time	1 month

Recommended Action

It is recommended to pursue both Actions 1 and 2 in order to verify recycled water uses and treatment process water uses in LADWP’s system. Actions 1 and 2 will also improve the data quality and validity score of the “Billed metered” entry on the AWWA water audit software.

**Recommendation 2.3:
CIS and WMIS Inconsistencies**

Previous Study Conclusion

In order to organize the billing and meter data to perform a consumption analysis, an attempt was made to merge the Customer Information System (CIS) and Work Management Information System (WMIS) databases. The goal was to link each account from CIS to the WMIS data in order to populate each account with both the consumption data (from CIS) and the most current meter information (from WMIS).

After some initial data analysis and review, it was determined that linking the databases was not possible. The service code was first used as a possible linking identifier between the two databases. However, CIS has 364,979 unique service codes and WMIS provides 691,297 unique service codes. Another attempt was made to link the databases based on the meter number provided. Here, it was also determined that there was insufficient overlap between the two databases: there are 721,997 unique meters in CIS and only 700,433 unique meters numbers in WMIS. Without the consistency in account information necessary to merge the two databases, it was decided to use the information only provided in CIS for the complete billing data analysis.

The large number of inconsistencies between WMIS and CIS should be addressed. The current number of inconsistencies could have a big impact on revenue collection and analysis of meter use by size or customer class. Ideally one central database would have up to date information for all meter characteristics and billing data for consumption analysis.

Current Status

As a part of the CISCON (CIS conversion), LADWP's new billing system implementation utilizing a relational database, a joint effort was conducted to minimize the discrepancies between Water WMIS and TRES, the legacy customer information system based on the COBOL programming language that was over 37 years old. WMIS maintained an overnight snapshot of all CIS active Water accounts with basic service and meter information. A set of discrepancy reports (using Crystal Reports) was used to compare the CIS Snapshot with the live WMIS database.

Water Distribution Division (WDD) sent out field crews to perform field checks and one of the two actions were performed:

- Water New Business made the relevant corrections in WMIS
- The corrections were passed on to appropriate personnel to make the correction in TRES (either programmatically or manually)

A progress report was maintained in Excel and updated on a bi-weekly to document the progress made, as shown in Table 33. Field checks ended on April 17, 2013 following the completion of the CISCON project.

Table 33: Number of Cross-Database Discrepancies Checked During CISCON

DATE	1/2/2013	2/19/2013	3/5/2013	3/20/2013	3/27/2013	4/17/2013
WMIS-CIS SERVICE NUMBER DISCREPANCIES	# Records	# Records	# Records	# Records	# Records	# Records
METER AT ANOTHER SERVICE NUMBER	670	572	452	393	398	377
ADDRESS AT ANOTHER SERVICE NUMBER	666	669	563	285	287	273
UNKNOWN	<u>1,761</u>	<u>1,958</u>	<u>1,521</u>	<u>767</u>	<u>678</u>	<u>567</u>
SUBTOTAL	<u>3,097</u>	<u>3,199</u>	<u>2,536</u>	<u>1,445</u>	<u>1,363</u>	<u>1,217</u>
WMIS-CIS METER NUMBER DISCREPANCIES	# Records	# Records	# Records	# Records	# Records	# Records
CIS HAS OLDER METER	1,277	982	615	639	635	687
CIS HAS OLDER METER / ALSO AT ANOTHER SERVICE	272	268	263	260	261	259
METER AT ANOTHER SERVICE	1,907	1,730	1,737	1,808	1,804	1,787
TRANSPOSED	433	434	435	435	435	434
TYPO	968	966	970	964	964	967
TYPO / ALSO AT ANOTHER SERVICE	905	917	905	912	912	903
UNKNOWN	<u>6,011</u>	<u>6,027</u>	<u>6,014</u>	<u>7,093</u>	<u>2,421</u>	<u>2,101</u>
SUBTOTAL	<u>11,773</u>	<u>11,324</u>	<u>10,939</u>	<u>12,111</u>	<u>7,432</u>	<u>7,138</u>
WMIS-CIS ERT NUMBER DISCREPANCIES	# Records	# Records	# Records	# Records	# Records	# Records
DIFFERENT ERT NUMBER AT SAME METER NUMBER	UNK	4,665	4,046	5,896	5,989	5,931
DIFFERENT METER NUMBER WITH SAME ERT NUMBER	UNK	2,358	1,741	1,626	1,667	1,423
DUPLICATE ERT NUMBER IN TRES	UNK	634	365	365	365	145
DUPLICATE ERT NUMBER IN WMIS	UNK	214	200	81	247	240
Bad Length ERT# (in WMIS)						220
Bad Length ERT# (in TRES)						644
SUBTOTAL	<u>0</u>	<u>7,871</u>	<u>6,352</u>	<u>7,968</u>	<u>8,268</u>	<u>8,603</u>
GIS DISCREPANCIES	# Records	# Records	# Records	# Records	# Records	# Records
DUPLICATE SERVICES IN GIS	UNK	2,185	1,738	1,198		
SERVICES NOT CONNECTED TO SUPPLY IN GIS	UNK	12,041	12,041	12,041		
SUBTOTAL	<u>0</u>	<u>14,226</u>	<u>13,779</u>	<u>13,239</u>	<u>0</u>	
TOTAL ALL CATEGORIES	<u>14,870</u>	<u>36,620</u>	<u>33,606</u>	<u>34,763</u>	<u>17,063</u>	<u>16,958</u>

List of Actions

No Action

Summary of Impact

By taking no action, the potential for lost revenues (meters found in the field not installed in CCB) increases as well as not meeting the customer’s expectations of a timely and accurate billing.

Action 1: Address the Remaining Duplicate Badge Numbers

Scope of Work

Customer Service Division (CSD) Account Services Unit (ASU) will continue with the effort of identifying and correcting duplicate water badge numbers by correcting possible clerical errors. Badges that require field checks will initially be done by meter reading at an effort to verify correct badge number and capture current meter read. Field investigation will provide support when additional information is needed and billing instructions required. In addition, ASU will work with Water Distribution Division (WDD) to correct duplicate water check detectors, Fire Services and ERTs. Once the field information is provided to ASU from both Field Investigation and WDD, corrections will be done to the billing system to ensure accurate billing. There are currently a total of 451 duplicate water badge numbers in CCB. This includes 5 detector checks.

Staffing Needs

It is estimated that one customer service representative and one field investigator will be needed to be able to correct the information in the field and in CCB in a period of four months.

Equipment, Materials, Rentals, and Contract Needs

No new equipment is needed. All equipment and materials needed are already in use by the Department.

Estimated Costs

Table 34: Estimated Cost for Recommendation 2.3, Action 1

Staff/Item	Hours/Units	Cost
<i>Staffing</i>		
<i>Capital Costs – for 4 months</i>		
Customer Service Representatives (1)	320 hours	\$12,000
Field Investigator (1)	320 hours	\$14,000
<i>Equipment, Materials, Rentals, Contracts</i>		
N/A	N/A	N/A
Total Capital Costs (for 4 months)		\$26,000

Note that the staffing costs shown are estimated and dependent on resources available. CSD is committed to ensuring this issue is addressed and will allocate staff to complete this work as needed.

Estimated Time

Table 35: Estimated Time for Recommendation 2.3, Action 1

Task	Time
CSD Investigation	3 months
Detector Check Verification	1 month
Total Time	4 months

Recommended Action

It is recommended to pursue Action 1, which is to work down the duplicate badge numbers in CCB. Action 1 will also improve procedures and accuracy of meter testing and consumption profiling activities outlined in Section 3.

**Recommendation 2.4:
Leak Database Consolidation and Accuracy**

Previous Study Conclusion

As one of the main data collection efforts for the component analysis of real losses, records for all infrastructure failures during the audit period were requested. Failures on service connections, mains, and mains appurtenances are required for a complete component analysis of real losses. This proved to be an especially effort intensive task given LADWP’s current tracking system for Reported Leaks.

To capture all the failures in the system for the audit period, three different groups of leak events – each differentiated by separate data compilation processes – were considered. Figure 6 shows the location of each of the different leak types in relation to the main and the curb. The following sections describe how the reported leak data was compiled for each type of leak.

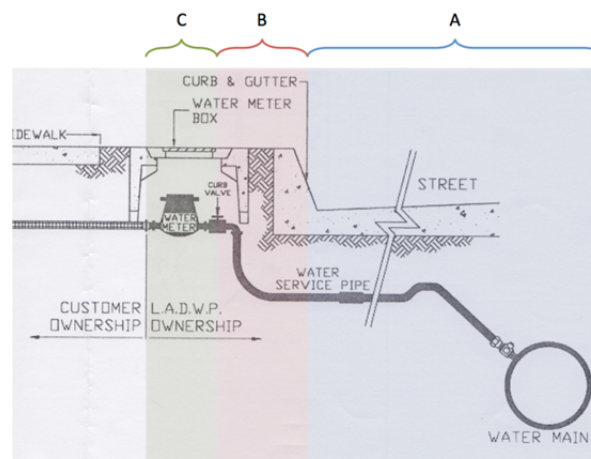


Figure 6: Diagram Showing Classification of Leak Types A, B, & C

The first data collection effort involves main leaks and service leaks found within portion “A” as noted on Figure 6. This section spans from the main to the curb. For all leaks that occur in this area, after confirmation of the leak and its subsequent repair, a Leak Report is filed in LADWP’s GIS system. The

Leak Report contains information on the leak characteristics, including pipe size, pipe material, and type of leak.

The second data collection effort produces service leaks found within portion “B” as noted on Figure 6. This section spans from the curb to the meter box. For all leaks that occur in this area, GIS Leak Reports are not filed. Instead, documentation of work completed can be found in the Construction Productivity System (CPS). Searching this database for leak references produces an inventory of leaks in the area between the curb and the meter box.

The third group of service leaks is found within portion “C” as noted on Figure 6. This section covers leaks in the meter box. Upon encountering a flooded meter box, a meter reader will request a Water Investigation Report (WIR). Each day the meter shop receives an inventory of meters with these WIR requests. In most cases, the flooded meter boxes are not a result of an actual leak. However, the meter shop representative investigating the case does not document any confirmation of a leak. Instead, repairs are simply completed as necessary. The only cases of documented and archived work in these instances involve a full meter replacement, in which case the meter number will be updated in the Work Management Information System (WMIS).

It is important to note that the leak repair data presented notable challenges in collection and analysis. The majority of leak repair data submitted characterizes reported leaks from the main to the curb. For this set of FY 2010 -2011 leak repair data, a significant percentage of leak repair data for main leaks is missing various leak data relevant information. For example about 24% of reported and repaired main leaks had missing information on start or end date of the work order. Further details on completeness of main repair data is provided in Table 36.

Table 36: Main Leaks Data Quality

Total Number of Reported Main Leaks	1,194	
Leak Repair Data Quality Stats	Count	Percentage
Reports with missing start or end date or both	289	24%
Reports with missing size information	19	2%
Reports with missing material information	37	3%
Reports with missing leak type	208	17%
Reports with missing year installed	196	16%

The service connection leak repair data has similar data completeness issues as the main leak repair data (see Table 37).

Table 37: Service Leaks Between Main and Curb Data Quality

Total Number of Reported Service Leaks	893	
Leak Repair Data Quality Stats	Count	Percentage
Reports with missing start or end date or both	270	30%
Reports with missing size information	36	4%
Reports with missing material information	54	6%
Reports with missing leak type	404	45%

The data provided on the failures between the curb and the meter box (in the CPS dataset) was especially difficult to organize and classify for inclusion in the reported break analysis. Table 38 outlines the data completeness issues encountered in the CPS dataset. Most of the record's information was entered in a "Comments" field, providing narrative descriptions without any standard format or consistent level of detail provided. For proper analysis and categorization, the comments fields were examined to extract failure type information and determine whether or not each record involved a leak. Only 425 of the 909 records were possible to categorize.

Table 38: Service Leaks Between Curb and Meter Box Data Quality

Total Number of Reported Service Leaks	909	
Leak Repair Data Quality Stats	Count	Percentage
Reports with missing start or end date or both	168	18%
Reports with missing size information	909	100%
Reports with missing material information	909	100%
Records Possible to Categorize by Leak Type	425	47%

Current Status

Leak information continues to be captured manually. Due to the manual process, there are delays in entering the information gathered in the field entered into the GIS database. Improvements have been made by field personnel in reporting complete information on the leak report data sheet. The data sheet does not capture the timing of when the leak started or was shut off. This information is captured as "Call Received". However, timestamps appear to often be reported incorrectly as the time the staff person completed the job and entered the data in the office, rather than the actual time of shutoff and repair in the field. This has skewed the results of past data to show the time of response for leak repair to be greater than actual response times.

In September 2013, LADWP switched from the Trouble Board to the new e-Respond system for capturing information on leak repair jobs worked. In addition, a pilot project was initiated in February 2015, with Trimble providing consulting services for Water Distribution Division to create a Leak Reporting system. The program includes fields for input of all types of leaks (mains, services, hydrants, valves, and meter leaks) in the same database using handheld devices. Staff are currently working on improving methods for using the database to query information based on pipe size and type, and other variables. In addition, training of staff on how to enter all relevant timestamps and other important

information in the new system is ongoing. This program currently involves pilot testing six mobile devices that are deployed with leak crews to enter information electronically instead of manually. This mobile recording system will tie in to e-Respond in Phase 2 of this pilot program.

List of Actions

No Action

Summary of Impact

The primary challenge with the No Action option is that CUWCC Best Management Practices require reporting an annual number of leaks and estimated volume loss. The volume loss is typically not estimated on all leaks, only on some of the major leaks.

This lack of data and inability to report estimated water losses could jeopardize opportunities to get low interest loans and grants from State and Federal government. California Proposition 1, which passed in 2014, is an example of potential loans and grants in which we would have difficulty meeting the reporting requirements.

If there is no action, there will also continue to be a lag between capturing information in the field and entering it into GIS.

Action 1: Develop a Second Pilot Mobile Leak Reporting System to Capture and Update Leak Information in Near-Real Time

Scope of Work

Implement a second automated leak reporting system pilot using Sedaru as a comparison with the Trimble pilot. Handheld devices will be used by field staff to upload leak information directly into the database in real time. Volume estimates will be automatically calculated based on variables inputted in the field. This should correct current issues with timestamps being recorded as the incorrect time based on when the staff person recorded the time in the office rather than the shutoff and repair time that occurred in the field.

Staffing Needs

This action utilizes five water utility workers and one civil engineering associate. The technology may be expanded in the future to gate crews and large valve operators that typically respond to leaks.

Equipment, Materials, Rentals, and Contract Needs

Equipment will consist of handheld mobile devices with broadband communication capability. This equipment will run licensed software and possibly communicate to cloud based server. Six units are planned to be purchased as a part of a pilot program. If the decision is made to implement the program on a full-scale basis, it is expected at least 40 devices will be needed for leak crews and support personnel.

Estimated Costs

Table 39: Estimated Cost for Recommendation 2.4, Action 1

Staff/Item	Hours/Units	Cost
Staffing		
Capital Costs – for 1 year		
Water Utility Workers (5)	60 hours	\$2,000
Civil Engineering Associate (1)	40 hours	\$2,000
Equipment, Materials, Rentals, Contracts		
Capital Costs		
Handheld Devices	6 Units	\$4,000
SIM Cards and Licensed Software	6 Units	\$12,000
Total Capital Costs (for 1 year)		\$20,000

Estimated Time

Table 40: Estimated Time for Recommendation 2.4, Action 1

Task	Time
Procure Equipment	6 months
Pilot Test Mobile Devices	6 months
Total Time	1 year

Recommended Action

It is recommended to pursue Action 1, develop a second pilot mobile leak reporting system. This Action, along with the first pilot and staff training, will help reduce the number of improperly recorded timestamps for leak shutoff and repair. This will improve the data quality of leak awareness and duration times used in the Component Analysis of Real Losses and will provide a more accurate depiction of leak response times for evaluating staffing needs for leak repair activities. Results of the pilot programs will be used to evaluate and select a mobile leak reporting system.

Section 3: Meter Testing and Replacement

Meter Testing and Replacement refers to activities related to meter maintenance that improve customer meter accuracies. This would include testing meters prior to installation, testing meters that have been in operation for a number of years, and replacing older meters on a reasonable replacement cycle. This section also discusses meter right-sizing, referring to the use of an appropriately-sized customer meter to accurately measure the typical consumption used by the customer.

“Customer meter inaccuracies” is an entry field in the AWWA Free Water Audit Software that is used to calculate the apparent losses section of the water balance. Figure 7 shows the role of customer meter inaccuracies in the water balance.

Water Supplied	Authorized Consumption	Billed Authorized Consumption	Billed Metered Consumption	Revenue Water
			Billed Unmetered Consumption	
		Unbilled Authorized Consumption	Unbilled Metered Consumption	Non-Revenue Water
			Unbilled Unmetered Consumption	
	Water Losses	Apparent Losses	Unauthorized Consumption	
			Customer Meter Inaccuracies	
			Data Handling Errors	
Real Losses				

Figure 7: Customer Meter Inaccuracies Identified in the Water Balance (Not to Scale)

Recommendation 3.1:

Customer Meter Sizing and Regular Consumption Profiling

Previous Study Conclusion

Customers with either over-sized meters or under-sized meters can result in loss of the meter’s registration accuracy. Over-sizing of customer meters has the potential for increasing the amount of under-registration since meters tend to be less accurate in the lower ranges of their measuring capacity. Under-sizing of customer meters may result in a meter wearing out quickly, which also eventually causes the meter to under-register. It is important to qualify that this consumption analysis is the first step in the process of a meter right-sizing program. Identifying outliers highlights meter populations that may be at risk for under or over registering.

Appendix E of the Water Loss Audit and Component Analysis study (which can be downloaded at <http://www.ladwp.com/wc>) shows the consumption range profile for each meter size separately. These meters should be prioritized for accuracy assessment and/or replacement as they are the most likely to be inappropriately sized for the customer’s average daily consumption. However, to verify the incorrect

sizing of a meter it is best to conduct consumption profiling that would record the exact 24-hour consumption profile of a specific meter.

Lastly, it's also important to review this analysis with an understanding of the small meter sizing parameters as dictated by fire flow requirements. Going forward, LADWP is planning to install small meters no smaller than 1", limiting the options in right-sizing low consumption accounts.

Current Status

WDD has a current contract with an outside vendor, who is reviewing LADWP's large meter maintenance and testing programs. Measuring elements of meters are being tested before installation into the ground, and also testing a sample of measuring elements from meters of various ages, sizes, and types.

In addition, WDD has procured a contract for a pilot Advanced Metering Infrastructure (AMI) project. WDD is planning to install 525 units for this project. This infrastructure will allow LADWP to perform more detailed consumption profiling.

However, it should be noted that there are significant constraints in potentially resizing a meter based on consumption profiling results. When LADWP customers request domestic services, the Los Angeles Department of Building and Safety (LADBS) must grant a plumbing permit. LADBS selects a meter and service size based on the number of fixtures at the proposed/existing site.

Once the service and meter have been installed, the service size and meter size cannot be changed without approval from LADBS. LADBS will not allow anyone to reduce the service/meter size unless fixtures are actually removed from the existing buildings and a new reassessment procedure is completed. Given the current LADBS rules and regulations, LADWP may not be able to reduce the meter size or force the customer to buy a larger service.

Furthermore, downsizing or upsizing a meter could be infeasible depending on the specific situation. A reducer could be used to downsize a meter on a larger service line, but this could violate LADBS and LAFD requirements for meter sizing and minimum fire flow. LADBS code also sizes meters by number of plumbing fixtures on site. In order to upsize a meter, a new service line would need to be installed, which could cost a few thousand dollars in piping costs, plus labor costs.

List of Actions

No Action

Summary of Impact

LADWP would continue to use the data from the FY 2010-2011 consumption profiling performed in the previous study, which is fast becoming outdated information. However, information from other currently ongoing pilot programs may provide more updated information on consumption patterns for a focused set of LADWP customers.

Action 1: Update FY 2010-2011 Consumption Profiling and Investigate Problematic Meters Identified

Scope of Work

The new consumption profile would be for the latest fiscal year for which a full set of consumption data is available. ITS staff would provide the raw data set for the consumption volumes for each meter for each billing period. Due to staffing limitations and resource constraints, a consultant would need to be hired to perform the data analysis of the consumption profiling.

The final consumption profile would be sent to Water Distribution Division, with specific meters that were presented as outliers identified for follow-up. WDD would either perform a field test for smaller meters, or pull the meter and place it on a test bench at a DWP facility.

Staffing Needs

One senior systems analyst would be required to provide the raw data set. The number of meters identified as outliers could vary, therefore, in order to provide an estimate of staff needs from WDD, it is estimated that 1 water service worker would be needed to check around 1,800 meters per year. This number is based on the number of non-zero meter outliers identified in the previous FY 2010-2011 Water Loss Audit consumption profile, but this may or may not be representative of the actual number of meters that need to be checked depending on the updated results of the proposed new profile. In addition, water service specialists would be needed to bench test meters. For an approximate 50% of those outlier meters identified as an estimate that would need to be bench tested, one water service specialist would be needed.

Equipment, Materials, Rentals, and Contract Needs

A contract would be needed to perform the consumption profiling. Three light utility trucks will also be needed.

Estimated Costs

Table 41: Estimated Cost for Recommendation 3.1, Action 1

Staff/Item	Hours/Units	Cost
<i>Staffing</i>		
<i>Capital Costs – for 1 month</i>		
Senior Systems Analyst (1)	160 hours	\$9,000
<i>Operations & Maintenance Costs – per year</i>		
Water Service Worker (1)	2,080 hours	\$78,000
Water Service Specialist (1)	2,080 hours	\$82,000
<i>Equipment, Materials, Rentals, Contracts</i>		
<i>Capital Costs</i>		
Contract	1 unit	\$50,000
Light Service Utility Truck	1 unit	\$56,000
Total Capital Costs (for 1 month)		\$115,000
Total Operations & Maintenance Costs (per year)		\$160,000

WATER LOSS TASK FORCE

Estimated Time

Table 42: Estimated Time for Recommendation 3.1, Action 1

Task	Time
Data Collection	1 month
Contract Procurement	6 months
Consumption Profile	2 months
Meter Outlier Follow-Up	Ongoing
Total Time	9 months + ongoing

Note that the time to purchase a truck, which could take up to 3-4 years, was not included in this estimated timeline.

Recommended Action

It is recommended to go with the No Action option due to concerns about the ability to make changes to existing meters. The pilot programs that are already ongoing will provide more detailed consumption profiling information that can be used as a small-scale evaluation.

Recommendation 3.2: *Testing of Small Customer Meters*

Previous Study Conclusion

LADWP should continue regular testing of random small meter samples. Regular testing will allow tracking of the average accuracy of each size/make group of meters. With this type of monitoring, LADWP will be able to initiate meter replacement when a certain meter size/make group reaches the threshold where meter replacement becomes an economically viable option.

In order to proactively manage the small meter population, LADWP should continue regular testing of random small meter samples (100 to 200 meters per year). Regular random testing will allow tracking of the average accuracy of each of the size/make groups of meters. With this type of monitoring, LADWP will be able to initiate meter replacement when a certain meter make/size group reaches the threshold where meter replacement becomes an economically viable option.

Current Status

WDD Meter and Service Section currently tests all large (3" and larger) meters and 10% of all small (5/8"x3/4" to 2") meters prior to installation. The tests are to insure that the meters are performing to manufacturer specifications. If a meter in the field is removed, it is generally more cost-effective to replace the unit rather than to test and re-install the meter. There is currently no meter testing of representative samples of meters already in service, but this is being addressed by meter replacement goals.

According to the industry standard, the life expectancy of small meters is 10-20 years. The current meter replacement cycle is approximately 27 years based on 25,000 small meter annual replacement goals. The goal was determined by the number of personnel available for meter replacement.

The top 400 large meters by consumption are overhauled (measuring elements, gaskets, and occasionally the registers are replaced) at a frequency of 6 months to five years, based on consumption.

List of Actions

No Action

Summary of Impact

No additional bench testing of a representative sample of small meters would be pursued. WDD would continue with their annual replacement program of 25,000 small meters to help improve meter accuracy. However, without bench test results, the current status of the meter accuracy of the small meter base would be unknown and would have to be estimated based on results from the previous study.

Action 1: Implement Meter Testing of a Representative Sample of 1,000 Operational Small Meters

Scope of Work

ITS would provide a sample list of 1,000 meters to be bench tested based on data found in CCB. These 1,000 meters should be representative of the size, age, and make of the entire small meter stock, and then randomly selected.

The 1,000 meters would have to be removed from the field and replaced with new meters and Itron ERTs. The Water Service Workers would data capture the new meter data as well as the out read of old meter on his/her assigned mobile data terminal (MDT). The sample of 1,000 meters pulled would not be placed back into the field following bench testing as the new meters they were replaced with will become the new permanent meters for those customers.

All removed meters would be delivered to the Water Service Specialist assigned to the testing facility. Water Service Specialist would clean the meters and prepare them to be set and tested on the Meter Shop test bench.

The actual percentage of LADWP small meter population by size is as follows:

- 5/8" x 3/4" meters = 25%
- 3/4" x 1" meters = 43%
- 1" meters = 20%
- 1-1/2" meters = 7%
- 2" meters = 5%

The meter sizes removed from the field for testing would mirror LADWP's actual meter population percentages.

WATER LOSS TASK FORCE

Once the bench tests of all 1,000 meters are completed, the results would need to be analyzed and an average meter accuracy percentage should be calculated. This data would be used to populate the AWWA water balance software for performing the water loss audit on an annual basis.

It should be noted that these bench tests would follow AWWA M6 standard testing protocol. If additional very low flow tests are requested, the time period for completion of this task would need to be extended.

Staffing Needs

The following staff would be needed to pull meters from the field and perform the bench tests: a Senior Water Utility Worker, a Maintenance and Construction Helper, two Water Service Workers, and a Water Service Specialist. In addition, a Senior Systems Analyst would be needed to prepare the sample meter list on an annual basis, and an Engineering Associate could analyze the results and perform the average meter accuracy calculation.

Equipment, Materials, Rentals, and Contract Needs

The following equipment and materials are needed: utility trucks, water meters, and ERTs.

Estimated Costs

Table 43: Estimated Cost for Recommendation 3.2, Action 1

Staff/Item	Hours/Units	Cost
<i>Staffing</i>		
<i>Capital Costs – for 5 months</i>		
Senior Water Utility Worker (1)	120 hours	\$5,000
Maintenance and Construction Helper (1)	120 hours	\$4,000
Water Service Workers (2)	880 hours	\$33,000
Water Service Specialist (Testing) (1)	128 hours	\$5,000
Senior Systems Analyst (1)	107 hours	\$6,000
Engineering Associate (1)	107 hours	\$6,000
<i>Equipment, Materials, Rentals, Contracts</i>		
<i>Capital Costs</i>		
Light Service Utility Truck	880 hours	\$10,000
Large Meter Utility Truck	120 hours	\$2,000
1.5" Water Meter	70 units	\$16,000
1"R Water Meter	200 units	\$24,000
2" Water Meter	50 units	\$15,000
¾" x 1" Water Meter	430 units	\$39,000
5/8" x ¾" Water Meter	250 units	\$19,000
ltron ERTs	1,000 units	\$56,000
Total Capital Costs (for 5 months)		\$240,000

Estimated Time

Table 44: Estimated Time for Recommendation 3.2, Action 1

Task	Time
Create Meter Sample List	1 month
Pull Meters from Field	2 months
Bench Test Meters	2 months
Analyze Results	1 month
Total Time	4 months

Pulling meters and bench testing will be performed concurrently, so the total time is 4 months. Note that the time to purchase additional trucks, which could take up to 3-4 years, was not included in this estimated timeline.

Action 2: Implement Meter Testing of a Representative Sample of 12,000 Operational Small Meters

Scope of Work

The 12,000 meters would have to be removed from the field and replaced with new meters and Itron ERTs. The Water Service Workers would data capture the new meter data as well as the out read of old meter on his/her assigned MDT. The sample of 12,000 meters pulled would not be placed back into the field following bench testing as the new meters they were replaced with will become the new permanent meters for those customers.

All removed meters would be delivered to the Water Service Specialist assigned to the testing facility. Water Service Specialist would clean the meters and prepare them to be set and tested on the Meter Shop test bench.

The actual percentage of LADWP small meter population by size is as follows:

- 5/8" x 3/4" meters = 25%
- 3/4" x 1" meters = 43%
- 1" meters = 20%
- 1-1/2" meters = 7%
- 2" meters = 5%

The meter sizes removed from the field for testing would mirror LADWP's actual meter population percentages.

Staffing Needs

The following staff would be needed: Senior Water Utility Worker, Maintenance and Construction Helper, Water Service Worker, and Water Service Specialist.

Equipment, Materials, Rentals, and Contract Needs

The following equipment and materials are needed: utility trucks, water meters, and ERTs.

WATER LOSS TASK FORCE

Estimated Costs

Table 45: Estimated Cost for Recommendation 3.2, Action 2

Staff/Item	Hours/Units	Cost
Staffing		
Capital Costs – for 1 year 5 months		
Senior Water Utility Worker (2)	1,440 hours	\$61,000
Maintenance and Construction Helper (2)	1,440 hours	\$46,000
Water Service Worker (4)	10,560 hours	\$396,000
Water Service Specialist (Testing) (2)	1,533 hours	\$60,000
Senior Systems Analyst (1)	160 hours	\$9,000
Engineering Associate (1)	160 hours	\$9,000
Equipment, Materials, Rentals, Contracts		
Capital Costs		
Light Service Utility Truck	10,560 hours	\$116,000
Large Meter Utility Truck	1,440 hours	\$29,000
1.5" Water Meter	840 units	\$191,000
1"R Water Meter	2,400 units	\$283,000
2" Water Meter	600 units	\$180,000
¾" x 1" Water Meter	5,160 units	\$468,000
5/8" x ¾" Water Meter	3,000 units	\$222,000
Itron ERTs	12,000 units	\$672,000
Total Capital Costs (for 1 year 5 months)		\$2,742,000

Estimated Time

Table 46: Estimated Time for Recommendation 3.2, Action 2

Task	Time
Create Meter Sample List	1 month
Pull Meters from Field	1 year 3 months
Bench Test Meters	1 year 3 months
Analyze Results	1 month
Total Time	1 year 5 months

Pulling meters and bench testing will be performed concurrently, so the total time is 1 year 5 months. Note that the time to purchase additional trucks, which could take up to 3-4 years, was not included in this estimated timeline.

Recommended Action

Based on results from the previous FY 2010-2011 Water Loss Audit and Component Analysis study, the amount of meter inaccuracies from small customer meter under-registration was estimated to be 6,112 AF. At the current cost of MWD Tier 1 Treated Water, LADWP's most expensive water source at \$923 per AF, this volume would amount to more than \$5.6 million in loss of revenue.

Therefore, it is recommended to pursue Action 1, testing of a representative sample of 1,500 small meters. Though Action 1 will help recover less than 1% of the lost revenue, it will improve the data quality and validity score of the “Customer metering inaccuracies” entry on the AWWA water audit software. Action 1 will also help inform and prioritize LADWP’s ongoing small meter replacement program, which has a replacement goal of 25,000 small meters per year. This replacement program is expected to help recover another 5% of lost revenue.

Pursuing No Action would not provide actual data to back up the meter accuracy information that would be entered into the AWWA Water Audit Software. Action 2 would be unrealistic as bench testing 12,000 meters would monopolize all test benches available and would use far too many staff and resources.

Recommendation 3.3: *Replacement of Worst Performing Small Customer Meters*

Previous Study Conclusion

To assess meter accuracy for the small meter population, 1,247 small meter tests were performed. The sample size tested for each meter size and make category was determined based on the ratio of total volume metered by a specific category to the total metered volume. For example, 3.69% of the small meter consumption is registered by two inch badger meters, so approximately 3.69% of the meter tests requested were two inch badger meters.

The small meter test results indicate that the small meter population is operating at a relatively high level of accuracy. The accuracy results and economic analysis here do not present a case for any immediate action on widespread small meter replacement. However, isolating the worst performing, most economic, meter groups (by size and make) for a targeted meter replacement program is recommended. The following small meter groups should be targeted for replacement given that the internal rate of return on the required meter replacement investment was positive:

- 5/8 x 3/4” Sensus meters
- 3/4 x 1” Sensus meters
- 1 1/2” Sensus meters
- 2” Sensus meters

Current Status

The Water Distribution Division (WDD) Meter and Service Section currently has a small meter replacement goal of 25,000 meters annually. This goal was initially based on the industry standard of the life expectancy of small meters. According to the standard, we should be replacing about 40,000 meters per year. The goal of 25,000 was set due to WDD’s available labor resources.

The Sensus small meters (2” and smaller) have been targeted as a priority for replacement. During the previous Water Loss Audit study, the Sensus meters were discovered to be the worst performers. To date, 1,000 Sensus meters have already been replaced. WDD is also looking to replace ABB meters, as they were determined to be next in bad performing meters.

List of Actions

No Action

Summary of Impact

If the worst performing small meters are not replaced, the total customer meter base will continue to perform at less accurate levels. Replacing the specific meters identified would improve the overall customer meter accuracy level significantly. However, LADWP would continue its goal to replace 25,000 priority small meters on an annual basis, thereby increasing customer meter accuracy each year.

Action 1: Replace All of the Worst Performing Small Meters

Scope of Work

There are 32,000 Sensus small meters in the distribution system to be replaced. Some of these meters can be addressed through WDD Meter and Service Section's annual Meter Replacement Program (MRP). The annual goal of the MRP is the replacement of 25,000 small meters. The priority is to replace stuck or defective meters as the potential for revenue recovery is greater than replacement of the worst-performing meters that are not stuck or otherwise defective. The stuck or defective meters may not be Sensus meters. The way to ensure that the Sensus meters are being replaced would be to dedicate resources strictly for the Sensus meters. 10 Water Service Workers should be able to replace the meters within 2 years.

Staffing Needs

One additional Clerk typist would be needed to research meter information, create Field Activities (F/As) in CCB, and to data capture and track meter changes in WMIS. 10 additional Water Service Workers (2 per district) will perform the meter changes at a rate of 8 meters, per Service Worker, per day.

Equipment, Materials, Rentals, and Contract Needs

32,000 Neptune meters, sizes 5/8"-1.5", 32,000 Itron Encoder Receiver Transmitters (ERTs), and 64,000 meter gaskets, sizes 3/4"-1.5", will need to be purchased. Each Water Service Worker will need a Light Service Utility Truck. Each Water Service Worker will need a mobile data terminal (MDT) to receive F/As and to input meter information.

Estimated Costs

Table 47: Estimated Cost for Recommendation 3.3, Action 1

Staff/Item	Hours/Units	Cost
Staffing		
Capital Costs – for 1 year 8 months		
Clerk Typist (1)	3,536 hours	\$70,000
Water Service Worker (10)	32,865 hours	\$1,589,000
Equipment, Materials, Rentals, Contracts		
Capital Costs		
Light Service Utility Truck	10 units	\$559,000
1.5" Water Meter	1,104 units	\$251,000
1"R Water Meter	12,519 units	\$1,477,000
2" Water Meter	730 units	\$219,000
¾"x 1" Water Meter	7,746 units	\$703,000
5/8"x ¾" Water Meter	9,900 units	\$733,000
ltron ERTs	32,000 units	\$2,240,000
Total Capital Costs (for 1 year 8 months)		\$7,841,000

Estimated Time

Table 48: Estimated Time for Recommendation 3.3, Action 1

Task	Time
Installation and Data Capturing	1 year 8 months
Total Time	1 year 8 months

Note that the time to purchase additional trucks, which could take up to 3-4 years, was not included in this estimated timeline.

Recommended Action

Based on results from the previous FY 2010-2011 Water Loss Audit and Component Analysis study, the amount of meter inaccuracies from small customer meter under-registration was estimated to be 6,112 AF. At the current cost of MWD Tier 1 Treated Water, LADWP's most expensive water source at \$923 per AF, this volume would amount to more than \$5.6 million in loss of revenue.

Pursuing Action 1 will increase meter accuracy and recover potential lost revenue due to under-registration of poor-performing meters. It is estimated that Action 1 could help recover up to 5% of the lost revenue. However, Action 1 is only recommended after an initial round of meter sampling is completed as suggested in Recommendation 3.2, Action 1. The results of the testing of 1,500 small meters will provide an updated profile of the meter stock and could potentially change (or otherwise validate) the results of which meters are worst performing from the previous sampling completed for the FY 2010-2011 Water Loss Audit and Component Analysis study. The scope of work and estimated costs for Action 1 will likely change after the new testing results are received.

Therefore, it is recommended to take the No Action option until the meters can be re-evaluated. Should Action 1 be deployed following re-assessment, it will improve the data quality and validity score of the “Customer metering inaccuracies” entry on the AWWA water audit software.

Recommendation 3.4: *Large Meter Maintenance Schedule Overhaul*

Previous Study Conclusion

For the top one hundred large customer meters (ranked by revenue generated), it is recommended to undertake consumption profiling and targeted selection of appropriate metering technology. An improvement of 1% in metering accuracy (achievable by switching from a standard compound meter to an electromagnetic flow meter, for example) will result in significant revenue increases for these meters.

For the large meter population, LADWP should aim to adopt a large meter maintenance program that compares consumption and revenue data to overhaul costs for an overhaul schedule that optimizes savings. To institutionalize this approach with an appreciation for labor constraints and a pending new central database, the FY2010-11 Water Loss Audit and Component Analysis Study recommended that LADWP pursue the new large meter maintenance program in the following three phases:

Phase One: To start the process of adopting this approach, it is recommended to select and implement Scenario #2 in Section 10.2 of the Water Loss Audit and Component Analysis study (which can be downloaded at <http://www.ladwp.com/wc>), without the sewer service charge considerations. This would require overhauling about 20 more large meters than the 153 overhauls completed in FY 2010-2011. Scenario #2 offers an advantageous starting point in that it does not require LADWP to test significantly more meters than tested in 2011.

Phase Two: With the adoption of the new central database and preparation of sufficient labor resources, it is recommended to adopt Scenario #2 with sewer service rate charge considerations. This will require significantly more overhauls per year but will be based on a more complete cost benefit analysis when taking the sewer service revenue losses into account.

Phase Three: Down the line, after institutionalizing this consumption based approach for designing the annual meter overhaul programs, it is recommended to fine tune the approach by revisiting the under-registration assumptions. Toward this end, completing more meter accuracy testing as a component of the overhaul process is recommended. This will provide trend data that will allow for better understanding of how the large meter’s accuracy decreases between testing intervals.

Current Status

Water Distribution Division (WDD) Meter and Service Section has a long history of performing maintenance on the unitized measuring elements (UME) of its large meter base to help maintain their accuracy. However, much of the knowledge that had been gained was disrupted when its large meter base was replaced between 2003 and 2010. Updated meter technology and different meter vendors

normally make previous knowledge less relevant and useful. As a result of the Water Loss Audit, WDD Meter and Service Section staffing and other priorities limit large meter measuring element maintenance to about 150 meters per year. In 2013, immediately following the completion of the previous FY 2010-2011 Water Loss Audit and Component Analysis study, LADWP's large meter maintenance schedule was overhauled so that the top 400 users have their meter maintained on a 6 month to 5 year frequency. WDD Meter and Service would like to maintain the remaining 6,300 large meter base on as 8 to 10 year cycle. As currently staffed, it would take nearly 45 years to work through the entire meter base.

List of Actions

No Action

Summary of Impact

Since the large meter maintenance schedule has already been overhauled to reflect the recommendations from the previous study, large meter accuracy is already expected to improve. However, this would not be confirmed without analyzing available test results.

Action 1: Analyze Large Meter Test Results from Recent Years to Provide a Volume Weighted Average Accuracy

Scope of Work

When a large meter is scheduled to be overhauled, the crew takes new or rebuilt UMEs to the work location. The old UME is removed, the new unit is installed, the old unit is returned to the meter shop, tested, and data is stored. This data has been stored for approximately the last 18 months. Once a sufficient amount of data is accumulated (about two years) the results can be analyzed. Therefore, the data analysis will be performed every 2 years.

Since the data is currently stored as hard copies only, the data would need to be transferred manually to an electronic format for data analysis. This could be time consuming. It is recommended that WDD organize a program in the future to populate the data electronically on a regular basis rather than waiting until a data analysis needs to be performed.

Staffing Needs

One Water Service Specialist will be required to analyze the results.

Equipment, Materials, Rentals, and Contract Needs

One laptop computer will be needed.

WATER LOSS TASK FORCE

Estimated Costs

Table 49: Estimated Cost for Recommendation 3.4, Action 1

Staff/Item	Hours/Units	Cost
Staffing		
Capital Costs – for 1 month		
Water Service Specialist	80 hours	\$3,000
Equipment, Materials, Rentals, Contracts		
Capital Costs		
Laptop Computer	1 unit	\$1,000
Total Capital Costs (for 1 month)		\$4,000

Estimated Time

Table 50: Estimated Time for Recommendation 3.4, Action 1

Task	Time
Purchase Laptop	1 month
Accumulate Data	2 years
Analyze Results	1 month
Total Time	2 years 2 months

Recommended Action

Based on results from the previous FY 2010-2011 Water Loss Audit and Component Analysis study, the amount of meter inaccuracies from large customer meter under-registration was estimated to be 1,118 AF. At the current cost of MWD Tier 1 Treated Water, LADWP's most expensive water source at \$923 per AF, this volume would amount to approximately \$1 million in loss of revenue. It is estimated that the large meter maintenance schedule overhaul that already occurred helps save 12% of this lost revenue.

It is recommended to pursue Action 1, analyze meter test results, as it will improve the data quality and validity score of the "Customer metering inaccuracies" entry on the AWWA water audit software. The estimated costs for Action 1 are minimal, and this action utilizes data that is already available.

Section 4: Leak Detection and Prevention

Leak Detection and Prevention refers to actions taken to try to prevent water losses from leaks (also known as “real losses”). These actions may include leak detection surveys, pressure management studies, and increased infrastructure improvements. Economic analyses are performed to determine the extent of leak detection and prevention measures that should be implemented in a cost-effective manner. LADWP is responsible for maintenance of all pipelines from the beginning of the distribution system up to the customer meter, including over 7,200 miles of mainline pipe.

Real losses are categorized as reported leaks, unreported leaks, and background leaks:

- *Reported Leaks* are defined by AWWA as: “leaks reported by customers, traffic authorities, or any other outside party because of their visible and/or disruptive nature.” Reported leaks tend to have high flow rates and relatively short durations because utilities like LADWP respond quickly to shut-off the leak and perform repairs.
- *Unreported Leaks* are defined by AWWA as: “leaks that escape public knowledge and are only identified through the active leakage control work of the utility.” Unreported leaks tend to have moderate flow rates and the run time depends on the intervention policy. Acoustic leak detection through leak survey is a commonly used method to search out unreported leaks.
- *Background Leaks* are defined by AWWA as: “leaks involving the tiny weeps and seeps at joints and fittings that defy detection through conventional acoustic means.” Background leaks tend to have small flow rates and are continuously running. Background leakage is generally unavoidable outside of prevention activities attributed to pressure management and infrastructure replacement.

Real losses are calculated from the water balance by subtracting the authorized consumption and apparent losses from the system input volume as shown in Figure 8. It is important that all of the values entered for the water balance are accurate in order to result in a confident calculation of real loss volume.

Water Supplied	Authorized Consumption	Billed Authorized Consumption	Billed Metered Consumption	Revenue Water
			Billed Unmetered Consumption	
		Unbilled Authorized Consumption	Unbilled Metered Consumption	Non-Revenue Water
			Unbilled Unmetered Consumption	
	Water Losses	Apparent Losses	Unauthorized Consumption	
			Customer Meter Inaccuracies	
			Data Handling Errors	
Real Losses				

Figure 8: Real Losses Identified in the Water Balance (Not to Scale)

The previous FY 2010-2011 Water Loss Audit and Component Analysis study evaluated economically efficient real loss reduction strategies, as shown in Figure 9.

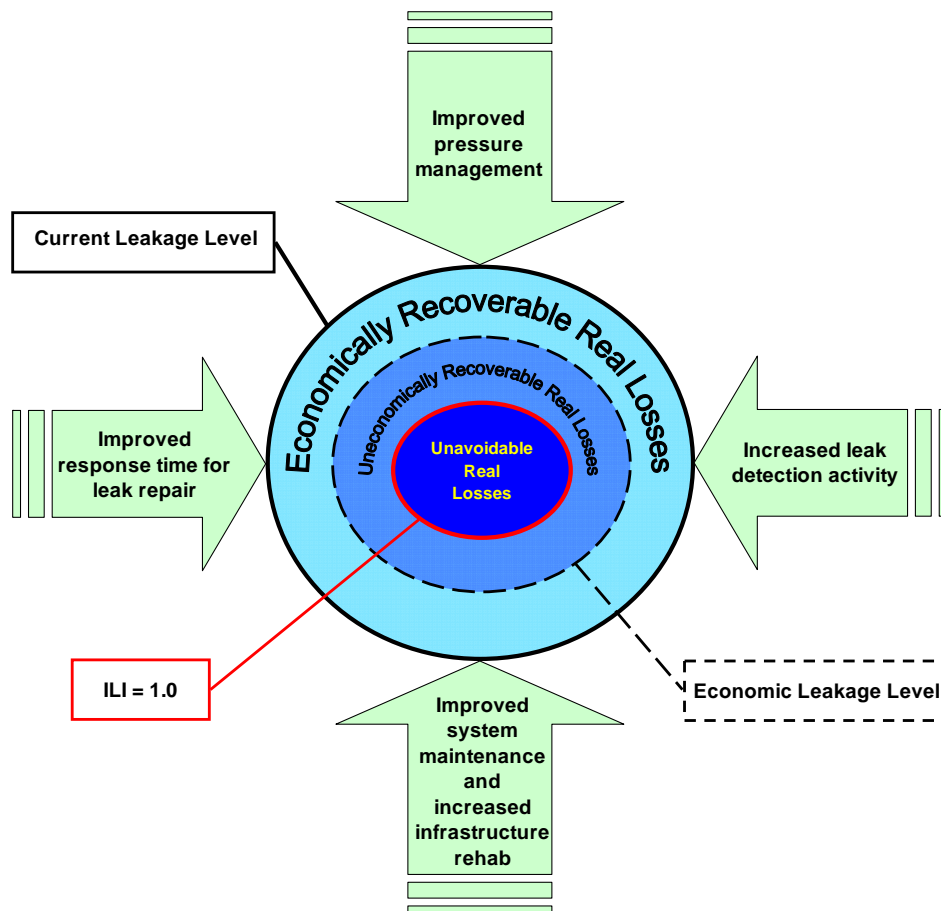


Figure 9: Four-Component Tool Box for Intervention against Real Losses

Three of the strategies – improved pressure management, improved response time for leak repair, and increased leak detection activity – are detailed and evaluated in Sections 4.1, 4.2, and 4.3 of this Action Plan based on recommendations from the previous FY 2010-2011 study. The fourth strategy – improved system maintenance and increased infrastructure rehabilitation – is not evaluated in this Action Plan as the previous study concluded there was no immediate need for LADWP to further increase the replacement of infrastructure strictly for a leakage management gain. This was due to the fact that LADWP has plans to increase its infrastructure replacement program, as well as the fact that LADWP has a relatively low level of leakage, an overall low break frequency for the system, and the fact that infrastructure replacement is the most expensive option/strategy for real loss reduction. Despite this and in light of the current drought, LADWP has further increased its plans for infrastructure replacement. However, it is estimated that LADWP will need an additional \$1.3 billion in funding to reduce its current pipe replacement cycle to improved levels outlined by LADWP’s infrastructure management goals.

Recommendation 4.1: *Pressure Management Improvement and Pilot Study*

Previous Study Conclusion

Pressure management is already partially being employed by LADWP through the use of hydraulic zones, known as “service zones”, within its distribution system where Pressure Reducing Valve (PRV) stations are operated. LADWP currently has 124 service zones and 423 PRVs in its distribution system. The current average system pressure is 90 psi, which indicates that there is room for improved pressure management.

Various improvements to current pressure management practices were investigated for their implementation cost and potential to reduce the average system pressure (and consequently reduce water loss). It was assumed that the reduction of average system pressure would be achieved through three steps, where each step builds upon the results of the previous step and reduces the average system pressure further through additional system upgrades and investments. The three steps should be implemented over an eight-year period.

Step 1: In 2011, LADWP operated a total of 124 service zones within its distribution network. Out of these 124 service zones, 65 service zones have average system pressures above 100 psi. These 65 service zones were selected for implementation of the three-step pressure management program described in this section (see Appendix V of the previous FY 2010-2011 Water Loss Audit and Component Analysis study for the list of prioritized 65 service zones).

Through a detailed assessment of current system pressure levels, pump operation, reservoir operation, pressure transients, PRV settings, validation of service zone boundary valves and replacement of valves where necessary, and an update of hydraulic models, this step will lay the ground work for the implementation of step 2 and 3. Step 1 will also include optimization of current PRV settings and operations. The first pressure reduction step will be achieved by implementing the following actions:

- System Pressure Study and high frequency pressure logging for detection of transients with 390 pressure logging sites throughout the 65 service zones
- Review and update the detailed inventory of all PRV's, tank level settings and controls, pumping regimes and boundary valves
- Validation of service zone boundary valves by identifying and sounding all boundary valves
- Replacement of boundary valves, assuming two per service zone
- Update hydraulic models with system pressure study
- LADWP general engineering and project management
- Adjustment of Current PRV settings and pumps and tank levels to optimum, where feasible

It was assumed that in each of the 65 service zones targeted for optimized pressure management the average pressure could be reduced by 4% by adjusting current PRV settings,

pump control and tank levels. Step 1 would result in a system wide average pressure reduction of 3 psi. This would reduce the total real loss volume by 204 MGY (or 626.05 AFY).

Step 2: Building upon the detailed assessment undertaken in Step 1, Step 2 reduces the system pressure further through the implementation of advanced flow modulated pressure control. The second pressure reduction step will be achieved by implementing the following actions:

- Replace existing lead PRVs with Cla-Val Model 98-06 (or similar) PRVs, which allow regulating pressure according to system demand. High pressure is provided when system demand is high and pressure is lowered when system demand is low. A high pressure set point is selected for high flow demand and a low pressure set point is selected for low flow demand. This dual set point arrangement allows for reduction in water loss by reducing system pressures during times of low demand, while still providing adequate pressure during high or fire demand. It was assumed that an average 3 PRV's per service zone (177 in total) would be replaced or retrofitted to be able to introduce demand based pressure control.
- Installation of new PRVs
- Pressure management engineering consultant for setting the PRVs, analyzing data and results, and managing the project
- LADWP general engineering and project management

Step 2 would achieve a reduction in system wide average pressure of 3 psi, plus the 3 psi of average system pressure reduction achieved in Step 1. In total, this would reduce the total real loss volume by 408 MGY (or 1,252.11 AFY).

Step 3: Building upon Steps 1 and 2, Step 3 will further reduce the system pressure by splitting zones 1134, 1123, 579, 1000, 1449, and 426 (service zones with more than 150 miles of distribution network) into subzones for better pressure control in those large zones. It was assumed that 15 new subzones would be created. Each of the new service zones will have an average of 3 PRV chambers controlling the pressure for each zone. The third pressure reduction step will be achieved by implementing the following actions:

- 90 PRV's of size 6 inch and 8 inch
- Installation of new PRVs
- Service zone PRV chambers – 45 in total
- Replacement of boundary valves and installation of new boundary valves – 150 in total
- Pressure management engineering consultant for setting the PRVs, analyzing data and results, and managing the project
- LADWP general engineering and project management
- Hydraulic Model for design of 15 zones
- Cost for distribution piping reconfiguration associated to creation of 15 new zones

Step 3 would achieve a reduction in system wide average pressure of 3 psi, plus the 6 psi of average system pressure reduction achieved in step 1 and 2. In total, this would reduce the total real loss volume by 544 MGY (1,669.47 AFY).

Current Status

Asset Management Group is currently assessing the correlation between high pressure and leaks. Available technologies are being assessed to compile data in determining effects of high pressure on leaks. Data collection is crucial in this study.

In general, trunk lines (pipes 24 inches or larger in diameter) are sized for a maximum head loss of 3 feet per 1000-foot of length. Distribution mains are sized for approximately 5 to 7 feet of head loss per 1000-foot length. This is to maximize the hydraulic grade and pressure as supply is delivered throughout the water system. A minimum pressure of 43 psi is required. Customer connections with less than 35 psi require a service elevation agreement. Customer service connections with greater than 80 psi require a pressure regulator.

Given the geography of the City of LA, service areas within service zones may have significant elevation differences. Areas with the highest elevations experience the lowest static pressures. Areas with the lowest elevations experience the highest static pressures. In addition, the areas with the lowest operational grades are typically the areas furthest from the trunk lines and furthest from the source of supply.

In the San Fernando Valley for example, the 1123-ft and 1134-ft service zones are gravity systems. The northernmost sections of the service zones where the elevations are high typically experience the minimum 43 psi pressure. As the elevation continues to slope down onto the Valley floor, pressures increase to over 80 psi and greater. The pipes for these areas are designed to handle the higher pressures. As elevations increase going into the Santa Monica Mountains, the pressures decrease back down to the minimum required pressure of 43 psi. As elevations increase further, the areas below 43 psi are moved over to the next service zone in a pump-tank system. Typically, for these service zones, the areas at the bottom of the hills are the ones experiencing the highest pressures.

Figure 10 is a static pressure map of LADWP's water system, which represents the maximum static pressure possible if a pipe existed. The maximum static pressure was calculated by taking the difference between the system zone and ground elevation (also taking into account that pipe usually is installed with a cover of 3 feet) and multiplying the difference by 0.433 to convert to pounds per square inch. Again, this map only represents what the maximum static pressure would be if a pipe existed. That's why you will still see a color for areas that do not have pipe in the ground.

Figure 11 shows the areas of the city with the highest leak densities. Background colors of this map represent the general leak density based on all leaks documented in GIS. These documented GIS leaks go back to roughly 1990, but the completeness is questionable. Basically, not all leaks were documented. The leak points (dots) shown on the map are from the year 2012. The reason this year was used was because it represents a fairly complete set of data and the leak density areas, shown with dark black borders, were based on these 2012 leak points.

Figure 12 shows the ground elevation based on the data received through the LARIAC program. Specifically it was taken from the 2006 aerial imagery which was at a 2' resolution.

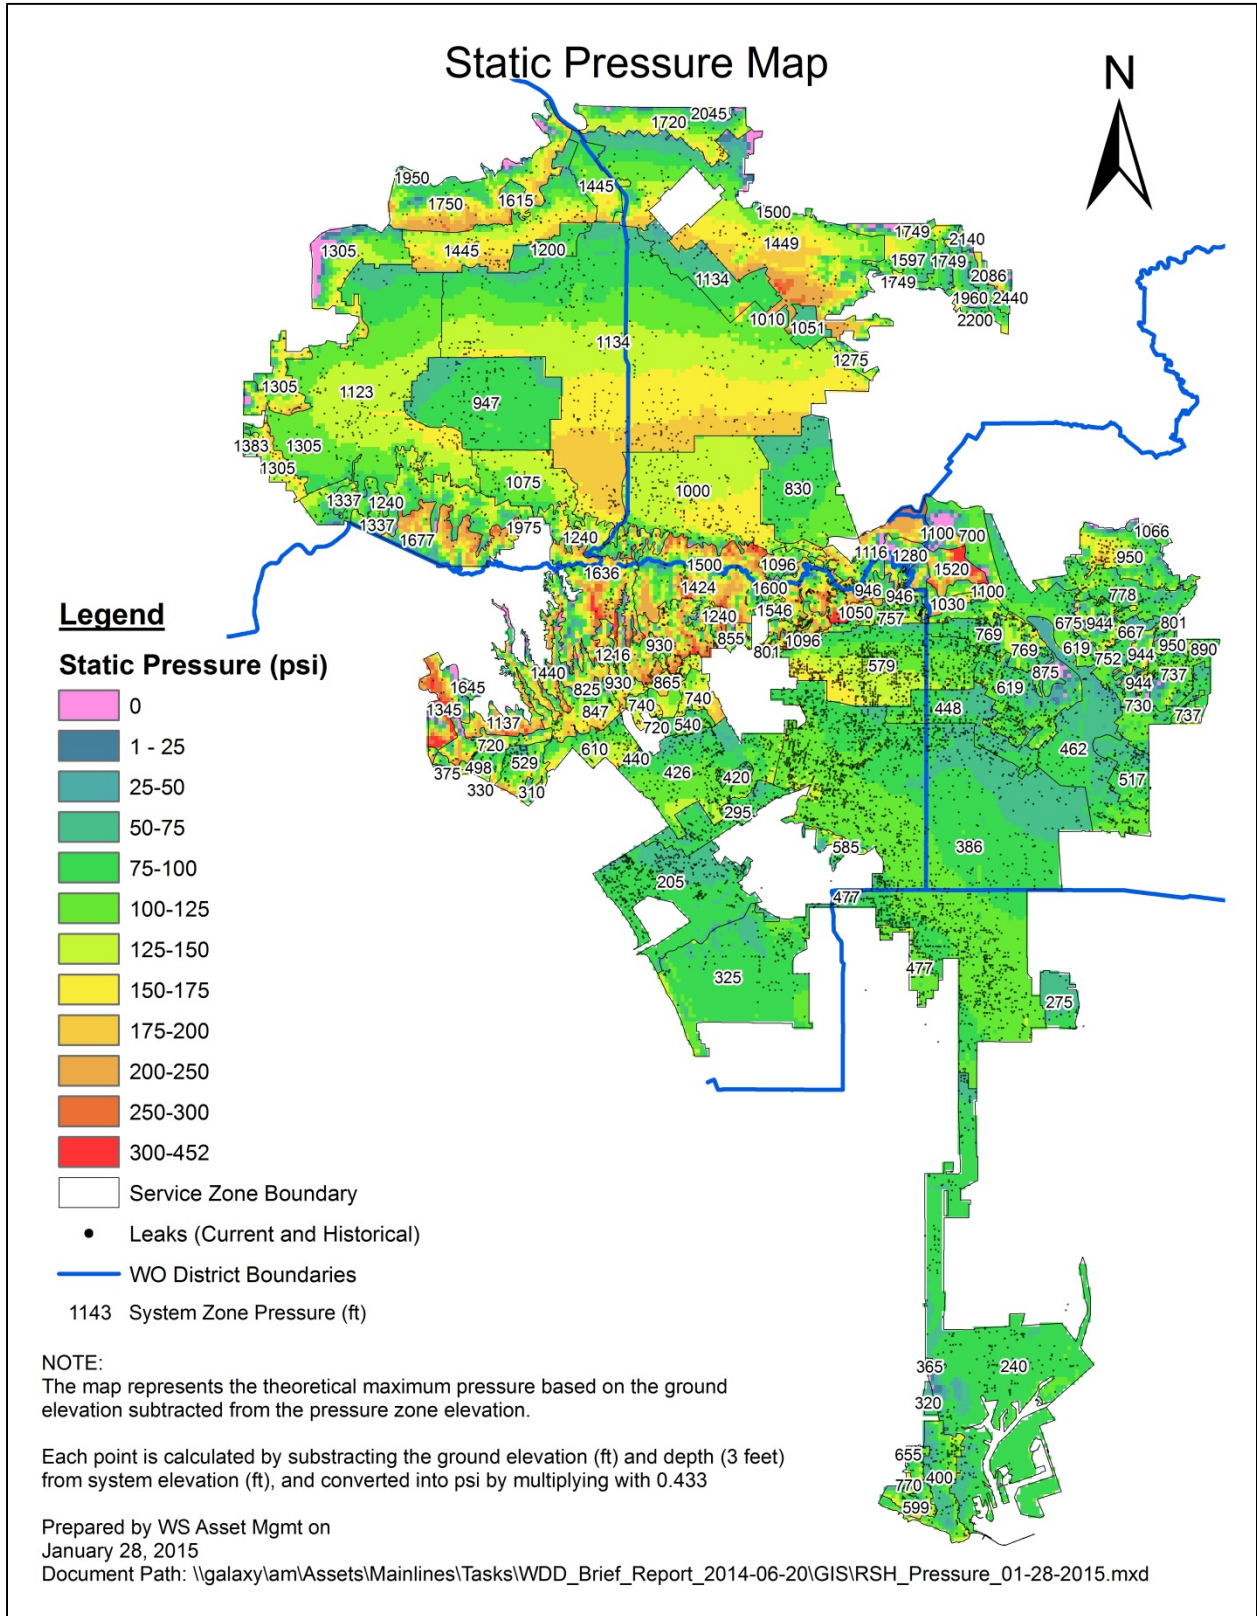


Figure 10: Static Pressure Map of LADWP's Water System

Leak Density Map

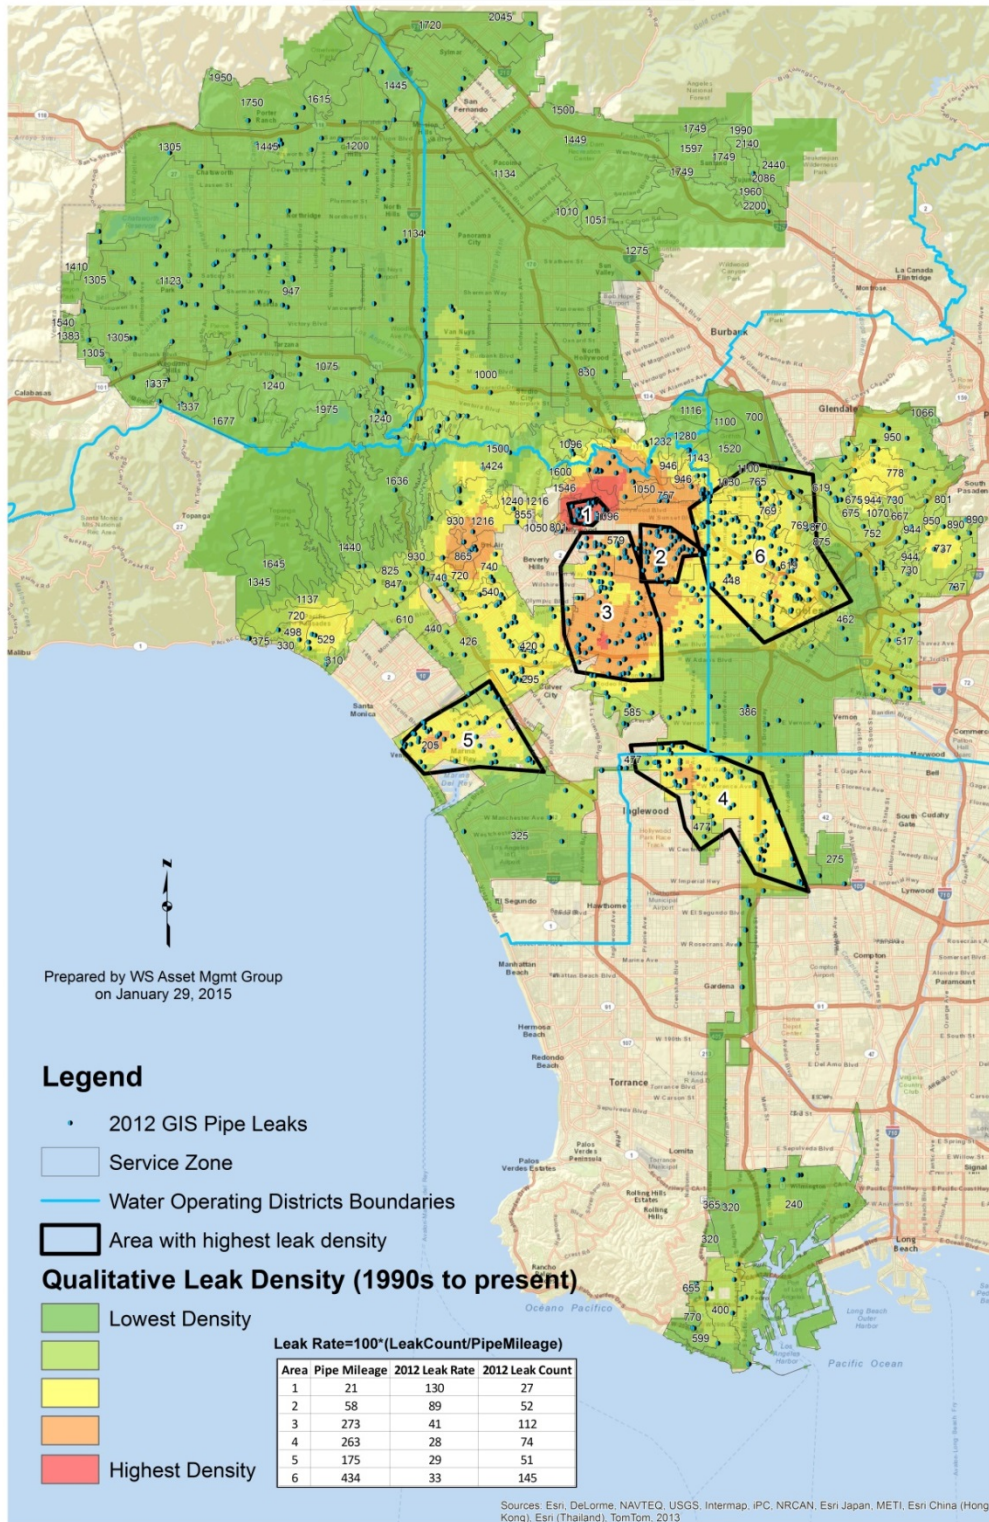


Figure 11: Leak Density Map of LADWP's Water System

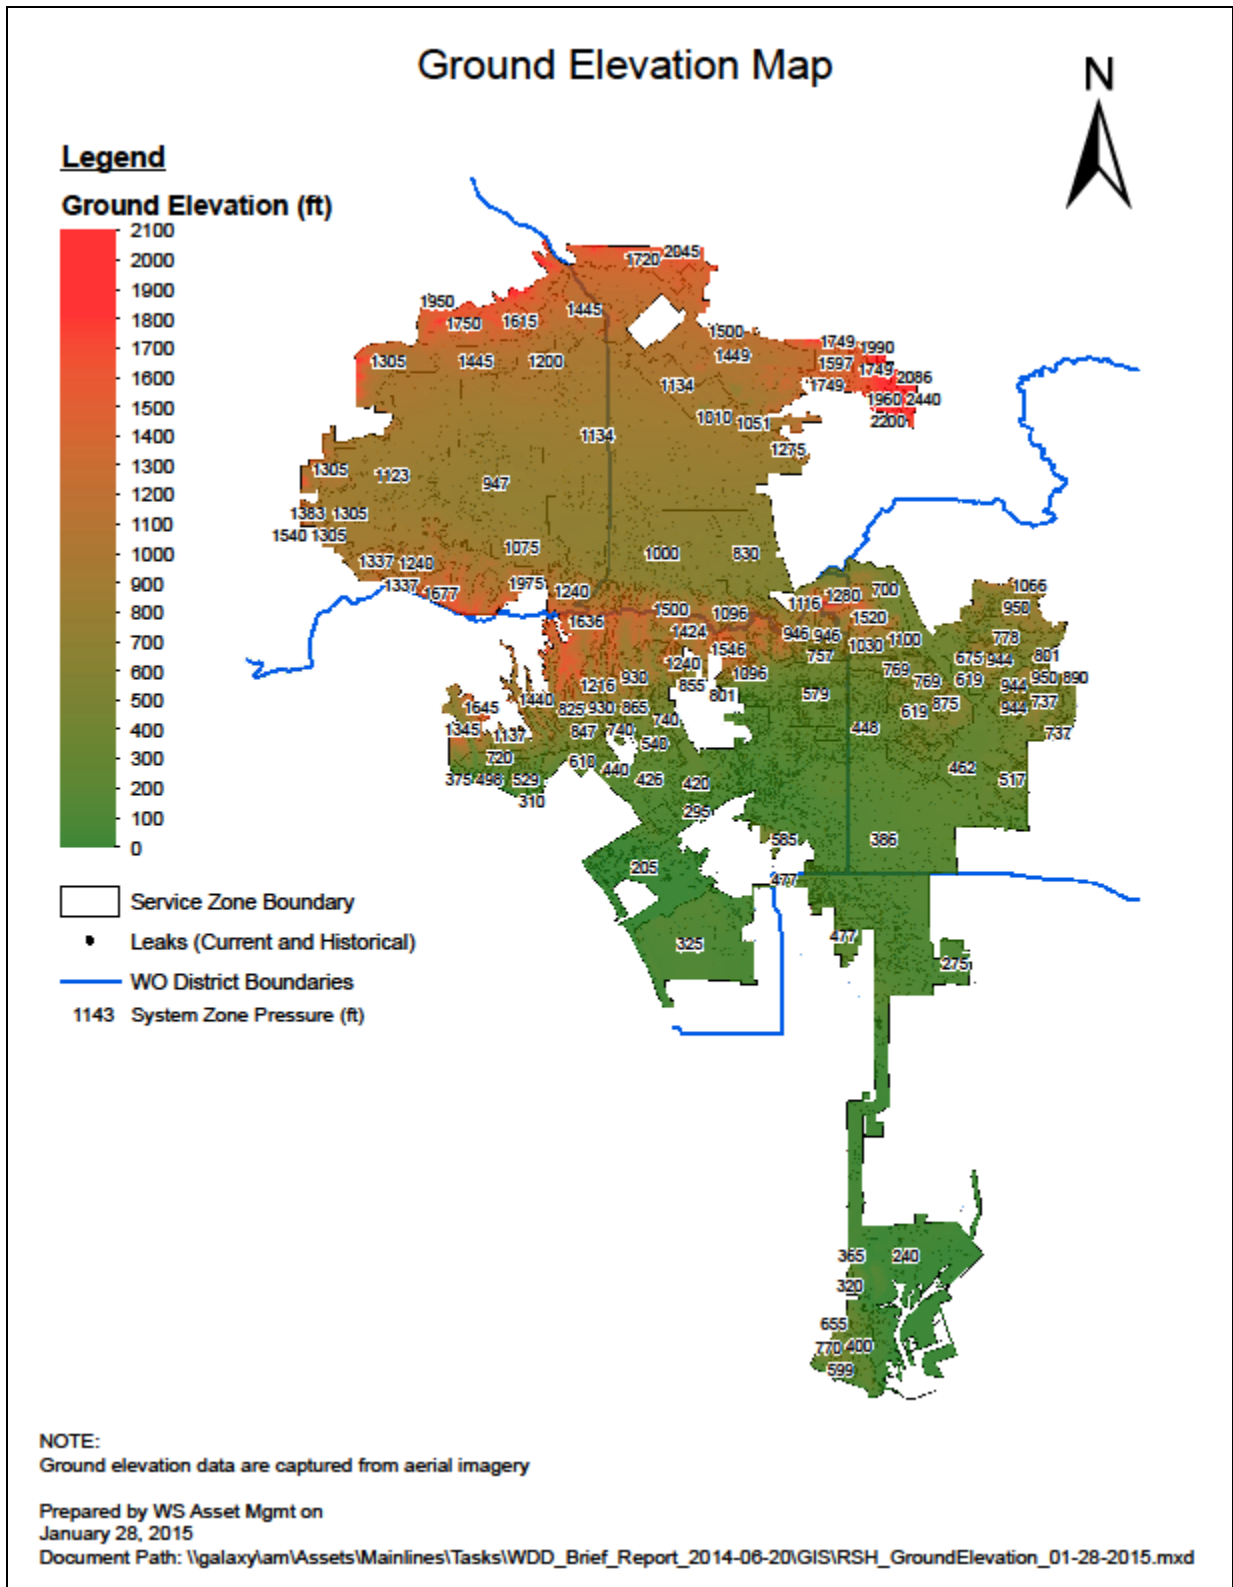


Figure 12: Ground Elevation Map of LADWP's Water System

List of Actions

No Action

Summary of Impact

Current service zone pressures are strategically set to provide for domestic as well as fire protection use. Reducing any pressures in any of the service zones will require extensive hydraulic system monitoring, modeling, and analysis to determine impacts to existing service requirement and adjacent service zones. Therefore a No Action Plan is a consideration.

Action 1: Site-Specific Pressure Monitoring in 13 Highest Leak Density Areas

Scope of Work

This action proposes to conduct further monitoring only in the 13 zones with highest leak densities. 20 pressure loggers will be installed at each service zone for one week during the high water demand period, typically in the summer. Water Operations Division (WOD) staff estimate a hydrographer can install 20 pressure loggers per day.

Once the data is retrieved, an engineer will analyze the pressure data and provide an analysis of trends. The engineer will identify any anomalies in the data, and with the help of a drafting technician and GIS data, determine if these anomalies warrant further study at specific infrastructure network locations.

Staffing Needs

A hydrographer will be needed for 2 months to install and remove pressure recorders, and extract data. One engineer will perform an analysis of the pressure data collected and trends. One drafting technician may be needed to provide GIS infrastructure data.

Equipment, Materials, Rentals, and Contract Needs

20 pressure loggers will be needed.

Estimated Costs

Table 51: Estimated Cost for Recommendation 4.1, Action 1

Staff/Item	Hours/Units	Cost
<i>Staffing</i>		
<i>Capital Costs – for 6 months</i>		
Hydrographer (1)	230 hours	\$12,000
Engineer (1)	700 hours	\$39,000
Drafting Technician (1)	200 hours	\$8,000
<i>Equipment, Materials, Rentals, Contracts</i>		
<i>Capital Costs</i>		
Pressure Loggers	20 units	\$4,000
Total Capital Costs (for 6 months)		\$63,000

WATER LOSS TASK FORCE

Estimated Time

Table 52: Estimated Time for Recommendation 4.1, Action 1

Task	Time
Procure and Install Pressure Loggers	2 months
Data Analysis	4 months
Total Time	6 months

Action 2: Site-Specific Pressure Monitoring in 13 Highest Leak Density Areas and 17 High Pressure Service Zones with Hydraulic Modeling

Scope of Work

This action proposes to conduct further monitoring in the 13 zones with highest leak densities and 17 zones with high pressure. 20 pressure loggers will be installed at each service zone for one week during the high water demand period, typically in the summer. Water Operations Division (WOD) staff estimate a hydrographer can install 20 pressure loggers per day.

Once the data is retrieved, engineers will analyze the data and make recommendations if pressure can be reduced or zones can be subdivided. This involves creating and or updating existing models, and analysis of all fire services and hydrants in the new zones for compliance. In order to perform this analysis, engineering staff may need to work with WDD Water New Business Group, CSD Account Services, ITS, and/or the Water Engineering and Technical Services (WETS) GIS Group to research and confirm the number and location of fire services in each zone. Furthermore, the water system data (including pipe infrastructure, elevations, grades, etc.) in WDD's hydraulic model may need to be updated with current GIS information from WETS GIS Group. Performing these updates and background research, as well as uploading the pressure data from the loggers and performing the analysis of each hydrant and individual fire service pressure (of which there could be hundreds or even thousands of services in each zone), could be time consuming. The complete data analysis and hydraulic modeling is estimated to take 3-6 months per service zone.

Staffing Needs

A hydrographer will be needed for 3 months to install and remove pressure recorders, and extract data. Two drafting technicians will be needed to layout pipe network using GIS data. Four engineers will perform hydraulic modeling. The time required to complete tasks depends on allocation of resources. The work will be spread over three years.

Equipment, Materials, Rentals, and Contract Needs

100 pressure loggers will be needed.

Estimated Costs

Table 53: Estimated Cost for Recommendation 4.1, Action 2

Staff/Item	Hours/Units	Cost
Staffing		
Capital Costs – for 3 years 2 months		
Hydrographers (1)	530 hours	\$27,000
Engineers (4)	25,000 hours	\$1,400,000
Drafting Technicians (2)	9,400 hours	\$366,000
Equipment, Materials, Rentals, Contracts		
Capital Costs		
Pressure Loggers	100 units	\$20,000
Total Capital Costs (for 3 years 2 months)		\$1,813,000

Estimated Time

Table 54: Estimated Time for Recommendation 4.1, Action 2

Task	Time
Procure and Install Pressure Loggers	2 months
Data Analysis	3 years
Total Time	3 years 2 months

Action 3: Site-Specific Pressure Monitoring in 65 Service Zones with Pressures Greater Than 100psi with Hydraulic Modeling

Scope of Work

This action involves a one-time pressure monitoring of the 65 service zones with pressures greater than 100psi to determine if pressure can be reduced or zones can be subdivided. 20 loggers will be installed per zone for one week during the summer when demand for water is high. Water Operations Division (WOD) staff estimate a hydrographer can install 20 pressure loggers per day. The scope of work for hydraulic modeling for the engineers is similar to the scope of work described in Action 2.

Staffing Needs

A hydrographer will be needed for 7 months to install and remove pressure recorders, and extract data. Two drafting technicians will be needed to layout pipe network using GIS data. Four engineers will perform hydraulic modeling. The work will be spread over six years.

Equipment, Materials, Rentals, and Contract Needs

100 pressure loggers will be needed.

WATER LOSS TASK FORCE

Estimated Costs

Table 55: Estimated Cost for Recommendation 4.1, Action 3

Staff/Item	Hours/Units	Cost
Staffing		
Capital Costs – for 6 years 7 months		
Hydrographer (1)	1,250 hours	\$55,000
Engineers (4)	56,000 hours	\$3,200,000
Drafting Technicians (2)	21,000 hours	\$800,000
Equipment, Materials, Rentals, Contracts		
Capital Costs		
Pressure Loggers	100 units	\$20,000
Total Capital Costs (for 6 years 7 months)		\$4,075,000

Estimated Time

Table 56: Estimated Time for Recommendation 4.1, Action 3

Task	Time
Procure and Install Pressure Loggers	7 months
Data Analysis	6 years
Total Time	6 years 7 months

Action 4: System-wide Pressure Monitoring on a One-Time Basis with Hydraulic Modeling

Scope of Work

This action involves a one-time system wide monitoring program to determine if pressure can be reduced or zones can be subdivided. There are 124 service zones. 20 pressure loggers will be installed per zone for one week during the high water demand period in the summer. Water Operations Division (WOD) staff estimate a hydrographer can install 20 pressure loggers per day. The scope of work for hydraulic modeling for the engineers is similar to the scope of work described in Action 2.

Staffing Needs

One hydrographer will be needed, as well as four engineers and two drafting technicians.

Equipment, Materials, Rentals, and Contract Needs

100 pressure loggers will be needed, along with 7 computer terminals and software.

Estimated Costs

Table 57: Estimated Cost for Recommendation 4.1, Action 4

Staff/Item	Hours/Units	Cost
Staffing		
Capital Costs – for 12 years 8 months		
Hydrographer (1)	2,100 hours	\$90,000
Engineers (4)	108,000 hours	\$6,240,000
Drafting Technicians (2)	42,000 hours	\$1,600,000
Equipment, Materials, Rentals, Contracts		
Capital Costs		
Pressure Loggers	100 units	\$20,000
Computers and Hydraulic Software	7 units	\$28,000
Total Capital Costs (for 12 years 8 months)		\$7,978,000

Estimated Time

Table 58: Estimated Time for Recommendation 4.1, Action 4

Task	Time
Procure and Install Pressure Loggers	8 months
Data Analysis	12 years
Total Time	12 years 8 months

Action 5: System-wide Pressure Monitoring on a Permanent Basis with Hydraulic Modeling

Scope of Work

This action is similar to Action 3 except 6 of the 20 pressure recorders in each of the 124 zones will be permanent recorders for future monitoring of pressure. Additional costs are design and installation of the permanent recorders. Permanent recorders will be installed in critical areas where pressure has been known to be inconsistent, too low or too high so that operational adjustments can be made. In addition, the permanent pressure recorder will provide pressure data continuously throughout the year which can be used to more precisely calibrate hydraulic models.

Water Operations Division (WOD) staff estimate a hydrographer can install 20 pressure loggers per day. The scope of work for hydraulic modeling for the engineers is similar to the scope of work described in Action 2.

Staffing Needs

Hydrographers will be needed, as well as engineering and drafting staff. In addition, maintenance and construction (M&C) helpers, senior water utility workers, equipment operators, and truck operators will be needed.

WATER LOSS TASK FORCE

Equipment, Materials, Rentals, and Contract Needs

100 temporary pressure loggers and 744 permanent pressure loggers will be needed, as well as 7 computer terminals and software, and other construction equipment as specified in the cost table.

Estimated Costs

Table 59: Estimated Cost for Recommendation 4.1, Action 5

Staff/Item	Hours/Units	Cost
Staffing		
Capital Costs – for 24 years 8 months		
Hydrographer (1)	2,500 hours	\$109,000
Engineers (4)	116,500 hours	\$6,700,000
Drafting Technicians (2)	42,000 hours	\$1,600,000
Water Utility Worker (2)	50,000 hours	\$1,875,000
M&C Helper (2)	50,000 hours	\$1,600,000
Sr. Water Utility Worker (2)	50,000 hours	\$2,150,000
Equipment Operator (2)	6,000 hours	\$264,000
Truck Driver (2)	6,000 hours	\$174,000
Cement Finisher (2)	12,000 hours	\$408,000
Waterworks Mechanic (1)	12,000 hours	\$558,000
Electrical Mechanic (1)	12,000 hours	\$572,000
Electrician (1)	12,000 hours	\$546,000
Equipment, Materials, Rentals, Contracts		
Capital Costs		
Pressure Loggers (temporary)	100 units	\$20,000
Pressure Loggers (permanent)	744 units	\$26,040,000
Computers and Hydraulic Software	7 units	\$28,000
Dump Truck	2 units	\$65,000
Backhoe	2 units	\$270,000
Material Contract	1 unit	\$237,000
Total Capital Costs (for 24 years 8 months)		\$43,216,000

Estimated Time

Table 60: Estimated Time for Recommendation 4.1, Action 5

Task	Time
Procure and Install Pressure Loggers	8 months
Data Analysis	12 years
Install Permanent Pressure Recorder	12 years
Total Time	24 years 8 months

Recommended Action

Based on results from the previous FY 2010-2011 Water Loss Audit and Component Analysis study, the amount of background leakage and hidden losses were estimated to be 14,455 AF. At the current cost of MWD Tier 1 Treated Water, LADWP's most expensive water source at \$923 per AF, this leakage would amount to more \$13 million in loss of revenue. It is estimated that if LADWP is able to pursue all Steps 1, 2, & 3 as outlined in the previous study conclusion, LADWP could save up to 25% of this lost revenue.

Because pressure management activities can help reduce background leakage and hidden loss, it is recommended to pursue Action 1. This option fulfills the Step 1 requirement as outlined in the previous study conclusion and will enable staff to study pressure data and trends in zones with the highest leak density. This option requires minimal resources, time, and the least estimated cost of the four Actions being proposed. Action 1 will also improve the data quality and validity score of the "Average operating pressure" entry on the AWWA water audit software.

Should LADWP implement pressure monitoring on a wide-scale, the next step in pressure management would be to investigate the possibility of reducing pressure in specific system zones by 3 psi. This should be accomplished without impacting system integrity by performing the following tasks:

1. System pressure study, review inventory of valves, PRVs, pumps, tanks settings etc.
2. Verify items in 1. are in working and at proper setting. Replace as necessary.
3. Update and analyze hydraulic models
4. Adjust system facility or appurtenance to reduce pressure

Furthermore, after investigating reducing pressure by 3 psi, LADWP could look into the possibility of splitting service zones into two or more zones. This would apply for larger service zones that have higher pressures or otherwise a large variability in pressures across the zone. In order to consider splitting a large service zone, a hydraulic study and modeling would need to be performed to determine feasibility of splitting high service zones into smaller, lower service zones. In addition, distribution mains, trunk lines, and regulator stations would need to be installed.

Recommendation 4.2: *Leak Location and Repair Time Reduction*

Previous Study Conclusion

As shown in Table 61 the total volume of real losses caused by 1,225 main leaks with an average repair time of 5 days was 950 MGY (or 2,915.44 AFY) for FY 2010-2011. Reducing the average location and repair time to 2.5 days, would save about 472 MGY (or 1,448.61 AFY). However, timestamps representing time of leak shutoff and repair appear to often be reported incorrectly as the time the staff person completed the job and entered the data in the office, rather than the actual time of shutoff and repair in the field. This has skewed the results of the data to show the time of response for leak repair to be greater than actual response times. The assumed reduction of average location and repair time by 50% was used to get an initial idea of the potential savings that could be achieved and do not represent industry standards or an actual recommendation since the currently available leak repair data needs to

WATER LOSS TASK FORCE

be substantially improved in terms of data quality/availability to be able to make recommendations on a target location and repair time for mains failures.

Table 61: Summary of Economic Analysis of Improved Location and Repair Times for Main Line Failures

Reported and Unreported Failure Events		
<i>Failures on Mains</i>	<i>Reported</i>	
Total Number of Failures on Mains in FY10/11	1,225	
Average location and repair duration	5.0	days
Total Volume lost (stemming from location and repair duration)	950.3	(MG)
Total Cost of Volume lost (stemming from location and repair duration)	\$ 2,470,145	
What IF Location and Repair Duration is Reduced to	2.5	days
Percent Reduction	50%	
Potential Related Savings in Leakage Volume	472.2	(MG)
Potential Related Savings in Leakage Volume Cost	\$ 1,227,425	

Using the currently available leak repair data, this analysis indicates that a reduction in average location and repair time could represent a cost effective option for reducing real losses in LADWP's distribution network. Once better leak repair data is available, LADWP should update this analysis and evaluate the necessary additional budget for reducing the average location and repair time for reported mains leaks.

As shown in Table 62 the total volume of real losses caused by 4,038 service line failures and meter leaks with average repair times of 12 days was 264 MGY (or 810.19 AFY) for FY 2010-2011. Reducing the average location and repair time to 5 days, would save about 157 MGY (or 481.82 AFY). This indicates significant potential for real loss and cost savings. The assumed reduction of average location and repair time by 60% was used to get an initial idea of the potential savings that could be achieved and do not represent industry standards or an actual recommendation since the currently available leak repair data needs to be substantially improved in terms of data quality/availability to be able to make recommendations on a target location and repair time for service line failures.

Table 62: Summary of Economic Analysis of Improved Location and Repair Times for Service Lines Failure and Meter Leaks

<i>Service Line Failures and Meter Leaks</i>	<i>Reported</i>	
Total Number of Failures on Service Connections and Meter Leaks in FY10/11	4,038	
Average location and repair duration	12.4	days
Total Volume lost (stemming from location and repair duration)	263.7	(MG)
Total Cost of Volume lost (stemming from location and repair duration)	\$ 685,400	
What IF Location and Repair Duration is Reduced to	5	days
Percent Reduction	60%	
Potential Related Savings in Leakage Volume	157.4	(MG)
Potential Related Savings in Leakage Volume Cost	\$ 409,029	

Using the currently available leak repair data it would indicate that a reduction in average location and repair time for service connection and meter leaks could represent a cost effective option for reducing real losses in LADWP's distribution network. Once better leak repair data is available, LADWP should update this analysis and evaluate the necessary additional budget for reducing the average location and repair time for service connection and meter leaks.

Current Status

All leaks in the street require an underground service alert (USA) be performed per State law, which takes a minimum of 2 days. (Leaks behind the curb can be repaired without a USA because they are usually very shallow and excavated by hand tools.) During this 2 day time, no leak repair construction work can be undertaken until the USA is completed. LADWP can thereafter repair most leaks within 1 day. Therefore, with two days of USA and one day of construction, the minimum time possible to complete location and repair of a leak is 3 days, with the exception of leaks classified an emergency that need to be shutoff and repaired right away.

Additionally, more leaks tend to occur during the winter season. In order to reduce leak repair times, LADWP would require extra staff during the winter or more staff year-round. It would be a challenge to meet staffing needs only for half-year periods. Current staff have been working overtime during the winter season to address this issue.

Figure 13 shows the average leaks per day for each month from November 2010 to January 2014. Highlighted in red are December and January, which traditionally have the highest leak rates. One of the factors that causes this variance is the difference in temperature between the water inside the pipe, and the soil outside the pipe, causing more breaks.

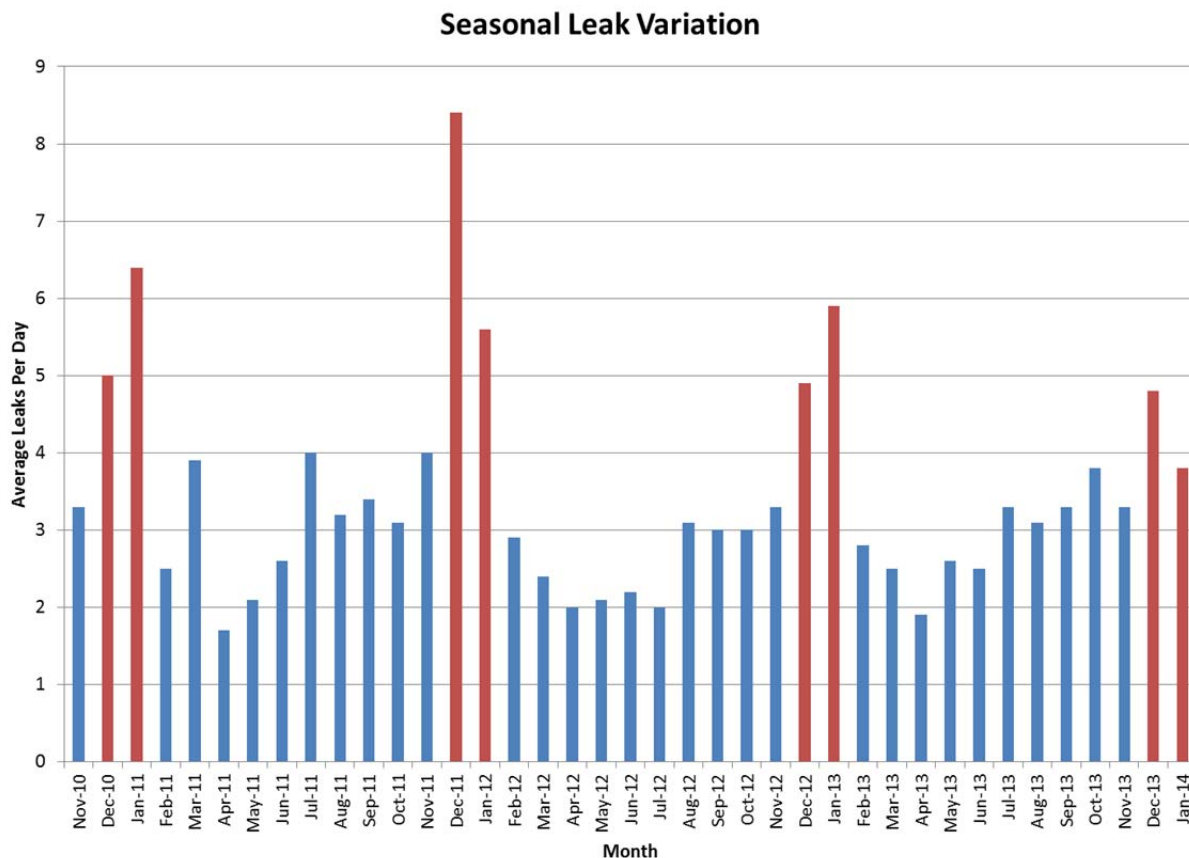


Figure 13: Seasonal Variation of Leaks in LADWP’s Water System

The new e-Respond project will convert the current leak datasets, housed in several different databases, into one, easy to use leak information system. The project is in progress. e-Respond, along with staff training, will also help to address inconsistencies in how LADWP staff fill out timestamps for leak location and repair times, with a goal of providing a more accurate picture of water volumes lost due to leaks.

Additionally, WDD Meter and Service Section has recently hired six new full-time employees. These employees have assisted in addressing and repairing meter leaks. Due to the increased number of staff dedicated to meter leak repairs, the response time for meter leak repairs has already decreased to an average of approximately five days. Furthermore, WDD has an ongoing large valve replacement program that will help crews shut off leaks in a more efficient manner.

List of Actions

No Action

Summary of Impact

LADWP will continue to respond to leak reports and perform repairs at about the same time as is performed currently. There will be no improvement to response time for leak location and repair.

Action 1: Add Internal Staff to Decrease Leak Response Times

Scope of Work

Add two LADWP leak crews for the off-hour shifts (PM and AM shifts) for all five districts to assist the leak sections in the districts. This will help decrease the leak response time for all types of leaks. These additional staff could also assist with other work to help reduce leaks during non-peak seasons, such as helping with leak survey and anode installations to decrease pipe corrosion.

Staffing Needs

2 Sr. Water Utility Workers would be needed to pair up with 2 Water Utility Workers. These personnel would form 2 two-man leak repair crews.

Equipment, Materials, Rentals, and Contract Needs

2 Maintenance and Construction Trucks would be needed along with 2 two axle Dump Trucks and 2 Tow Compressors.

Estimated Costs

Table 63: Estimated Cost for Recommendation 4.2, Action 1

Staff/Item	Hours/Units	Cost
<i>Staffing</i>		
Operations & Maintenance Costs – per year		
Sr. Water Utility Worker (2)	2,080 hours	\$92,000
Water Utility Worker (2)	2,080 hours	\$80,000
<i>Equipment, Materials, Rentals, Contracts</i>		
Capital Costs		
Maintenance and Construction Truck (2)	2,080 hours	\$41,000
2 Axle Dump Truck (2)	2,080 hours	\$27,000
Tow Compressor (2)	2,080 hours	\$4,000
Total Capital Costs (equipment only)		\$72,000
Total Operations & Maintenance Costs (per year)		\$172,000

Estimated Time

Table 64: Estimated Time for Recommendation 4.2, Action 1

Task	Time
Hiring	15 months
Vehicle and Equipment Procurement	3 months
Leak Repair and Other Support Work	Ongoing
Total Time	18 months + ongoing

Action 2: Hire a Contractor to Help Fix Leaks and Decrease Response Times During the Winter Months

Scope of Work

Hire a contractor that could have up to 2 crews available, on 48 hours’ notice, to repair small main and service leaks.

Staffing Needs

One Sr. Water Utility Workers would be needed to inspect the contractors work.

Equipment, Materials, Rentals, and Contract Needs

One Pickup Truck would be needed.

WATER LOSS TASK FORCE

Estimated Costs

Table 65: Estimated Cost for Recommendation 4.2, Action 2

Staff/Item	Hours/Units	Cost
<i>Staffing</i>		
Operations & Maintenance Costs – per year		
Sr. Water Utility Worker (1)	1,040 hours	\$46,000
<i>Equipment, Materials, Rentals, Contracts</i>		
Operations & Maintenance Costs – per year		
Leak Repair Crew Contract	1 unit	\$700,000
Pickup Truck Rentals (1)	1,040 hours	\$6,000
Total Operations & Maintenance Costs (per year)		\$752,000

Estimated Time

Table 66: Estimated Time for Recommendation 4.2, Action 2

Task	Time
Procuring Contract	18 months
Vehicle Procurement	3 months
Leak Repair Work	Ongoing
Total Time	18 months + ongoing

Recommended Action

Based on results from the previous FY 2010-2011 Water Loss Audit and Component Analysis study, the amount of reported leakage was estimated to be 4,326 AF. At the current cost of MWD Tier 1 Treated Water, LADWP's most expensive water source at \$923 per AF, this leakage would amount to almost \$4 million in loss of revenue. However, due to the data quality issues with the timestamps used to estimate the reported leakage, that volume and subsequent loss in revenue is likely over-estimated. Furthermore, pursuing either Actions 1 or 2 will not eliminate the entire lost revenue, but could reduce the losses by an estimate of up to 25% if the run time of the leaks in the winter months is reduced by almost half.

Therefore, it is recommended to first re-evaluate average response times to leak repairs based on improved data that will be received through the e-Respond system, as described in Recommendation 2.4. Proactively, however, it is also recommended to consider pursuing Action 1 as this provides multiple benefits in meeting the goal of reducing leaks through lower response times and also through leak survey assistance and additional anode installations.

Recommendation 4.3: *Active Leak Detection*

Previous Study Conclusion

Analyses indicate that given the relatively high monetary value of real losses, it is economically beneficial to LADWP to periodically survey the distribution network for unreported leaks. Considering this, the FY2010-11 Water Loss Audit and Component Analysis Study recommended that LADWP targets surveying about 10% to 15% of the distribution network per year for the next five years using in-house resources and carefully documenting the results and findings to inform LADWP's future proactive leak detection strategy. Since LADWP is considering trials of Advanced Metering Infrastructure (AMI), the Study recommended that for the service zones with AMI a water loss mass balance is calculated on a regular basis to identify service zones with higher levels of leakage that should be targeted for proactive leak detection. The three service zones used for the District Metered Analysis in the previous Water Loss Audit and Component Analysis study should be considered as candidates for trial AMI installations.

Current Status

LADWP has participated in several pilot studies in recent years to evaluate the performance and accuracy of the leak detection technology available in the industry. In addition, Water Distribution Division (WDD) and Asset Management Group (AMG) are engaging and meeting with several firms to learn about the available products, methods of leak detection, performance and reliability. This effort is on-going as the technology is evolving and improving. The following list summarizes some of the different technologies WDD and AMG have been evaluating:

- Leak Detection Acoustic Sensors
- Hydraulic & Leak Modeling and Data Management
- Pipe Assessment and Rehabilitation
- Broadband Electromagnetic Technology
- Pressure Transient Detection and Reporting
- Pressure and Flow Monitoring

Pilot studies on these technologies are in the planning stages and proceeding timely. AMG and WDD are collaborating and sharing resources to determine the most optimal locations for these pilot studies, targeting the most vulnerable areas in the City. The results of these pilot studies will help LADWP identify and select the appropriate products for permanent implementation.

List of Actions

No Action

Summary of Impact

For a No Action option, the amount of unreported leakage remains unchanged and no water savings are realized through proactive leak management. By not installing an active leak detection system, volume of unreported leakage would continue to accumulate in the system. This action would not improve the

WATER LOSS TASK FORCE

system's efficiency and would not be a cost savings to the ratepayers. LADWP has initiated several pilot studies for leak detection devices and will continue to plan partial implementation.

Action 1: Deploy Acoustic Leak Detection Crews to Survey 10% of the Entire System Per Year

Scope of Work

LADWP personnel would survey at least 10% of the system's mainline every year, which represents approximately 720 miles. It is estimated that one leak detection crew could survey approximately 10% of the system's mainlines, including services, in a year.

Staffing Needs

A leak detection crew would consist of 1 Senior Water Utility Worker and 1 Water Utility Worker.

Equipment, Materials, Rentals, and Contract Needs

1 Pickup truck is needed, as well as leak detection equipment.

Estimated Costs

Table 67: Estimated Cost for Recommendation 4.3, Action 1

Staff/Item	Hours/Units	Cost
<i>Staffing</i>		
Operations & Maintenance Costs – per year		
Sr. Water Utility Worker (1)	2,080 hours	\$92,000
Water Utility Worker (1)	2,080 hours	\$80,000
<i>Equipment, Materials, Rentals, Contracts</i>		
Operations & Maintenance Costs – per year		
Pickup Truck Rental (1)	2,080 hours	\$11,000
Capital Costs		
Leak Detection Equipment	1 unit	\$3,000
Total Capital Costs (equipment only)		\$3,000
Total Operations & Maintenance Costs (per year)		\$183,000

Staffing costs could be eliminated if staff are hired under Recommendation 4.2, Action 1 that can help perform leak survey in addition to assisting with leak repair work.

Estimated Time

Table 68: Estimated Time for Recommendation 4.3, Action 1

Task	Time
Hiring (if needed)	15 months
Vehicle and Equipment Procurement	3 months
Leak Survey	Ongoing
Total Time	18 months + ongoing

Action 2: Deploy Acoustic Leak Detection Crews to Survey Specific System Zones with Highest Leak Densities and/or Critical Areas

Scope of Work

The six highest leak rate areas identified in Figure 11 total 1,224 miles of piping, which is a little less than 17% of the total system mainline. Surveying all six areas annually would require the services of 2 leak detection crews. These crews could supplement leak repair crews when they were not actively surveying mainline.

Staffing Needs

Two leak detection crews are needed, consisting of one Sr. Water Utility Worker and one Water Utility Worker each.

Equipment, Materials, Rentals, and Contract Needs

Two Pickup trucks are needed, as well as leak detection equipment.

Estimated Costs

Table 69: Estimated Cost for Recommendation 4.3, Action 2

Staff/Item	Hours/Units	Cost
<i>Staffing</i>		
Operations & Maintenance Costs – per year		
Sr. Water Utility Worker (2)	3,640 hours	\$160,000
Water Utility Workers (2)	3,640 hours	\$141,000
<i>Equipment, Materials, Rentals, Contracts</i>		
Operations & Maintenance Costs – per year		
Pickup Truck Rentals (2)	3,640 hours	\$20,000
Capital Costs		
Leak Detection Equipment	2 units	\$6,000
Total Capital Costs (equipment only)		\$6,000
Total Operations & Maintenance Costs (per year)		\$321,000

Staffing costs could be eliminated if staff are hired under Recommendation 4.2, Action 1 that can help perform leak survey in addition to assisting with leak repair work.

Estimated Time

Table 70: Estimated Time for Recommendation 4.3, Action 2

Task	Time
Hiring (if needed)	15 months
Vehicle and Equipment Procurement	3 months
Leak Survey	Ongoing
Total Time	18 months + ongoing

Action 3: Install Acoustic Leak Monitoring Sensors in Areas with Highest Leak Densities

Scope of Work

The leak data that LADWP has been collecting are available on GIS and can be graphed for analysis. Several geographical areas with the highest leak densities have been identified in the Central, Western and Harbor districts. Piping in these areas was installed prior to 1940 and these are among the oldest pipes in the City. Some of these areas also have the highest concentrations of the oldest pipes in service and, hence, are more prone to leakage.

LADWP is evaluating several leak detection products to perform pilot projects and determine its performance. An acoustic leak monitoring system will be selected and installed in the high leak areas, starting with the highest leak locations. Currently, there are leak detection devices under evaluation that can be installed on the piping system without interrupting the pipe operation. Each acoustical logger has a maximum range of 750 feet in each direction or 1,500 feet apart.

The two highest leak rate areas are identified in Figure 11 with 21 miles and 58 miles of piping, or about 1% of the total mainlines in the system. Based on this piping mileage with 1,300-foot spacing for the loggers, approximately 90 devices will be required to cover a 21-mile pipe length and 240 devices for a 58-mile coverage.

Staffing Needs

One engineering associate will be needed to monitor the devices, collect data, and perform evaluations. An additional two-person crew is needed to install the leak detection devices.

Equipment, Materials, Rentals, and Contract Needs

330 acoustical logger devices and required telemetry for data transmission and evaluation are needed, including the Cloud data access and device status monitoring.

A contract agreement is needed with the vendor to rent or purchase the devices, to maintain or replace the power supply package, and to have a service agreement for the data access and monitoring for two-year period.

Estimated Costs

Table 71: Estimated Cost for Recommendation 4.3, Action 3

Staff/Item	Hours/Units	Cost
Staffing		
Capital Costs – for 2 years 10 months		
Engineering Associate (1)	3,360 hours	\$259,000
Crew Member (2)	840 hours	\$50,000
Equipment, Materials, Rentals, Contracts		
Capital Costs		
Acoustical logger devices	330 units	\$776,000
Telemetry (collectors, repeaters)	7 units	\$56,000
Service Agreement – Cloud access	1 unit	\$2,000
Total Capital Costs (for 2 years 10 months)		\$1,143,000

Estimated Time

Table 72: Estimated Time for Recommendation 4.3, Action 3

Task	Time
Procure and Install Loggers	9 months
Install Telemetry	1 month
Cloud Monitoring and Data Analysis	2 years
Total Time	2 years 10 months

Action 4: Install Acoustic Leak Monitoring Sensors System-wide

Scope of Work

This action is an extension of Action 3 and is applied to the entire water system pipeline network. The current system has over 7,200 miles of piping which includes over 6,700 miles of mainlines (20-inch diameter and less) and over 500 miles of trunk lines (more than 20-inch diameter). Based on this mileage length of piping, which is over 38 million feet of piping, approximately 26,000 logging devices are required.

Staffing Needs

Five engineering associates will be needed to monitor the devices, collect data, and perform evaluations. Five additional two-person crews are needed to install the leak detection devices.

Equipment, Materials, Rentals, and Contract Needs

26,000 acoustical logger devices and required telemetry for data transmission and evaluation are needed, including the Cloud data access and device status monitoring.

A contract agreement is needed with the vendor to rent or purchase the devices, to maintain or replace the power supply package, and to have a service agreement for the data access and monitoring for a two-year period.

WATER LOSS TASK FORCE

Estimated Costs

Table 73: Estimated Cost for Recommendation 4.3, Action 4

Staff/Item	Hours/Units	Cost
Staffing		
Capital Costs – for 4 years		
Engineering Associate (5)	16,800 hours	\$1,294,000
Crew Member (10)	11,200 hours	\$672,000
Equipment, Materials, Rentals, Contracts		
Capital Costs		
Acoustical logger devices	26,000 units	\$28,080,000
Telemetry (collectors, repeaters)	260 units	\$1,300,000
Service Agreement – Cloud access	1 unit	\$24,000
Total Capital Costs (for 4 years)		\$31,370,000

Estimated Time

Table 74: Estimated Time for Recommendation 4.3, Action 4

Task	Time
Procure Loggers	1 year
Install Loggers and Telemetry	1 year
Cloud Monitoring and Data Analysis	2 years
Total Time	4 years

Recommended Action

Based on results from the previous FY 2010-2011 Water Loss Audit and Component Analysis study, the amount of hidden losses were estimated to be 2,434 AF. At the current cost of MWD Tier 1 Treated Water, LADWP's most expensive water source at \$923 per AF, this leakage would amount to over \$2 million in loss of revenue. It is estimated that Actions 1 and 3 can help recover 11% of this lost revenue.

Action 1 will allow LADWP to perform annual leak surveying of 10% of the distribution system. This will provide more information about hidden losses on a system-wide basis. Action 3 will allow LADWP to collect more information on potential hidden losses on an automated basis in the areas which have shown the highest number of reported leaks in recent years. The cost of Action 3 is roughly equivalent to the cost of Action 2 on an annual basis. While Action 2 will cover more mileage, Action 3 will provide monitoring on a continuous, real-time basis, which would be of greater benefit to the areas showing the highest levels of reported leakage. Therefore, it is recommended to pursue Actions 1 and 3.

In addition to the recommended actions, LADWP should consider composing a group responsible for evaluating new leak detection technologies. This would include following the market for new products, understanding the analysis and functions, the limitations, and most effective applications. When technologies are determined to be worth testing, pilot projects and demonstration can be done to determine practical application and cost for implementation.

Section 5: Unmetered and Unauthorized Consumption

Unmetered Authorized Consumption refers to authorized consumption that is not metered. Unmetered consumption that is not billed includes fire fighting and system flushing, among other uses. These uses are also referred to as “unbilled unmetered authorized consumption”. LADWP does not have any authorized consumption that is billed and not metered. Unbilled unmetered authorized consumption is not currently tracked at LADWP, and therefore, these volumes are not known. 0.125% of system input volume was used as the estimate of unbilled unmetered authorized consumption in the water balance calculation.

Unauthorized Consumption refers to water usage that is not billed, not metered, and not authorized by LADWP. Essentially, unauthorized consumption amounts to theft. As unauthorized consumption volumes in LADWP are difficult to track, 0.25% of system input volume was used as the estimate of unauthorized consumption in the water balance calculation.

Figure 14 shows the roles of the unbilled unmetered authorized consumption and unauthorized consumption in the water balance.

Water Supplied	Authorized Consumption	Billed Authorized Consumption	Billed Metered Consumption	Revenue Water
			Billed Unmetered Consumption	
		Unbilled Authorized Consumption	Unbilled Metered Consumption	Non-Revenue Water
			Unbilled Unmetered Consumption	
	Water Losses	Apparent Losses	Unauthorized Consumption	
			Customer Meter Inaccuracies	
			Data Handling Errors	
		Real Losses		

Figure 14: Unmetered and Unauthorized Consumption Identified in the Water Balance (Not to Scale)

Recommendation 5.1: *Unauthorized Consumption Volume Tracking*

Previous Study Conclusion

In water distribution systems, unauthorized consumption may occur through:

- Misuse of fire hydrants and fire fighting systems in unmetered fire lines
- Buried, vandalized, or bypassed consumption meters
- Illegal connections

In most cases, the unauthorized consumption is not measured and the utility may not have sufficient data to make reasonable estimates of this volume. LADWP staff anecdotally described rates of hydrant

misuse and theft off fire connections as quite high (though no specific volumes could be provided). Without volume estimations, the AWWA M36 Manual recommends assuming a default value of 0.25% of the water supplied as the volume of unauthorized consumption. For the FY 2010-2011 LADWP water audit, the estimated unauthorized consumption volume was 439.06 MG (1,347.43 AF).

Current Status

LADWP is aware of the fact that there are many different ways that water is being consumed without authorization. It may be residential or commercial theft, smashed or defective meters, cross connections between domestic and fire services, illegal fire hydrant connections, etc.

When accounts are identified as having a possible problem with the service, the Customer Service Division (CSD) Field Investigation (FI) and Revenue Security Unit (RSU) will attempt to identify the nature of loss: faulty equipment or intentional theft and tampering.

Following investigation, a corrected bill is issued using one of the following methods:

- estimated based on prior history on the account
- observation field checks of property, how services are being used, what equipment is installed
- developed using a daily rate of use on the new meter once installed
- on a negotiated basis with the customer

The billing instructions do not quantify the dollar amount but only the HCF to be billed. There is no formal way to capture this number at this time. FI generates Field Activities (F/A's) to Water Distribution Division (WDD) Meter and Service Section to have meters replaced when damaged or defective (stuck).

When RSU is involved, the accounts are referred from many areas (CSD reports and field operations, WDD Meter and Service Section, Security Services Division – Office of Special Investigations, email from reports filed at www.ladwp.com, LAFD, LADBS, LAPD, etc.). These accounts are suspected of engaging in theft or tampering with the services. The accounts are reviewed and investigated. Once identified as unauthorized consumption, RSU takes appropriate action to stop the use including issuing orders to WDD Meter and Service Section for removing or installing meters, disconnecting services. RSU attempts to determine the losses and render an appropriate one time bill for both the revenue loss as well as expenses associated with the cost to correct the issue. For illegal fire hydrant connections, RSU assesses a daily temporary meter fee unless there is a way to define the amount of water lost.

WDD Meter and Service Section currently only reads fire service meters when the meter vault is checked for maintenance. There are currently no scheduled actual readings and no mechanism to bill fire services. Generally, 10 HCF is allowed annually for fire system testing purposes. Usage registered on a fire service meter beyond that amount would be questionable.

List of Actions

No Action

Summary of Impact

The impacts of not tracking unauthorized consumption are two-fold:

1. The uncertainty in the unauthorized consumption value adds to the uncertainty of the total apparent loss volume (an accounting challenge that affects the real loss determination)
2. There is a need to measure the illegal activity/volume "lost" to theft in order to reduce it.

By only reading the detector check meters on fire services during periodic vault inspections, the potential water losses are likely to go undetected for several years. Additionally the detector check meter only records a portion of the water based on the rate of flow. Not reading the fire service meters on a regularly scheduled (monthly) basis means that there would still be greater volumes of undetected water that will continue to remain unknown. Therefore, uncertainties and errors will continue to be introduced into the water loss calculation.

Action 1: Initiate an Automated Meter Reading (AMR) Program for Fire Service Meters

Scope of Work

Install AMR infrastructure in the form of remote read radio frequency (RF) meters on all the fire services. Then change the read responsibility as these meters are installed from WDD Meter and Service to CSD Meter Reading. This would allow meter readings on a monthly basis to facilitate a quicker response to fire services showing recorded use. Out of 19,079 total fire services, 17,524 fire services still need to have RF meters installed. It is proposed to start with RF installations on around 1,000 fire services to pilot the program, and re-evaluate implementation on a full-scale basis at a later time.

RF units will need to be tested after installation and compared with manual reads to ensure they are working properly. In addition, meter registers should be reset to zero after installation to avoid generating a bill. WDD Meter & Service should manually read the meter upon RF installation to confirm starting read.

Meter readers will only be able to read flow that goes through the bypass meter. There is no meter on the detector check main line. So the reading can indicate flow going through the detector check, but will not provide an accurate measurement of the volume of water passing through the fire service main line.

Staffing Needs

WDD Meter and Service staff needed include 1 additional two man crew (1 hour each per detector check), 1 specialist, and 1 service worker. Customer Services will need increased staffing both in office and field functions. Account Services would need additional personnel to ensure proper coding for reading and billing services. Information Technology Services (ITS) Division will need to provide necessary resources for programming the fire services to be allowed to be read properly, configured and billed on CCB. There will also be requirements to develop tracking reports, exception reports, develop

WATER LOSS TASK FORCE

flags to alert and generate investigation requests to appropriate groups (WDD Meter and Service, FI, or RSU). CSD field operations will require additional personnel in meter reading, FI, and RSU to respond to regular reading, or investigating exceptions reported.

A Commercial Field Representative is needed to perform route design to incorporate fire service meters into existing routes. A Customer Service Representative is needed to assist with billing uses deemed over the allotted amount. A Programmer Analyst is needed to send and receive service points to and from RouteSmart and look at meter read upload and download processes.

All costs detailed in this action are based on a 2 ½ year period. Some additional continuing costs will exist after the initial two and one half year period for Customer Service Division as well as WDD Meter and Service to inspect, maintain and investigate fire services which will continue generate reports to be checked out.

Equipment, Materials, Rentals, and Contract Needs

Approximately 825 5/8 x 3/4 bypass meters with RF for 8" and smaller detector checks and 175 1 -1/2" bypass meters with RF for 10" detector checks are needed to replace the current fire service meters. Also needed are 4 vehicles (1 for WDD Meter and Service, 1 for CSD Meter Reading, and 2 for FI and RSU), computers, handheld devices, and other tools.

Estimated Costs

Table 75: Estimated Cost for Recommendation 5.1, Action 1

Staff/Item	Hours/Units	Cost
Staffing		
Capital Costs – for 6 months		
WDD Meter and Service Staff (2)	7,100 hours	\$413,000
Commercial Field Representative (1)	200 hours	\$8,000
Programmer Analyst (1)	500 hours	\$27,000
Operations & Maintenance Costs – per year		
Meter Readers (1)	3,780 hours	\$175,000
Field Investigators (1)	1,890 hours	\$208,000
Revenue Security Unit Investigator (1)	756 hours	\$223,000
Customer Service Representatives (1)	5,000 hours	\$160,000
Equipment, Materials, Rentals, Contracts		
Capital Costs		
Vehicles	4 units	\$112,000
5/8" x 3/4" Bypass Meters with RF	825 units	\$106,000
1" x 1 1/2" Bypass Meters with RF	175 units	\$49,000
Computers, Handheld Devices, Tools	2 units	\$8,000
Total Capital Costs (for 6 months)		\$723,000
Total Operations & Maintenance Costs (per year)		\$766,000

*Estimated Time***Table 76: Estimated Time for Recommendation 5.1, Action 1**

Task	Time
Installation of RF Meters	6 months
Route Design and Changes	2 months
Coding and Programming	3 months
Meter Reading and Field Investigations	Ongoing
Total Time	6 months + ongoing

Some phases of the timeline overlap in timeframe.

Action 2: Initiate an Advanced Metering Infrastructure (AMI) Program for Fire Service Meters

Scope of Work

Install advanced metering infrastructure (AMI), a.k.a. “smart meters”, on the bypass lines of fire service meters to track usage. The smart meters will track usage on an hourly basis and show patterns in usage that could determine potential theft. Since there are around 19,000 fire service meters in LADWP’s service area, a pilot installation of around 1,000 smart meters is recommended to begin with to evaluate the program and plan for future needs. A system for transmitting and downloading the data to a central server will also be needed. There will also be requirements to develop tracking reports, exception reports, develop flags to alert and generate investigation requests to appropriate groups (WDD Meter and Service, FI, or RSU). CSD field operations will require additional personnel in meter reading, FI, and RSU to respond to regular reading, or investigating exceptions reported.

LADWP is currently doing several pilot AMI programs. An evaluation of the AMI data and the reliability of the communications platform will be completed before implementing the installation of smart meters on a full-scale basis.

Staffing Needs

Five water service workers will be needed to install 1,000 smart meters in one year. A programmer analyst and database architect may be needed to program an alert system in CCB that would alert field investigations of above-average usage based on reading recorded by the smart meters. It is estimated that four field investigators, one revenue security investigator, and two customer service representatives will be needed to investigate flagged abnormal uses on fire service meters and generate bills for those accounts identified as over their allotment.

Equipment, Materials, Rentals, and Contract Needs

1,000 smart meter units will be needed. Five vehicles will also be needed.

WATER LOSS TASK FORCE

Estimated Costs

Table 77: Estimated Cost for Recommendation 5.1, Action 2

Staff/Item	Hours/Units	Cost
Staffing		
Capital Costs – for 1 year		
Water Service Workers (5)	1,040 hours	\$39,000
Database Architect (1)	500 hours	\$32,000
Programmer Analyst (1)	500 hours	\$27,000
Operations & Maintenance Costs – per year		
Field Investigators (1)	1,890 hours	\$208,000
Revenue Security Unit Investigator (1)	756 hours	\$223,000
Customer Service Representatives (1)	5,000 hours	\$160,000
Equipment, Materials, Rentals, Contracts		
Capital Costs		
Vehicles	5 units	\$140,000
Smart Meter Units	1,000 units	\$275,000
Total Capital Costs (for 1 year)		\$513,000
Total Operations & Maintenance Costs (per year)		\$591,000

Estimated Time

Table 78: Estimated Time for Recommendation 5.1, Action 2

Task	Time
Installation of Smart Meters	9 months
Coding and Programming	3 months
Field Investigations	Ongoing
Total Time	1 year + ongoing

Action 3: Research Other Areas of Potential Unauthorized Consumption and Recommend Policy Changes

Scope of Work

Staff from Water Distribution Division (WDD) and Water Resources Division (WRD) will conduct research and initial investigation of other potential types of unauthorized consumption not identified by the previous Water Loss Audit and Component Analysis study and not currently known by Customer Services Division or Security Services Division. This could include unauthorized fill-ups at fire hydrants by private companies or other individuals, or unauthorized disconnections of services. WDD and WRD staff will also recommend an ordinance or policy change to include measures for theft prevention, such as requiring meters on all trucks that fill up at hydrants.

Staffing Needs

One engineering associate and one water utility superintendent would be needed for the initial phase of research and investigation. Other staff needs would be determined at later date as needed.

Equipment, Materials, Rentals, and Contract Needs

No additional equipment, materials, rentals, and contract needs are needed during the initial stage.

Estimated Costs

Table 79: Estimated Cost for Recommendation 5.1, Action 3

Staff/Item	Hours/Units	Cost
Staffing		
Capital Costs – 2 months		
Engineering Associate (1)	200 hours	\$10,000
Water Utility Superintendent (1)	200 hours	\$15,000
Equipment, Materials, Rentals, Contracts		
N/A	N/A	N/A
Total Capital Costs (for 2 months)		\$25,000

Estimated Time

Table 80: Estimated Time for Recommendation 5.1, Action 3

Task	Time
Research and Investigation	1 month
Draft Suggested Policy Changes	1 month
Total Time	2 months

Recommended Action

Based on results from the previous FY 2010-2011 Water Loss Audit and Component Analysis study, the amount of unauthorized consumption in LADWP’s system was estimated to be 1,347 AF. At the current cost of MWD Tier 1 Treated Water, LADWP’s most expensive water source at \$923 per AF, this theft would amount to over \$1 million in loss of revenue. However, because this estimate is based on AWWA national standards and not on LADWP area-specific volumes of theft, which are currently not fully known, this estimate could be higher or lower than the actual value. Additionally, improving the estimates of unauthorized consumption volumes will improve subsequent estimates of apparent and real loss volumes in LADWP’s system. This will improve the data quality and validity score of the “Unauthorized consumption” entry on the AWWA water audit software.

Therefore, it is recommended to pursue a combination of Actions 1 and 2, pilot AMI/AMR installation, to help provide more information on theft occurring in LADWP’s system through fire service meters. This was a critical area identified for further investigation after the completion of the District Metered Area analysis in the previous FY 2010-2011 Water Loss Audit and Component Analysis study. Should Actions 1 and 2 prove successful, it is recommended to deploy AMI/AMR on a system-wide scale for all existing fire service meters and to include a design standard change that requires new fire services have AMI/AMR installed.

Furthermore, it is recommended to pursue Action 3 to continue research and investigate other sources of theft not known or identified, and to be able to suggest policy changes to help prevent such theft.

Recommendation 5.2: *Authorized Unmetered Uses Tracking*

Previous Study Conclusion

“Unbilled Unmetered Authorized Consumption” is the volume of water estimated as taken from the system unmetered and for which no bill is issued. For LADWP, uses of unbilled unmetered authorized consumption include fire fighting and mains flushing. However, records of estimates for these volumes were unavailable for the audit period. LADWP staff reports that flushing was kept at a minimum during the audit period due to mandatory conservation measures.

For the water balance, an estimate of 0.125% of the water supplied was used for unbilled unmetered authorized consumption. This equates to 219.47 MG (673.53 AF).

Current Status

Water Main Flushing

Water main flushing may be done as the result of field inspection of water quality complaints. In recent years, this may have been 2-5 times per year, which is very seldom. However, most regular flushing operations have been suspended due to current drought conditions.

Sewer Flushing

Sewer flushing is performed daily by the Los Angeles Bureau of Sanitation (LASAN) to remove blockages so that wastewater in sewer pipes can be conveyed to one of the City's four treatment/water reclamation plants for treatment, reuse or discharge. This flushing activity typically uses potable water.

LASAN estimates that on a daily basis, 40 wastewater collection crews are deployed to flush sewer pipes to comply with the goals initiated by Collection Systems Settlement Agreement. Each crew uses around 15,000 gallons of water per truck and can use up to 4 loads per truck per day. After the initial fill at a maintenance yard, all subsequent fills appear to be unmetered. In total, this amounts to 2,400,000 gallons used for flushing activities on a daily basis, or 624,000,000 gallons used on an annual basis. It is apparent that 75% of this use is unmetered. In FY 2013-2014, LASAN reports that 128,000 sewer pipes were flushed with potable water.

LASAN is currently working with LADWP's Recycled Water Planning Group to locate two new recycled water hydrants at its North Central Yard. These recycled water hydrants could be used for flushing activities and would reduce potable water used during sewer pipe flushing.

Street Sweeping Uses

Street sweeping water uses are not typically monitored and recorded. Per conversations with the Los Angeles Bureau of Street Services (LABSS), a street sweeping truck typically carries 325 gallons and is refilled three times a day. LABSS typically operates 65-75 sweepers daily. Based on this information, it is estimated that LABSS uses 17,000,000 gallons per year in street sweeping operations. Of that total, approximately 325,851 gallons per year of the water used in street sweeping operations is recycled water. This amounts to about 2% of the total street sweeping water usage.

Fire Fighting Uses

Water Operations Division (WOD) provides a rough estimate of water used to fight a specific fire upon special request. This estimate is calculated by considering the drawdown of nearby reservoirs and/or tanks that feed the system. Water Distribution Division (WDD), also provides estimates of water used to fight a specific fire upon request. Typically, WDD would take a look at the service zone and run a hydraulic analysis to determine the flow rate from the fire hydrant. WDD also looks at the hydrants in the area, and gets input from LAFD on which ones they used, and for approximately how long.

WOD, WDD, and Water Resources Division (WRD) staff have coordinated with Los Angeles Fire Department (LAFD) training coordinators to provide a suitable location for fire testing operations that does not result in water lost to the storm drain system. This was prompted by the current drought and the need for water conservation. WDD Meter and Service Section is currently in communications with LAFD to provide an appropriately-sized temporary meter that can be attached either to the hydrant or fire hose. The metered flows will provide a rough estimate of flows used by LAFD to fight fires. This could be a first step in refining estimates of fire fighting uses in LADWP's service area.

List of Actions

No Action

Summary of Impact

LADWP would continue to use the AWWA default value for unbilled unmetered authorized volumes. The validity score for this item would remain low.

Action 1: Provide an Estimate on Volume of Water Used for Water Main Flushing

Scope of Work

Water Operations Division hydrographers could use piezometers to monitor static pressures in the hydrants used for flushing and calculate an estimate of volume used. Due to staffing constraints, this type of monitoring could be performed on certain percentage of total flushing activities and the data extrapolated to provide an estimate of all water volumes used for flushing. The cost estimate assumes the hydrographer will spend 6 months out of the year working on estimating flushing volumes.

Due to the current drought, system flushing activities have been severely reduced to only those activities deemed necessary to remain in compliance with water quality requirements for disinfection within the distribution system pipelines. However, it is worth looking into this action to be prepared for when flushing activities may be ramped again in the near future.

Staffing Needs

One hydrographer will be needed to complete the work.

Equipment, Materials, Rentals, and Contract Needs

No additional equipment is needed as piezometers are already available.

WATER LOSS TASK FORCE

Estimated Costs

Table 81: Estimated Cost for Recommendation 5.2, Action 1

Staff/Item	Hours/Units	Cost
Staffing		
Operations & Maintenance Costs – per year		
Hydrographer (1)	1,040 hours	\$45,000
Equipment, Materials, Rentals, Contracts		
N/A	N/A	N/A
Total Operations & Maintenance Costs (per year)		\$45,000

Estimated Time

Table 82: Estimated Time for Recommendation 5.2, Action 1

Task	Time
Installation of Piezometers and Monitoring of Flushing Volumes	Ongoing
Total Time	Ongoing

Action 2: Provide Estimates of Volumes of Water Used in Fire Fighting and Training Activities

Scope of Work

Calculating the amount of water volume used for fire fighting and other unmetered Fire Department uses is challenging. Installing meters on every fire hydrant in LADWP's distribution system would cost upwards of \$1 billion and is not feasible. On some occasions, water is pumped directly from reservoirs and tanks to fight fires and it is not possible to know the exact amount pumped only for fire fighting purposes versus the amount used to supply the distribution system.

Therefore, estimates of water used during fire fighting will be reliant on the best information available from the LAFD on which hydrants, reservoirs, or tanks were used during a fire fighting activity, how long LAFD used these facilities, and the flow rate of the pumps used by LAFD trucks, hoses, and other equipment. WDD is capable of utilizing hydrologic models to calculate rough estimates of water volumes used if this type of information is available from LAFD; however, this is not currently done on a regular basis and is only calculated by special request.

One area that could potentially show improvements in estimates of water volumes used would be LAFD training exercises that are not metered. Sometimes LAFD must perform training exercises that involve hooking up to fire hydrants to simulate a fire fighting exercise. It may be possible for WDD to coordinate with LAFD to install temporary meters on hydrants used for training exercises. However, LAFD may have objections to hooking up to a meter instead of directly to a hydrant, as this would not simulate an actual fire fighting activity.

It is recommended that WDD staff hold meetings with LAFD staff to discuss what measures are possible in improving unmetered fire fighting and training volume estimates.

Staffing Needs

One engineering associate and one water utility superintendent would be needed for these meetings. Other staff needs would be determined at later date after both LADWP and LAFD plan and agree to an improved method for monitoring fire fighting flows.

Equipment, Materials, Rentals, and Contract Needs

No additional equipment, materials, rentals, and contract needs are needed during the initial stage.

Estimated Costs

Table 83: Estimated Cost for Recommendation 5.2, Action 2

Staff/Item	Hours/Units	Cost
<i>Staffing</i>		
<i>Capital Costs – 2 months</i>		
Engineering Associate (1)	40 hours	\$2,000
Water Utility Superintendent (1)	40 hours	\$3,000
<i>Equipment, Materials, Rentals, Contracts</i>		
N/A	N/A	N/A
Total Capital Costs (for 2 months)		\$5,000

Estimated Time

Table 84: Estimated Time for Recommendation 5.2, Action 2

Task	Time
Planning Meetings with LAFD	2 months
Total Time	2 months

Recommended Action

Based on results from the previous FY 2010-2011 Water Loss Audit and Component Analysis study, the amount of unbilled, unmetered consumption in LADWP's system was estimated to be 219 AF. However, because this estimate is based on AWWA national standards and not on LADWP area-specific volumes of authorized unbilled and unmetered consumption, which are currently not fully known, this estimate could be higher or lower than the actual value. Additionally, improving the estimates of unbilled, unmetered authorized consumption volumes will improve subsequent estimates of water loss volumes in LADWP's system. This will improve the data quality and validity score of the "Unbilled unmetered" entry on the AWWA water audit software.

Therefore, it is recommended to pursue both Actions 1 and 2 to determine if improvements can be made to estimates of water main flushing and fire fighting activities in LADWP's distribution system.

Conclusion

Table 85 provides a summary of recommended actions to improve the validity of data in the annual LADWP water loss audit and to reduce water losses in LADWP's water distribution system.

Table 85: Summary of Recommended Actions

Previous Study Recommendation	Recommended Action(s) to Pursue	Capital Cost	O&M Cost
Section 1: System Input Volume			
Recommendation 1.1: LA Aqueduct Filtration Plant System Input Volume Meters	Action 1: Track Volumes of Water Sources and System Water Supply Separately	\$5,000	N/A
	Action 2: Regular Calibration of Relevant Supply Volume Meters at LAAFP	N/A	\$7,000
Recommendation 1.2: LA Reservoir West Outlet Meter Installation	Action 1: Calculate West Outlet Flow using Mass Balance	\$2,000	N/A
Recommendation 1.3: Well Field Meter Accuracy and Regular Testing	Action 2: Installation of Flow Meters on Well Collector Lines	\$1,128,000	N/A
	Action 3: Calibrate Collector Facility Meters	N/A	\$184,000
Recommendation 1.4: Storage Data Tracking	No Action (Action 1 not cost-effective)	N/A	N/A
Recommendation 1.5: MWD LA-25 Connection Meter Installation	Action 1: Install an Ultrasonic Meter with Internal Mount Sensors	\$383,000	N/A
Section 1 Total Estimated Costs of Proposed Actions		\$1,518,000	\$191,000
Section 2: Database Management			
Recommendation 2.1: SCADA Database Consolidation	No Action (Feasibility of Action 1 being evaluated)	N/A	N/A
Recommendation 2.2: Recycled Water and Treatment Process Water Tracking	Action 1: Add a Recycled Water Identifier in the Billing System	\$29,000	N/A
	Action 2: Create a Standard Procedure for Identifying Treatment Process Water in the Billing System	\$8,000	N/A
Recommendation 2.3: CIS and WMIS Inconsistencies	Action 1: Address the Remaining Duplicate Badge Numbers	\$26,000	N/A
Recommendation 2.4: Leak Database Consolidation and Accuracy	Action 1: Develop a Second Pilot Mobile Leak Reporting System to Capture and Update Leak Information in Near-Real Time	\$20,000	N/A
Section 2 Total Estimated Costs of Proposed Actions		\$83,000	\$0

WATER LOSS TASK FORCE

<i>Section 3: Meter Testing and Replacement</i>			
<u>Recommendation 3.1:</u> Customer Meter Sizing and Regular Consumption Profiling	<i>No Action (AMI pilot programs already ongoing to assist with profiling)</i>	N/A	N/A
<u>Recommendation 3.2:</u> Regular Testing of Small Customer Meters	<i>Action 1: Implement Meter Testing of a Representative Sample of 1,000 Operational Small Meters</i>	\$240,000	N/A
<u>Recommendation 3.3:</u> Replacement of Worst Performing Small Customer Meters	<i>No Action (Action 1 not cost-effective until confirmation of results with increased small meter testing)</i>	N/A	N/A
<u>Recommendation 3.4:</u> Large Meter Maintenance Schedule Overhaul	<i>Action 1: Analyze Large Meter Test Results from Recent Years to Provide a Volume Weighted Average Accuracy</i>	\$4,000	N/A
Section 3 Total Estimated Costs of Proposed Actions		\$244,000	\$0
<i>Section 4: Leak Detection and Prevention</i>			
<u>Recommendation 4.1:</u> Pressure Management Improvement and Pilot Study	<i>Action 1: Site-Specific Pressure Monitoring in 13 Highest Leak Density Areas</i>	\$63,000	N/A
<u>Recommendation 4.2:</u> Leak Location and Repair Time Reduction	<i>Action 1: Add Internal Staff to Decrease Leak Response Times</i>	\$72,000	\$172,000
<u>Recommendation 4.3:</u> Active Leak Detection	<i>Action 1: Deploy Acoustic Leak Detection Crews to Survey 10% of the Entire System Per Year</i>	\$3,000	\$183,000
	<i>Action 3: Install Acoustic Leak Monitoring Sensors in Areas with Highest Leak Densities</i>	\$1,143,000	N/A
Section 4 Total Estimated Costs of Proposed Actions		\$1,281,000	\$355,000
<i>Section 5: Unmetered and Unauthorized Consumption</i>			
<u>Recommendation 5.1:</u> Unauthorized Consumption Volume Tracking	<i>Actions 1 & 2: Initiate Automated Meter Reading (AMR) and Advanced Metering Infrastructure (AMI) Programs for Fire Service Meters</i>	\$1,236,000	\$1,357,000
	<i>Action 3: Research Other Areas of Potential Unauthorized Consumption and Recommend Policy Changes</i>	\$25,000	N/A
<u>Recommendation 5.2:</u> Authorized Unmetered Uses Tracking	<i>Action 1: Provide an Estimate on Volume of Water Used for Water Main Flushing</i>	N/A	\$45,000
	<i>Action 2: Provide Estimates of Volumes of Water Used in Fire Fighting and Training Activities</i>	\$5,000	N/A
Section 5 Total Estimated Costs of Proposed Actions		\$1,241,000	\$1,402,000
Total Estimated Costs of All Proposed Actions		\$4,392,000	\$1,948,000

Appendix

Table 86 identifies the recommended actions from the previous FY 2010-2011 Water Loss Audit and Component Analysis study and the key LADWP staff who worked on the write-up for each section of the Water Loss Task Force Action Plan. The Action Plan was coordinated by the Water Resources Division Water Conservation Policy Group and was edited by Sofia Marcus of the Water Conservation Policy Group. Reinhard Sturm and Kate Gasner from Water Systems Optimization, Inc. served as consulting technical experts and provided guidance to the key staff in Water Loss Task Force meetings and during the drafting of the Action Plan.

Table 86: List of Sections, Recommended Actions, and Key LADWP Staff

Section	Issue	Recommended Actions	Explanation	Key Staff	Division
1	<u>System Input Volume</u>	1.1 - Use the LA Aqueduct Filtration Plant relevant effluent meters for the system input volume calculation instead of the LA Aqueduct final meters currently used.	System Input Volume should be measured as closely to the start of the distribution system as possible. In addition, process water and recycled backwash water used at the LA Aqueduct Filtration Plant complicates the system input volume calculation if measured at the influent points rather than the effluent points.	Dave Christensen Simon Hsu Greg Loveland	WOD WRD WOD
	Critical improvements in meter accuracy need to be made to improve the Water Loss calculation.	1.2 - Install a meter on the LA Reservoir West Outlet.	The West Outlet is a key component of the system input volume calculation. Without a meter, the volume through the West Outlet must be estimated and this impacts the accuracy of the system input volume total.	John Otoshi Vince Rivera Linh Phan	WETS WETS WOD
		1.3 - Improve the accuracy of metering the well field production and implement regular well meter testing.	Current meters installed on the individual wells do not have sufficient straight pipe length to prevent turbulence that can disturb the meter read. Also, well meters are read manually and not connected to a SCADA system, and well volumes are available only on a monthly basis.	Phil Clark Ani Siyahian Gonzalo Reyes	WETS WETS WOD

WATER LOSS TASK FORCE

Section	Issue	Recommended Actions	Explanation	Key Staff	Division
1	<p><u>System Input Volume</u> (continued from previous page)</p> <p>Critical improvements in meter accuracy need to be made to improve the Water Loss calculation.</p>	1.4 - Track all reservoir level data (and other data related to storage volumes).	Not all storage volume data is available on SCADA, and the storage volume currently reported on a monthly basis contains an estimated volume for all reservoirs with insufficient data.	Linh Phan Robert Tokashiki	WOD WOD
		1.5 - Install a meter on the LA-25 MWD connection.	LA-25 supplies water to LADWP when the LA Aqueduct Filtration Plant is down for maintenance. LA-25 is not directly metered, and the volume delivered is therefore calculated by mass balance through the Jensen Treatment Plant.	John Otoshi Vince Rivera Du Tran	WETS WETS WETS
2	<p><u>Database Management</u></p> <p>Data should be organized in a more efficient manner. Some of the data also has issues with accuracy and/or needs to be updated.</p>	2.1 - Streamline the multiple SCADA systems that house all of the system input volume data.	Data from the meters relevant to the system input volume calculation are not located in one SCADA system, but at least three systems - LAWSDAC, TOCC/Wave Server, and Northern District Hydrologic Database (Bishop). The data needs to be streamlined into one easy-to-use system that is easily accessible by Water Resources staff.	Robert Tokashiki	WOD
		2.2 - Re-categorize recycled water and process water accounts in the billing system if they are not already properly coded.	All recycled water accounts should be categorized as Rate Code 44 in CIS and excluded from the water loss audit analysis as they are not a part of the potable water demand. Two accounts related to LA Aqueduct Filtration Plant process water should also be re-catgorized in CIS and excluded from the analysis.	Flora Chang Kathy Wright Don Cresse	ITS ITS WETS

Section	Issue	Recommended Actions	Explanation	Key Staff	Division
2	<p><u>Database Management</u> (continued from previous page)</p> <p>Data should be organized in a more efficient manner. Some of the data also has issues with accuracy and/or needs to be updated.</p>	<p>2.3 - Address problems and inconsistencies in the Customer Information System (CIS) and Work Management Information System (WMIS), and improve meter data quality in CIS.</p>	<p>CIS contains all of the account and billing data, and WMIS contains service data, however both overlap with meter and other data. The overlapping data is not consistent across the databases. In addition, improving the data quality on the size, make, age, and location of meters in the billing database is critical to any meter maintenance program going forward.</p>	<p>Carolina Maldonado Javier Romero Hugo Torres</p>	<p>CSD WDD WDD</p>
		<p>2.4 - Create one database for leak information that addresses problems and inconsistencies in the various existing databases.</p>	<p>Information on leaks reported on mains and on service lines between the main and curb are stored in two databases - GIS and Trouble Board. Cross-referencing between the two databases requires a tedious, manual effort. Similarly, information on leaks reported on service lines between the curb and meter box, and information on leaks reported within the meter box, are stored in several other databases, including CPS, WMIS, and Meter Investigation Reports. All of the leak information should ideally be stored in one database. Also, timestamps should reflect the time the leak was plugged, not the time staff entered the data into the database. In addition, WSO provided an extensive list of attributes that are recommended for database record keeping on leaks.</p>	<p>Steve Cole Shabbir Baldiwala</p>	<p>WDD WDD</p>

WATER LOSS TASK FORCE

Section	Issue	Recommended Actions	Explanation	Key Staff	Division
3	<p><u>Meter Testing and Replacement</u></p> <p>Customer meter testing should occur regularly and consumption profiles should be analyzed on a regular basis.</p>	<p>3.1 - Investigate the improperly-sized meters/accounts highlighted in Appendix E. Develop a future schedule for regular consumption profiling.</p>	<p>Meters that are too small for the relatively larger consumption rates will not accurately read the volumes passing through the meter. Vice versa, meters that are too large for small consumption rates will not accurately read the small volumes. This affects the accuracy of the total demand volume calculated. Meters that are too small or too large for the amount of consumption used as shown by the billing database should be tested and potentially replaced by an appropriate size.</p>	<p>Javier Romero Ricky Glover Kathy Wright Flora Chang</p>	<p>WDD WDD ITS ITS</p>
		<p>3.2 - Perform regular testing of an appropriate, representative sample of small and large customer meters.</p>	<p>Most customer meters are not tested on a regular basis and may be under-registering or otherwise non-functional. Perform regular testing of random small meter samples (100-200 meters per year).</p>	<p>Javier Romero Ricky Glover Kathy Wright Flora Chang</p>	<p>WDD WDD ITS ITS</p>
		<p>3.3 - Replace the worst-performing small customer meters.</p>	<p>A representative sample of around 1,000 small meters conducted during the Water Loss Audit study indicated the worst-performing meters out of the ones tested were Sensus meters of these sizes: 5/8 x 3/4", 3/4 x 1", 1 1/2", and 2".</p>	<p>Ricky Glover</p>	<p>WDD</p>
		<p>3.4 - Overhaul the large meter maintenance schedule to target more frequent maintenance and replacement of large customer meters with the highest consumption rates (based on past usage).</p>	<p>WSO provided a recommended overhaul schedule of the large customer meters in Section 10.2. For the top one hundred large customer meters (ranked by revenue generated), it is recommended to undertake consumption profiling and targeted selection of appropriate metering technology.</p>	<p>Ricky Glover</p>	<p>WDD</p>

Section	Issue	Recommended Actions	Explanation	Key Staff	Division
4	<p><u>Leak Detection and Prevention</u></p> <p>There is not enough data available to accurately assess system zone typical flow, pressure, and leak potential.</p>	<p>4.1 - Improve pressure management through implementation of a pilot study.</p>	<p>Most system zones are operated at high pressures. High pressures can put strain on the infrastructure and contribute to system leakage. If possible, determine ways to decrease pressure within the system zones. WSO provided recommendations to implement a pilot study for pressure management in Section 11.4.</p>	<p>Todd Huynh Todd Le Linh Phan Gary Warden Marce-Adrian Perez Russell Pierson</p>	<p>WDD WDD WOD WOD WETS WETS</p>
		<p>4.2 - Reduce the average location and repair time for main leaks, service connection leaks, and appurtenance leaks.</p>	<p>An initial modeling of savings suggests that a significant real loss reduction could be achieved (approximately \$1.6 million annually based on MWD water rates) if the average location and repair time was reduced by 50%. This initial savings analysis is based on the average location and repair time as determined from the leak repair records from FY 2010-2011; before response time improvements are pursued, it is important to revisit the reliability and completeness of the response time data.</p>	<p>Jeff Bray</p>	<p>WDD</p>
		<p>4.3 - Implement a regular active leak detection program to the extent that is cost-effective.</p>	<p>Active leak detection can find leaks in pipes that have not yet surfaced and prevent damage to above-ground infrastructure through proactive leak repair. WSO recommends targeting 10-15% of the distribution network for leak detection surveying each year.</p>	<p>Charles Ngo Dean Terada Cree Horner</p>	<p>WETS WETS WDD</p>

WATER LOSS TASK FORCE

Section	Issue	Recommended Actions	Explanation	Key Staff	Division
5	<u>Track Authorized Unmetered and Unauthorized Consumption</u>	5.1 - Track and estimate volumes lost from unauthorized consumption (theft).	Currently, an AWWA standard percentage estimate is applied as the theft volume. Better estimates based on LADWP-specific information should be calculated to improve the accuracy of this number. Read fire service meters on a regular basis to determine if unauthorized consumption is occurring. Consider reading customer meters on irregular days (like Sundays) every once and a while and/or install Advanced Metering Infrastructure (AMI) to catch any meter tampering that may occur.	Wayne Wohler Kim Versluis Carolina Maldonado Javier Romero Ricky Glover Kathy Wright Flora Chang	CSD CSD CSD WDD WDD ITS ITS
		5.2 - Track and estimate volumes from authorized unmetered unbilled uses (such as fire fighting and system flushing).	Currently, an AWWA standard percentage estimate is applied as the unmetered unbilled volume. Better estimates based on LADWP-specific information should be calculated to improve the accuracy of this number.	Cree Horner Alvin Bautista Mike Downs	WDD WDD WDD